



# Brighton Council

---

## ATTACHMENTS

PLANNING AUTHORITY

2 JUNE 2026



P I N N A C L E

# PINNACLE

Note: The images provided are artistic representations only and should not be used as references for final colours, finishes, or external/internal features.














## 77 Fouche Avenue, Old Beach 7017

Owner(s) or Clients	Lyden Developments	Title Reference	187482/1
Building Classification	1a	Zoning	General Residential
Designer	Jason Nickerson CC6073Y	Land Size	1400m <sup>2</sup>
Total Floor Area (Combined)	540.90m <sup>2</sup>	Design Wind Speed	TBA
Alpine Area	N/A	Soil Classification	TBA
Other Hazards <small>(e.g., High wind, earthquake, flooding, landslip, dispersive soils, sand dunes, mine subsidence, landfill, snow &amp; ice, or other relevant factors)</small>	Low coastal inundation hazard band	Climate Zone	7
		Corrosion Environment	Medium
		Bushfire Attack Level (BAL)	Low


ID	Sheet Name	Issue
A0.01	Location Plan	DA - 06
A0.02	Site Plan	DA - 06
A0.03	Site Plan	DA - 06
A0.04	Site Elevations	DA - 06
A1.01	U1 - Floor Plan	DA - 06
A1.02	U1 - Elevations	DA - 06
A1.03	U1 - Elevations	DA - 06
A1.04	U1 - Roof Plan	DA - 06
A1.05	U1 - Electrical Plan	DA - 06
A2.01	U2 - Floor Plan	DA - 06
A2.02	U2 - Elevations	DA - 06
A2.03	U2 - Elevations	DA - 06
A2.04	U2 - Roof Plan	DA - 06
A2.05	U2 - Electrical Plan	DA - 06
A3.01	U3 - Floor Plan	DA - 06
A3.02	U3 - Elevations	DA - 06
A3.03	U3 - Elevations	DA - 06
A3.04	U3 - Roof Plan	DA - 06
A3.05	U3 - Electrical Plan	DA - 06
A4.01	U4 - Floor Plan	DA - 06
A4.02	U4 - Elevations	DA - 06
A4.03	U4 - Elevations	DA - 06
A4.04	U4 - Roof Plan	DA - 06
A4.05	U4 - Electrical Plan	DA - 06
C.01	Parking	DA - 06
L.01	Landscaping Plan	DA - 06
L.02	Planting Schedule & Details	DA - 06

**Legend**

-  - Electrical Connection
-  - Electrical Turret
-  - Sewer Connection
-  - Stormwater Connection
-  - Telstra Connection
-  - Telstra Pit
-  - Water Meter
-  - Water Stop Valve
-  - Fire Hydrant
-  - Solar Bollard Light
-  - Spotlight with sensor

**Survey Notes**

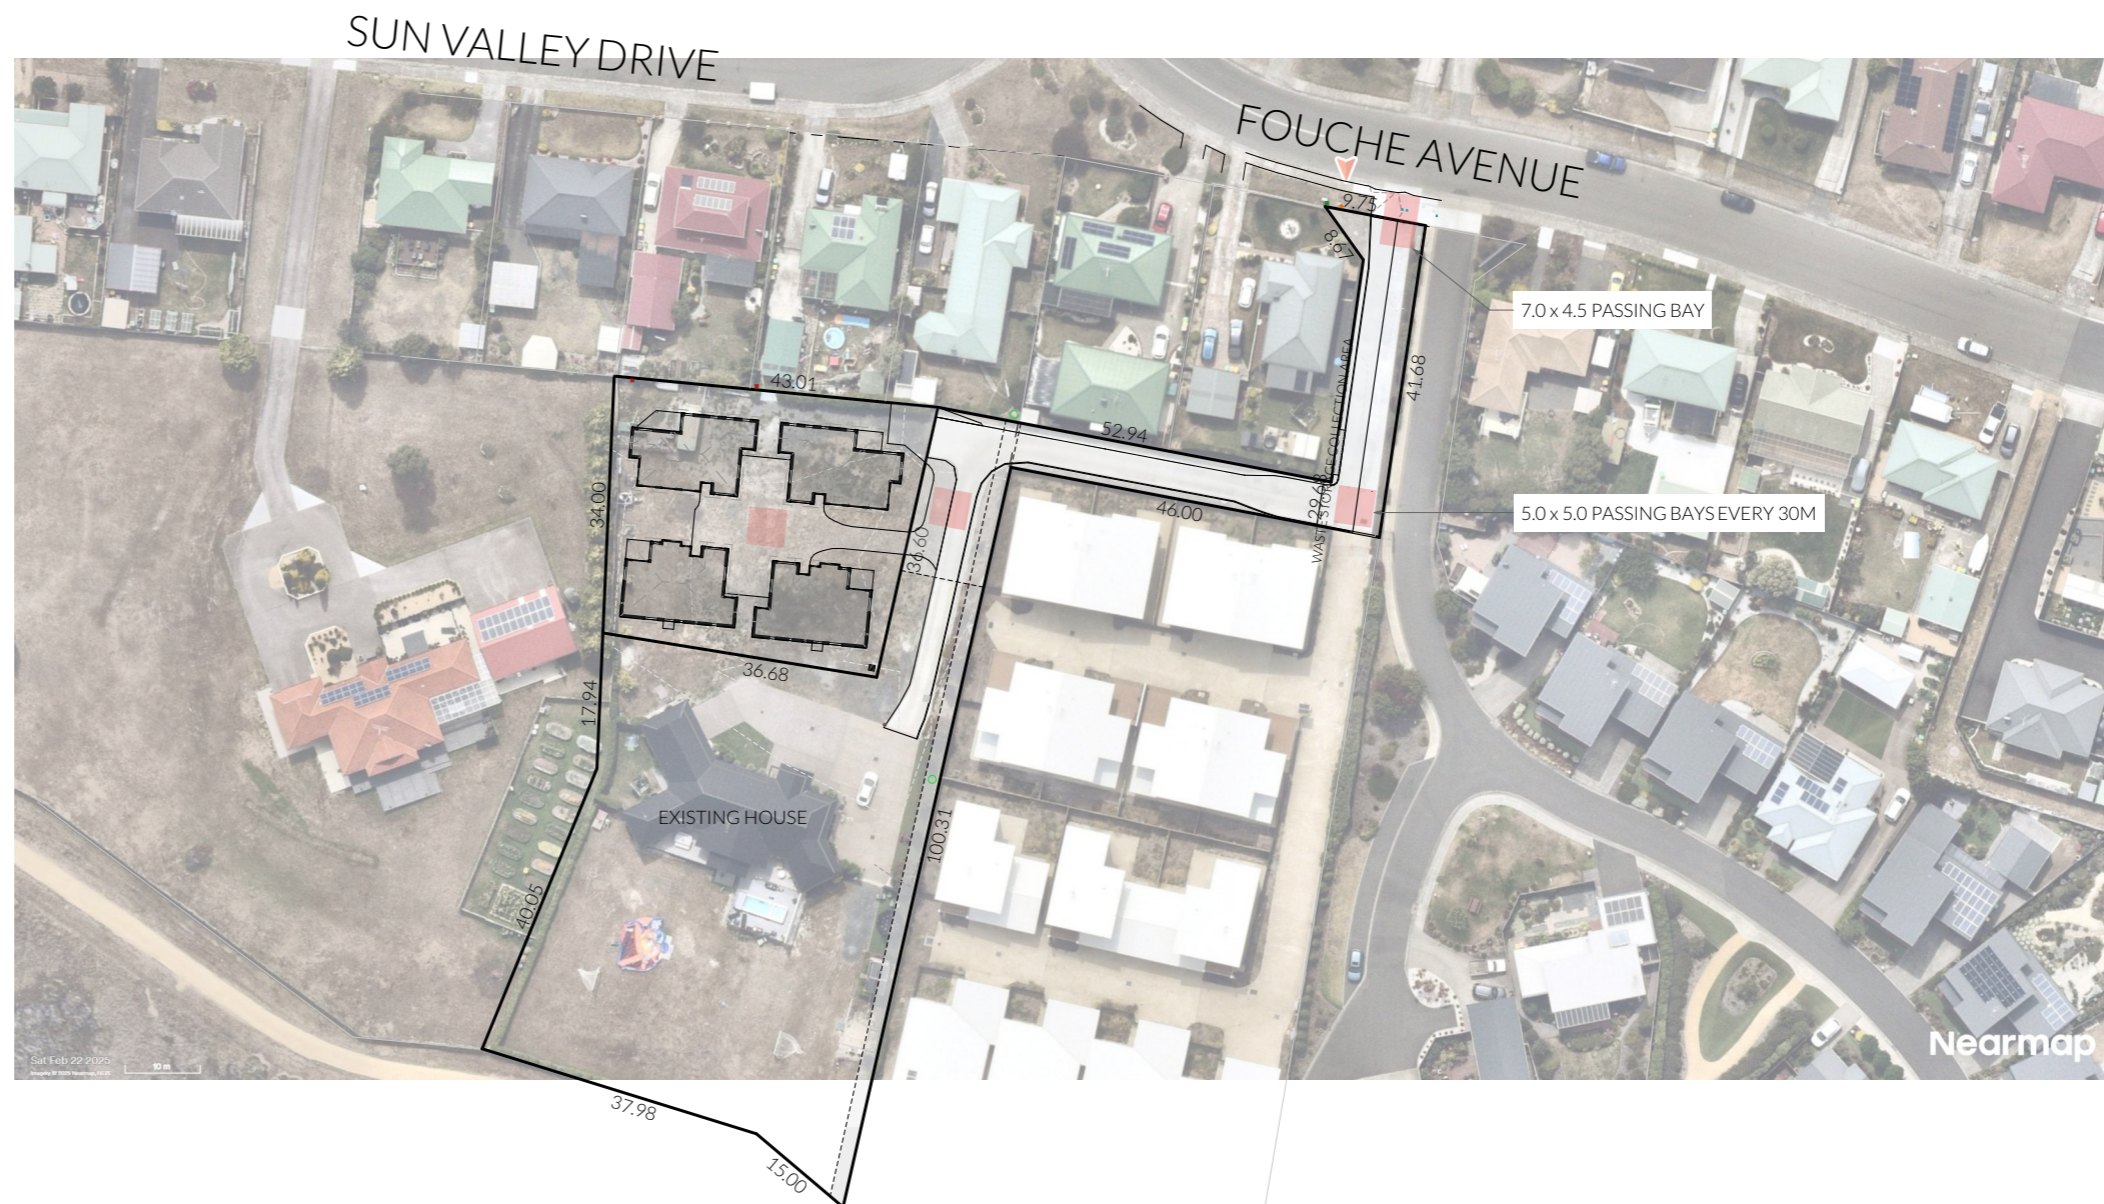


The site details shown are based off the subdivision plan by Rodgerson and Birch. All measurements and areas are subject to the final survey














**Site Areas**

Site Area 1400m<sup>2</sup>  
 Building Footprint 540.90m<sup>2</sup>  
 Site Coverage 597.82m<sup>2</sup>  
 Total Site Coverage 42.70%

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>Location Plan</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:1000 @ A3</b>  Pg. No: <b>A0.01</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																								
DA - 02	21.02.2025	Council RFI, add turning paths																									
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																									
DA - 04	07.04.2025	Council RFI, driveway and services																									
DA - 05	11.02.2026	Revise plans to match civil design																									
DA - 06	07.04.2026	Council RFI																									

**Legend**

-  - Electrical Connection
-  - Electrical Turret
-  - Sewer Connection
-  - Stormwater Connection
-  - Telstra Connection
-  - Telstra Pit
-  - Water Meter
-  - Water Stop Valve
-  - Fire Hydrant
-  - Solar Bollard Light
-  - Spotlight with sensor

EXISTING SEWER CONNECTION  
R.L: 2.33  
INV: 1.59

EXISTING SEWER INSPECTION POINT  
R.L: 2.24  
INV: 1.47

EXISTING SW MANHOLE 1025Ø  
R.L: 2.37  
INV: 1.41

Revision 07/04/26

Revision 07/04/26

Revision 07/04/26



**\* NOTE**  
VISITOR PARKING ONLY SIGN  
300 x 400  
(LOCATED ON FENCE  
VISIBLE FROM DRIVEWAY  
1500h+/-)



**# NOTE**  
EXAMPLE:  
RESERVED PARKING FOR UNIT X  
225 x 300  
(LOCATED ON FENCE  
VISIBLE FROM DRIVEWAY  
1500h+/-)



**Important Note**

Refer to civil plans completed by Henry Design & Consulting drawing number H25038 for further details

NOT FOR CONSTRUCTION


**PINNACLE**  
PINNACLE DRAFTING & DESIGN  
7/3 Abernant Way, Cambridge 7170  
03 6248 4218  
admin@pinnacledrafting.com.au  
www.pinnacledrafting.com.au  
Licence: CC6073Y

**Site Plan**  
Scale: 1:200 @ A3  
Pg. No: A0.02  
Revision: DA - 06  
Approved by: JRM

Proposal: Unit Development  
Client: Lyden Developments  
Address: 77 Fouche Avenue, Old Beach 7017

Date: 11/02/2026  
Drawn by: MM  
Job No: 065-2023  
Engineer: TBA  
Building Surveyor: LTBS

Issue	Date	Description
DA - 02	21.02.2025	Council RFI, add turning paths
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3
DA - 04	07.04.2025	Council RFI, driveway and services
DA - 05	11.02.2026	Revise plans to match civil design
DA - 06	07.04.2026	Council RFI



These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.

**Lydenbuilders**  
bdaa  
BUILDING DESIGNERS  
ASSOCIATION OF AUSTRALIA






Site Elevation - North Elevation

1:150




Site Elevation - South Elevation

1:150

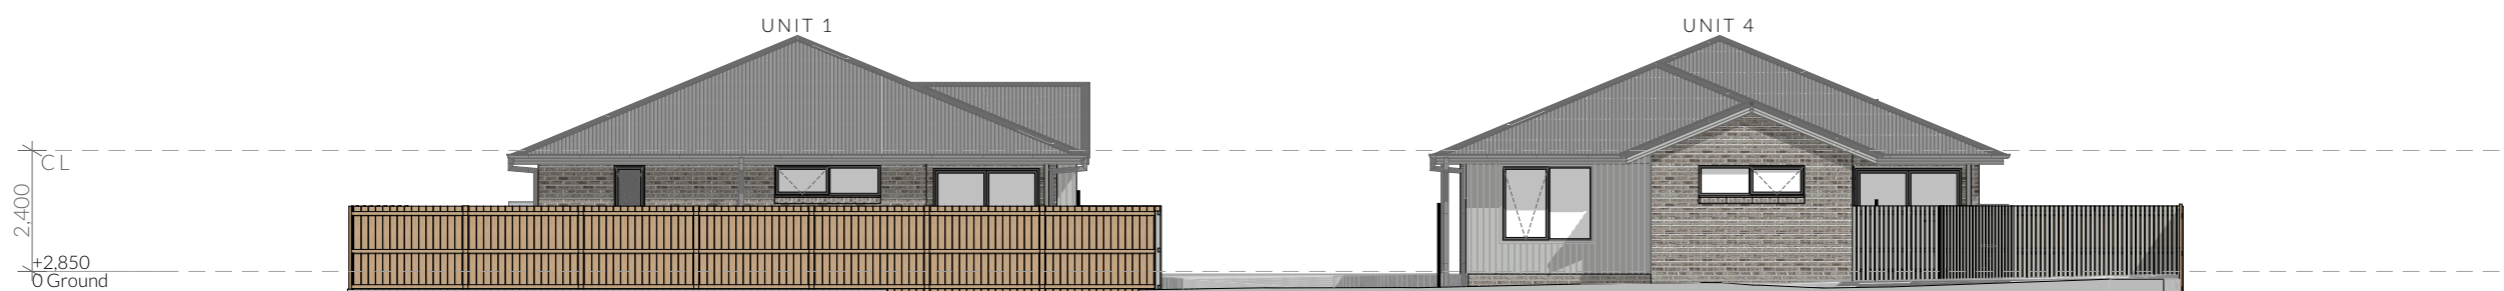

Site Elevation - East Elevation

1:150

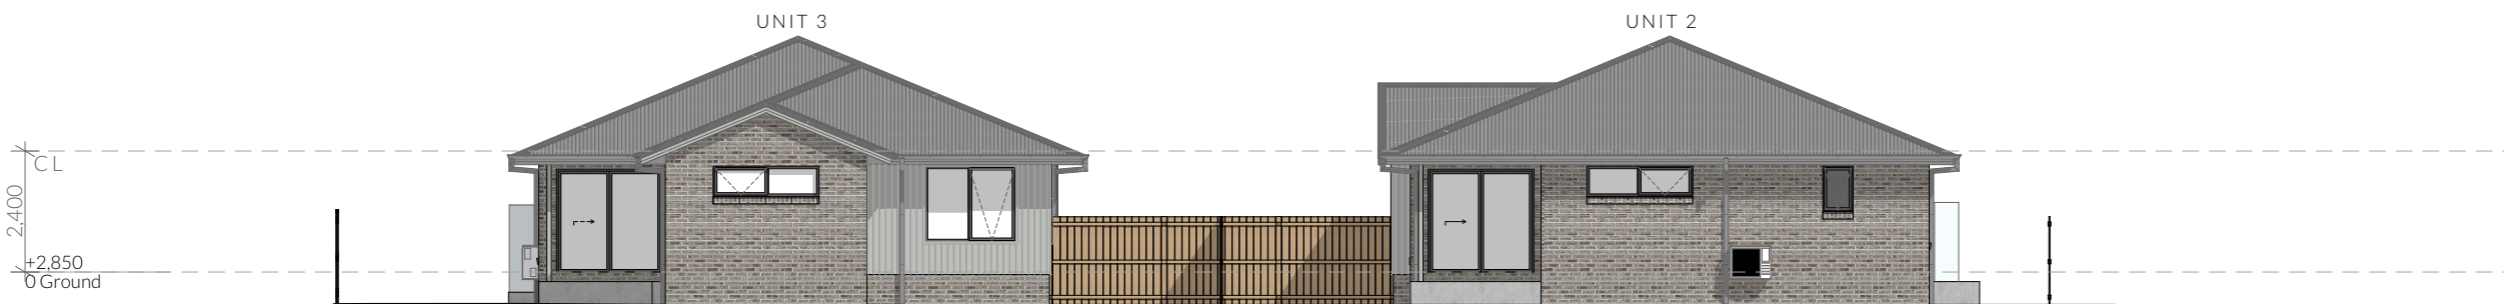

Site Elevation - West Elevation

1:150

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>Site Elevations</b>  Revision: DA - 06 Approved by: JRM	Scale: <b>1:150</b> @ A3  Pg. No: <b>A0.04</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																							
DA - 02	21.02.2025	Council RFI, add turning paths																								
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																								
DA - 04	07.04.2025	Council RFI, driveway and services																								
DA - 05	11.02.2026	Revise plans to match civil design																								
DA - 06	07.04.2026	Council RFI																								



Access Panel



Articulation Joint



Smoke Alarm

— BATTIS TO WALL

— SOUND INSULATION

### Construction of sanitary compartments 10.4.2 of NCC 2022

The door to a fully enclosed sanitary compartment must -

- open outwards; or
- slide; or
- be readily removable from the outside of the compartment.

unless there is a clear space of at least 1.2 m, measured in accordance with Figure 10.4.2 of NCC 2022 Vol II, between the closet pan within the sanitary compartment and the doorway.

### Note: Safe Movement & Egress

Openable windows greater than 4m above the surface below are to be fitted with a device to limit opening or a suitable screen so a 125mm sphere cannot pass through. Except for Bedrooms, where the requirement is for heights above 2m. Refer to clauses 11.3.7 and 11.3.8 of NCC 2022 for further information on suitable protective devices.

### Note: Paved Areas

All paths and patios to fall away from dwelling.

### Note: Stair Construction

All stairs to be constructed in accordance with NCC Vol II 2022 Part 11.2.2:

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

For stairways serving non-habitable room used infrequently, refer to table 11.2.2(b).

Landings to comply with Clause 11.2.5 and be a minimum of 750mm deep measured 500mm from the inside edge of the landing.

Slip resistance of treads, nosings and ramps to comply with Clause 11.2.4.

### Heights of rooms & other spaces 10.3.1 of NCC 2022

Heights of rooms and other spaces must not be less than;

- (a) in a habitable room excluding a kitchen - 2.4 m; and
- (b) in a kitchen - 2.1 m; and
- (c) in a corridor, passageway or the like - 2.1 m; and
- (d) in a bathroom, shower room, laundry, sanitary compartment, airlock, pantry, storeroom, garage, car parking area or the like - 2.1 m; and
- (e) in a room or space with a sloping ceiling or projections below the ceiling line within- See NCC directly for these items
- (f) in a stairway, ramp, landing, or the like - 2.0 m measured vertically above the nosing line of stairway treads or the floor surface of a ramp, landing or the like.

If required onsite, the builder may work within the tolerances of the above as specified within the NCC 2022 Vol II. Builder to contact Pinnacle before undertaking works.

### Unit 1 Floor Areas

Floor Area	135.90m <sup>2</sup>
Alfresco	8.21m <sup>2</sup>
Porch	2.69m <sup>2</sup>
Landing	1.43m <sup>2</sup>



# PINNACLE

PINNACLE DRAFTING & DESIGN  
 7/3 Abernant Way, Cambridge 7170  
 03 6248 4218  
 admin@pinnacledrafting.com.au  
 www.pinnacledrafting.com.au  
 Licence: CC6073Y

**U1 - Floor Plan**

Revision: **DA - 06**  
 Approved by: **JRM**

Scale: **1:100 @ A3**  
 Pg. No: **A1.01**

Proposal: Unit Development  
 Client: Lyden Developments  
 Address: 77 Fouche Avenue, Old Beach 7017

Date: 11/02/2026  
 Drawn by: MM  
 Job No: 065-2023  
 Engineer: TBA  
 Building Surveyor: LTBS


Issue	Date	Description
DA - 02	21.02.2025	Council RFI, add turning paths
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3
DA - 04	07.04.2025	Council RFI, driveway and services
DA - 05	11.02.2026	Revise plans to match civil design
DA - 06	07.04.2026	Council RFI



These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.



# NOT FOR CONSTRUCTION

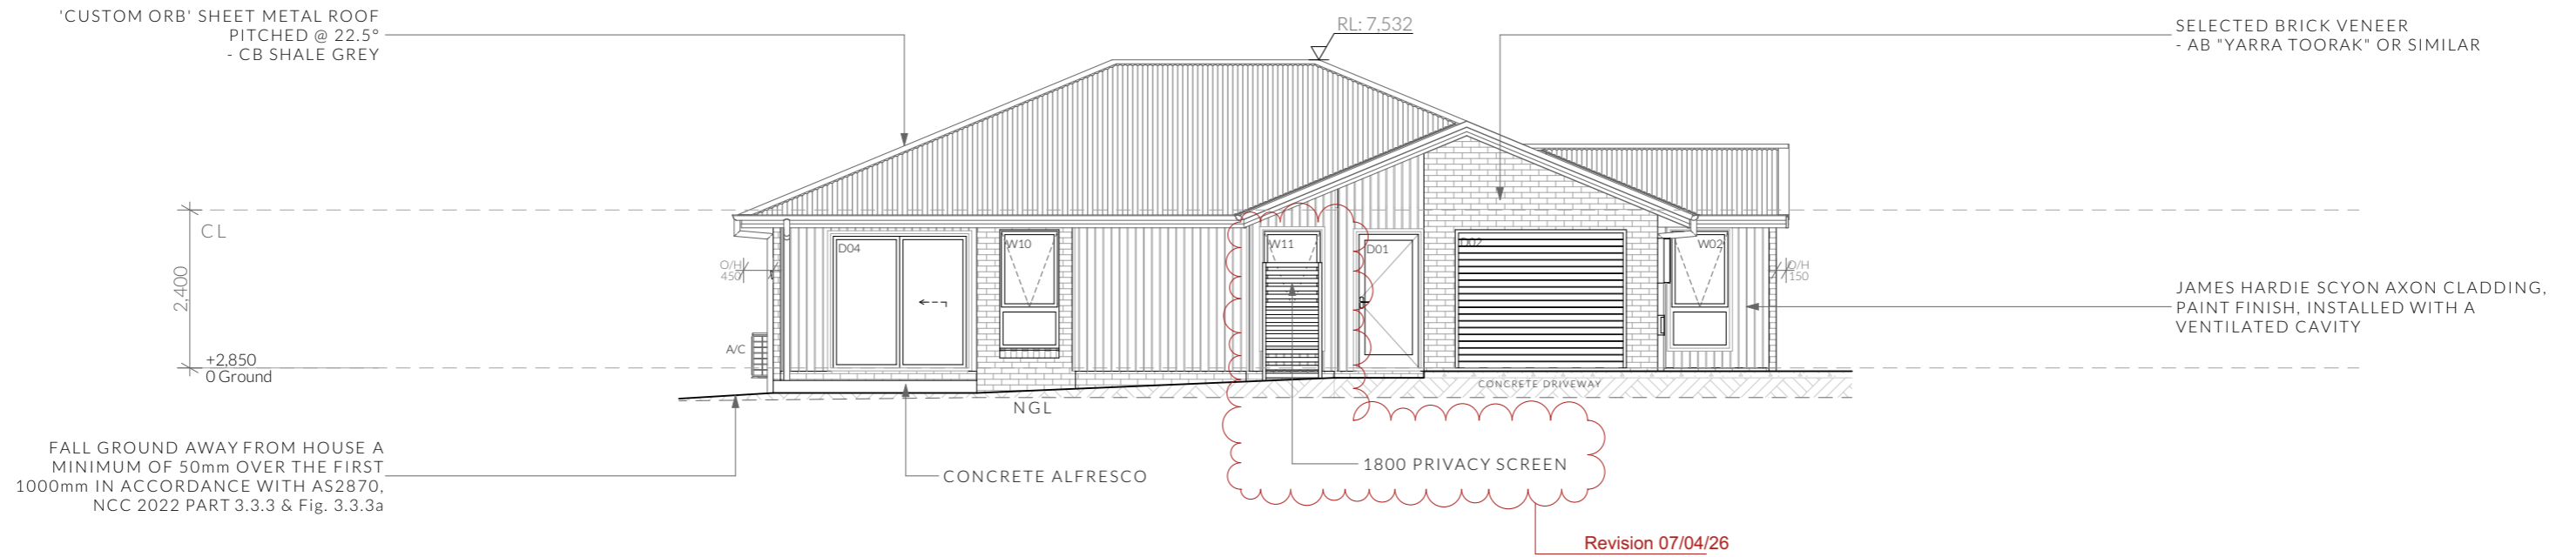

U1 - North Elevation

1:100



U1 - South Elevation

1:100

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of: 100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2


Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700


NOT FOR CONSTRUCTION

<p>PINNACLE PINNACLE DRAFTING &amp; DESIGN 7/3 Abernart Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y</p>	<p><b>U1 - Elevations</b></p> <p>Revision: <b>DA - 06</b> Approved by: <b>JRM</b></p>	<p>Scale: <b>1:100</b> @ A3 Pg. No: <b>A1.02</b></p>	<p>Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017</p>	<p>Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS</p>	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	<p>Lydenbuilders BUILDING DESIGNERS ASSOCIATION OF AUSTRALIA</p>
	Issue	Date	Description																						
DA - 02	21.02.2025	Council RFI, add turning paths																							
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																							
DA - 04	07.04.2025	Council RFI, driveway and services																							
DA - 05	11.02.2026	Revise plans to match civil design																							
DA - 06	07.04.2026	Council RFI																							

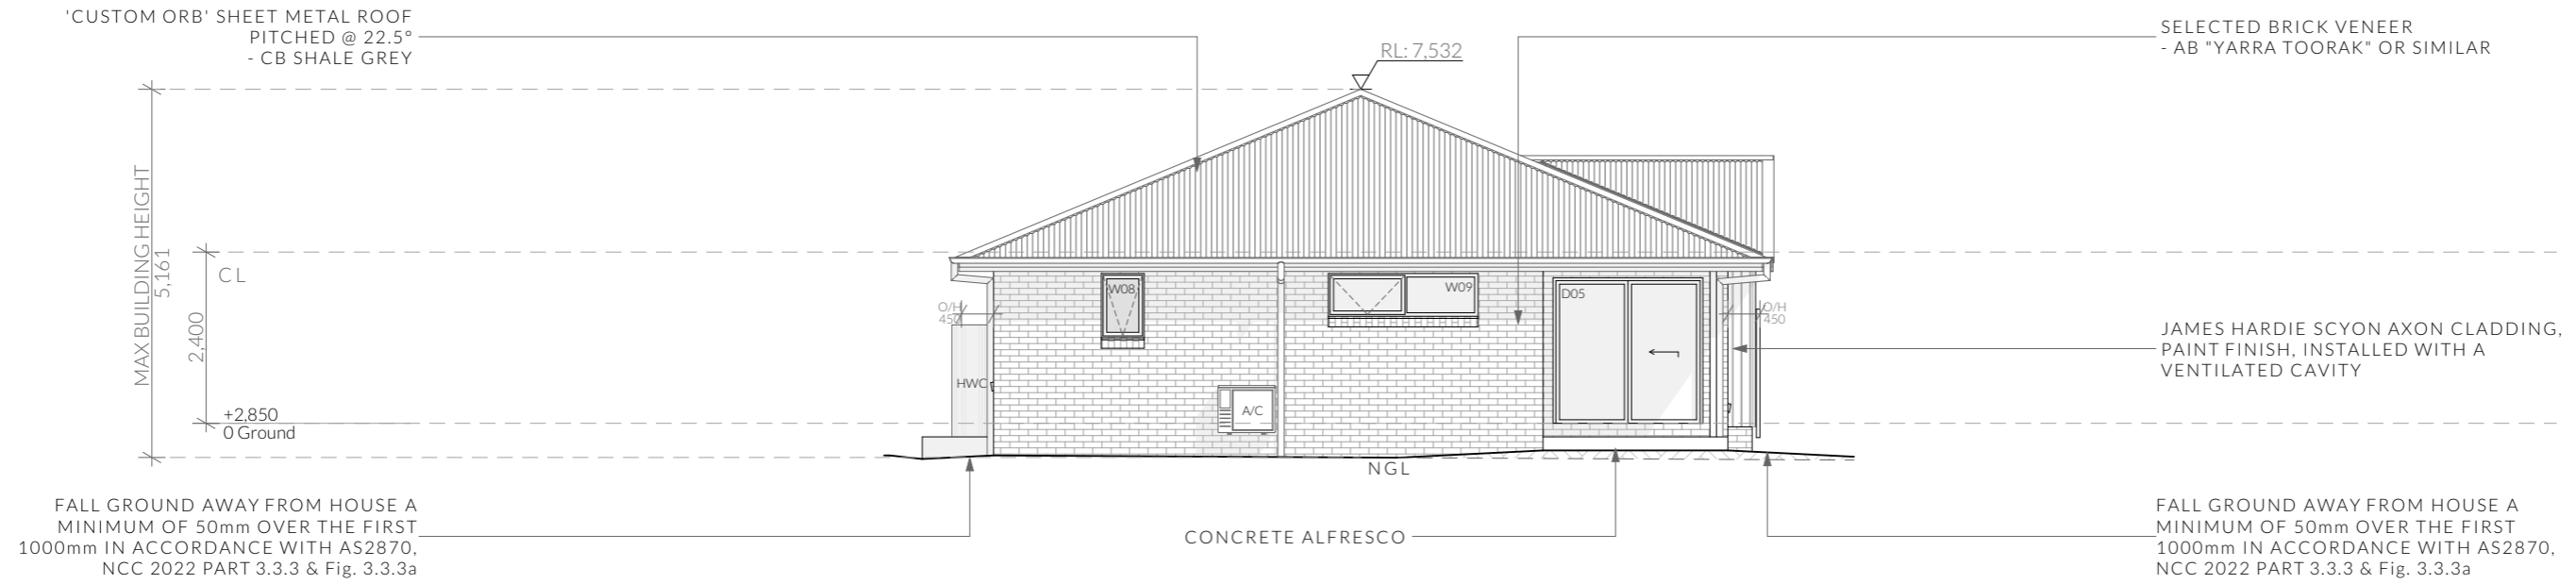

U1 - East Elevation

1:100

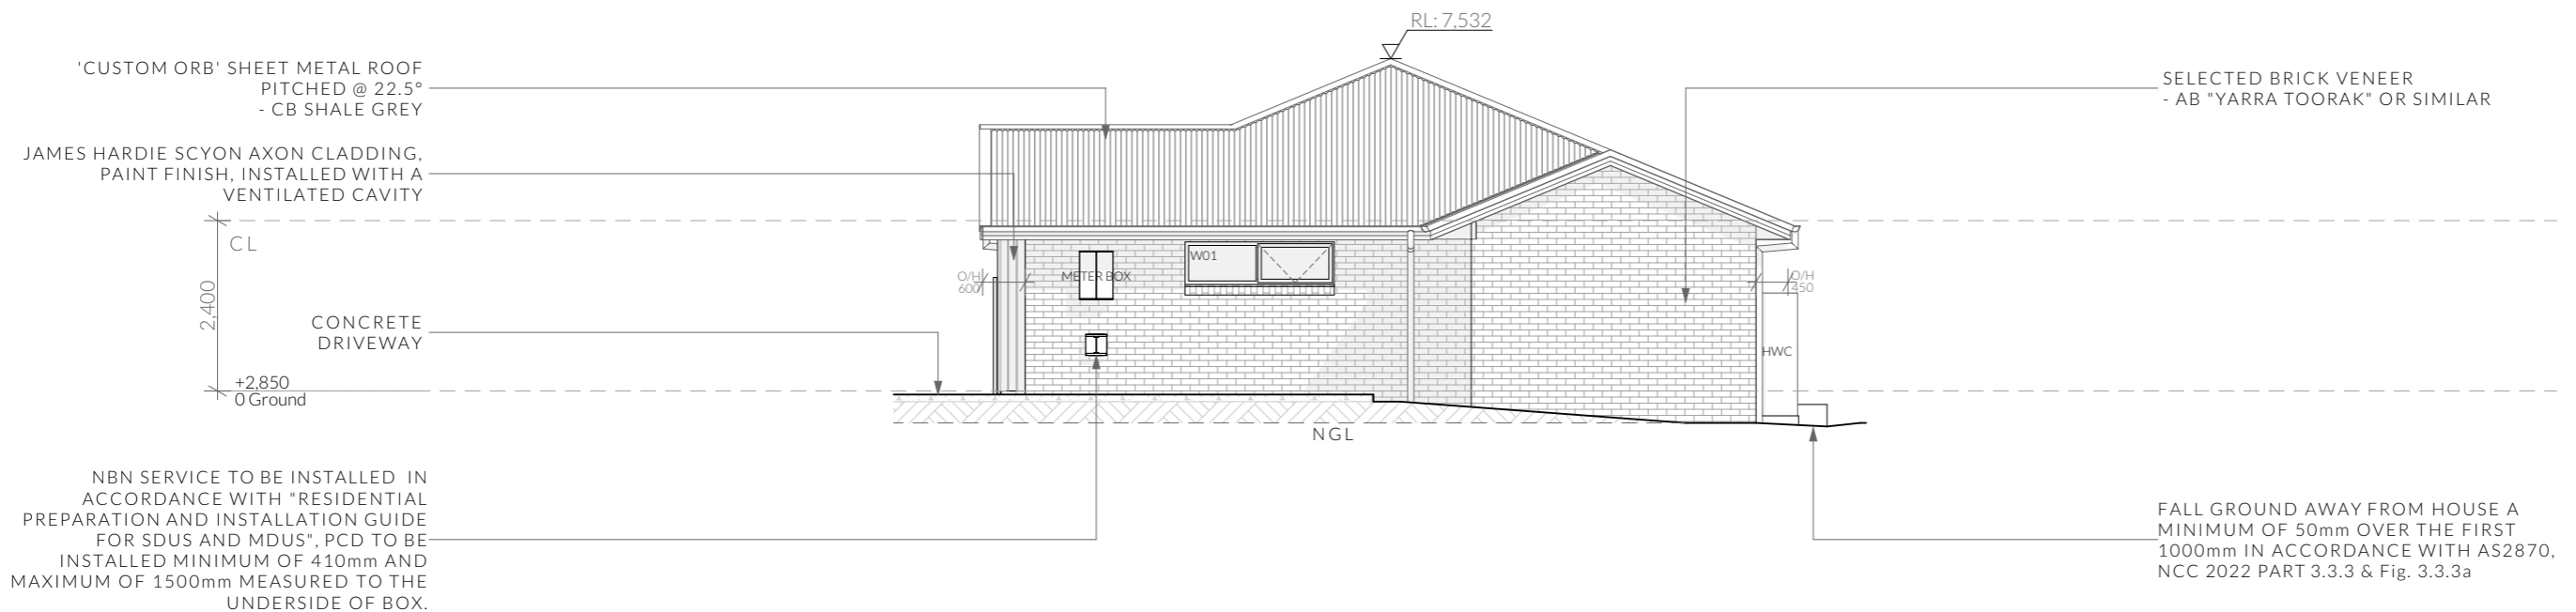

U1 - West Elevation

1:100

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of: 100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

NOT FOR CONSTRUCTION

<p>PINNACLE</p>	<p>PINNACLE DRAFTING &amp; DESIGN 7/3 Abernart Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y</p>	<p><b>U1 - Elevations</b></p>	<p>Scale: <b>1:100</b> @ A3 Pg. No: <b>A1.03</b></p>	<p>Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017</p>	<p>Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS</p>	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	<p>Lydenbuilders</p> <p>bdca BUILDING DESIGNERS ASSOCIATION OF AUSTRALIA</p>
	Issue	Date	Description																							
DA - 02	21.02.2025	Council RFI, add turning paths																								
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																								
DA - 04	07.04.2025	Council RFI, driveway and services																								
DA - 05	11.02.2026	Revise plans to match civil design																								
DA - 06	07.04.2026	Council RFI																								
<p>Revision: <b>DA - 06</b> Approved by: <b>JRM</b></p>																										

**Ventilation of roof spaces NCC 2022**

**Part 10.8.3**

A roof must have a roof space that-

- (a) is located-
  - (i) immediately above the primary insulation layer; or
  - (ii) immediately above sarking with a vapour permeance of not less than 1.14 µg/N.s, which is immediately above the primary insulation layer; or
  - (iii) immediately above ceiling insulation; and
- (b) has a height of not less than 20 mm; and
- (c) is either-
  - (i) ventilated to outdoor air through evenly distributed openings in accordance with Table 10.8.3; or
  - (ii) located immediately underneath the roof tiles of an unsarked tiled roof.

**Stormwater Notes**

All gutters, downpipes and rain heads to be designed and installed in compliance with AS3500.3 & NCC 2022 Volume II Part 7.4.

**Roofing Cladding**

Roof cladding, flashings, cappings, roof sheeting and fixings are to be installed in accordance with NCC 2022 Volume II Part 7.2 for sheet roofing and Part 7.3 for tiled and shingle roofing.

**Eaves & Soffit Linings**

To comply with NCC 2022 Vol II Part 7.5.5 and where provided, external fibre-cement sheets and linings used as eaves and soffit linings must-

- (a) comply with AS/NZS 2908.2 or ISO 8336; and
- (b) be fixed in accordance with Table 7.5.5 and Figure 7.5.5 using-
  - (i) 2.8 x 30 mm fibre-cement nails; or
  - (ii) No. 8 wafer head screws (for 4.5 mm and 6 mm sheets only); or
  - (iii) No. 8 self embedding head screws (for 6 mm sheets only).

Refer to table 7.5.5 for trimmer and fastener spacings.

ROOF PITCH	VENTILATION OF OPENINGS (TABLE 10.8.3)
>15° AND <75°	7,000 mm <sup>2</sup> /m provided at the eaves and 5,000 mm <sup>2</sup> /m at high level, plus an additional 18,000 mm <sup>2</sup> /m at the eaves if the roof has a cathedral ceiling
(1) Ventilation openings are specified as a minimum free open area per metre length of the longest horizontal dimension of the roof. (2) For the purposes of this Table, high level openings are openings provided at the ridge or not more than 900 mm below the ridge or highest point of the roof space, measured vertically.	

**REQUIRED NUMBER OF ROOF VENTS:**

ROOF PITCH >15° and <75°  
HIP/GABLE ROOF

**REQUIRED VENT AREA**

Low Vents = 0.38m<sup>2</sup> (55.37m x 7,000mm<sup>2</sup>)  
High Vents = 0.036m<sup>2</sup> (7.2m x 5,000mm<sup>2</sup>)


**EAVE VENTS**

BUILDERS EDGE EAVE VENT (EV4020)  
10x 400x200mm(0.042m<sup>2</sup>) VENTS EVENLY SPACED  
OR  
25mm CONTINUOUS VENT

**RIDGE VENT SYSTEM**

RIDGE CAP (Continuous 5mm gap in sarking)  
1x GABLE VENTS 300x300mm (0.09m<sup>2</sup>)

NOTE: GABLE VENTS SHALL BE INSTALLED WITHIN 900mm OF RIDGE

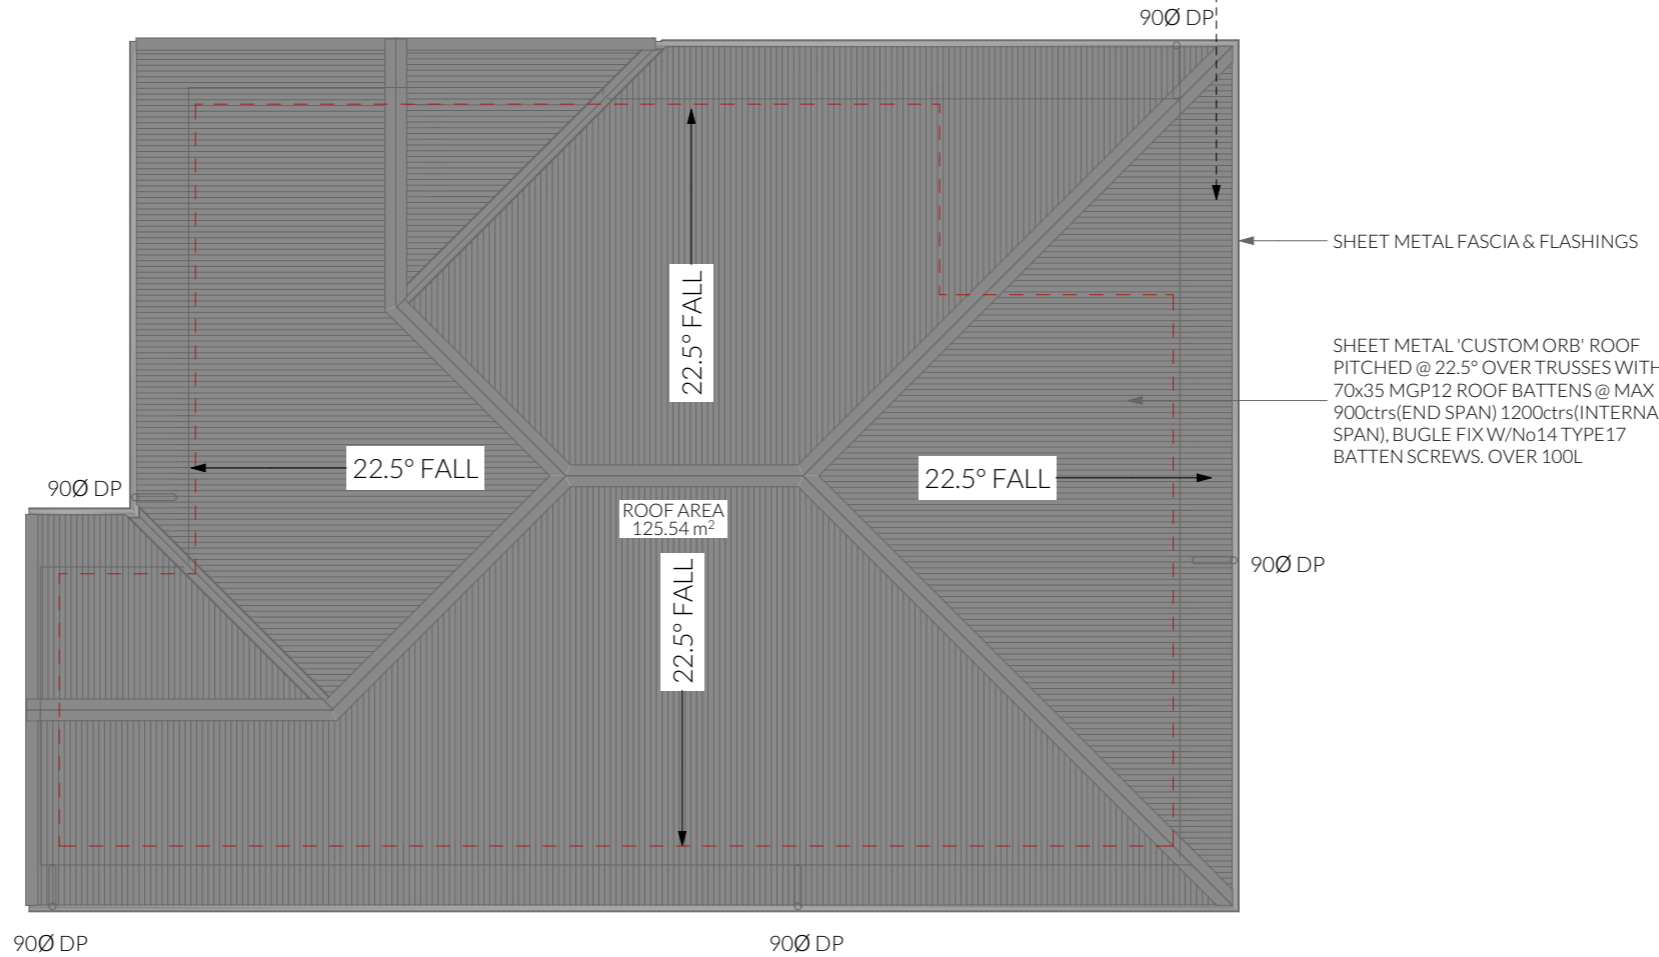

NOT FOR CONSTRUCTION

<b>PINNACLE</b> PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U1 - Roof Plan</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:100 @ A3</b>  Pg. No: <b>A1.04</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																							
DA - 02	21.02.2025	Council RFI, add turning paths																								
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																								
DA - 04	07.04.2025	Council RFI, driveway and services																								
DA - 05	11.02.2026	Revise plans to match civil design																								
DA - 06	07.04.2026	Council RFI																								

### Smoke Alarms Part 9.5 of NCC 2022

- Smoke alarms must-
- (a) be located in-
    - (i) a Class 1a building in accordance with 9.5.2 and 9.5.4; and
    - (ii) a Class 1b building in accordance with 9.5.3 and 9.5.4; and
  - (b) comply with AS 3786, except that in a Class 10a private garage where the use of the area is likely to result in smoke alarms causing spurious signals, any other alarm deemed suitable in accordance with AS 1670.1 may be installed provided that smoke alarms complying with AS 3786 are installed elsewhere in the Class 1 building; and
  - (c) be powered from the consumer mains source where a consumer mains source is supplied to the building; and be interconnected where there is more than one alarm.

- In a Class 1a building, smoke alarms must be located in-
- (a) any storey containing bedrooms, every corridor or hallway associated with a bedroom, or if there is no corridor or hallway, in an area between the bedrooms and the remainder of the building; and
  - (b) each other storey not containing bedrooms.

- Smoke alarms required by 9.5.2 and 9.5.3 must be installed on or near the ceiling, in accordance with the following:
- (a) Where a smoke alarm is located on the ceiling it must be-
    - (i) a minimum of 300 mm away from the corner junction of the wall and ceiling; and
    - (ii) between 500 mm and 1500 mm away from the high point and apexes of the ceiling, if the room has a sloping ceiling.
  - (b) Where (a) is not possible, the smoke alarm may be installed on the wall, and located a minimum of 300 mm and a maximum of 500 mm off the ceiling at the junction with the wall.

### Note: Exhaust Fans

- Exhaust fans to comply with NCC 2022 Vol 2 Part 10.8.2 and have:
- An exhaust system installed in a kitchen, bathroom, sanitary compartment or laundry must have a minimum flow rate of-
    - (a) 25 L/s for a bathroom or sanitary compartment; and
    - (b) 40 L/s for a kitchen or laundry.
  - Exhaust from a kitchen, kitchen range hood, bathroom, sanitary compartment or laundry must discharge directly or via a shaft or duct to outdoor air.
  - Where a venting clothes dryer is installed, it must discharge directly or via a shaft or duct to outdoor air.
  - An exhaust system that is not run continuously and is serving a bathroom or sanitary compartment that is not ventilated in accordance with 10.6.2(a) must-
    - (a) be interlocked with the room's light switch; and
    - (b) include a run-on timer so that the exhaust system continues to operate for 10 minutes after the light switch is turned off.

### Note: Lighting

- Lighting layout may change, owner to confirm with builder prior to purchase/installation of exact quantity and location of electrical services provided that installation is compliant with AS3000 and artificial lighting allowances do not exceed:
- 5W/m<sup>2</sup> in class 1a dwellings
  - 4W/m<sup>2</sup> to veranda, balcony or the like
  - 3W/m<sup>2</sup> in a class 10a dwelling associated with the class 1a dwelling


U.N.O - All downlights are to be Insulation Contact (IC) rated.

### Preparation for future Solar Installation:


Should the solar design be required for future installation, 2/25mm solarflex (or similar) conduits marked "solar" are to be installed from the meter box to the roof space.

### ELECTRICAL LEGEND - UNIT 1

Symbol	Description	Allowance	Quantity
700H	DATA - CAT 6 (RJ45) - 1 GANG		4
300H	DATA - TV CONNECTION		2
[Symbol]	FAN - 3 IN 1 (2 LAMP)	10W (LIGHT)	2
[Symbol]	FAN - 3 IN 1 (4 LAMP)	10W (LIGHT)	2
[Symbol]	FAN - CEILING - EXHAUST		5
1800H	GPO - (1) SINGLE		7
1100H	GPO - (2) DOUBLE		39
[Symbol]	GPO - (2) DOUBLE (WITH COOKTOP ISOLATOR SWITCH)		2
[Symbol]	GPO - (2) DOUBLE (WITH USB CHARGER)		4
300H W/PROOF	GPO - WEATHER PROOF DOUBLE		5
[Symbol]	LIGHT - CEILING - BATTEN FITTING	20W	8
[Symbol]	LIGHT - CEILING - DOWNLIGHT RECESSED	10W	41
[Symbol]	LIGHT - CEILING - LED BATTEN	20W	4
[Symbol]	SERVICE - SMOKE ALARM		3
[Symbol]	SWITCH - LIGHT 1 GANG		16
[Symbol]	SWITCH - LIGHT 2 GANG		7
[Symbol]	SWITCH - LIGHT 3 GANG		4
[Symbol]	SWITCH - WITH TIMER		1

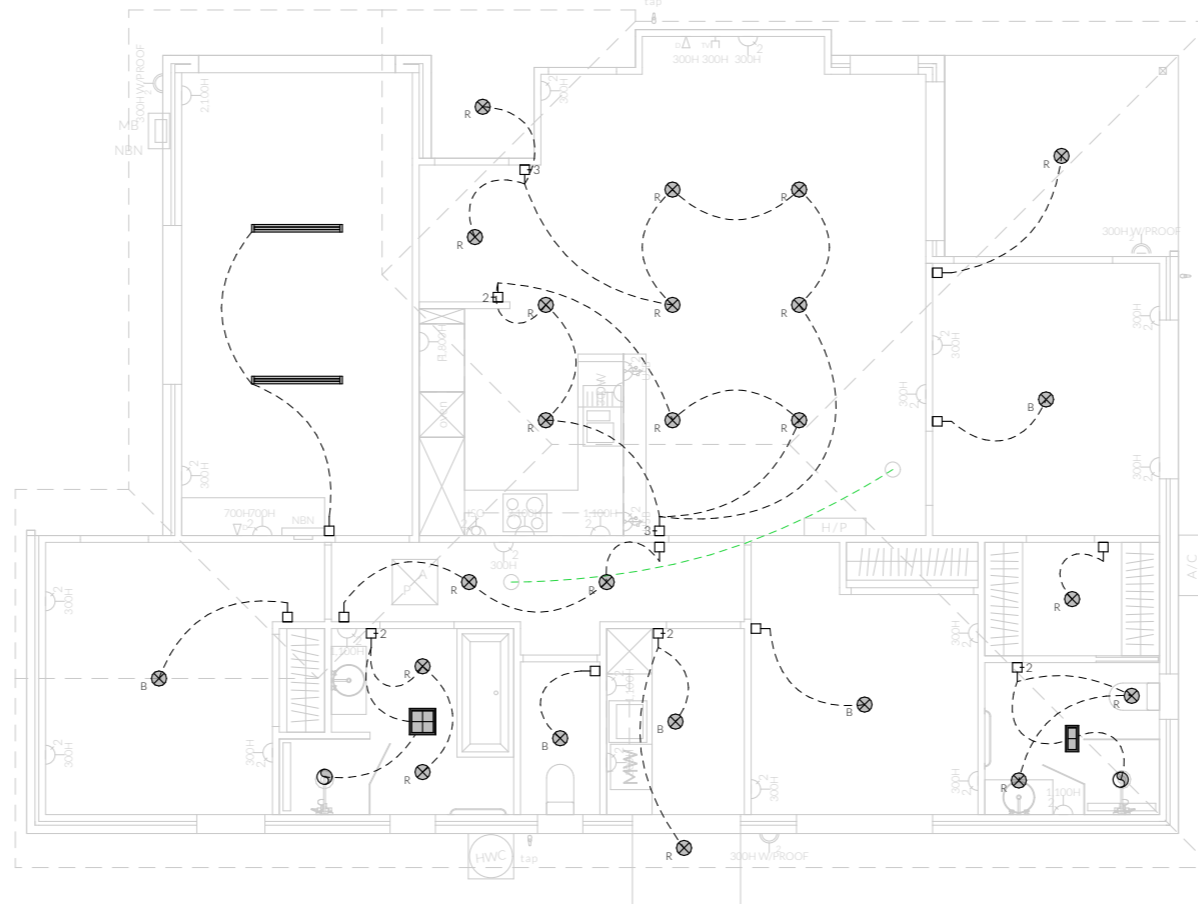

Electrical Plan - Light/Reflected Ceiling

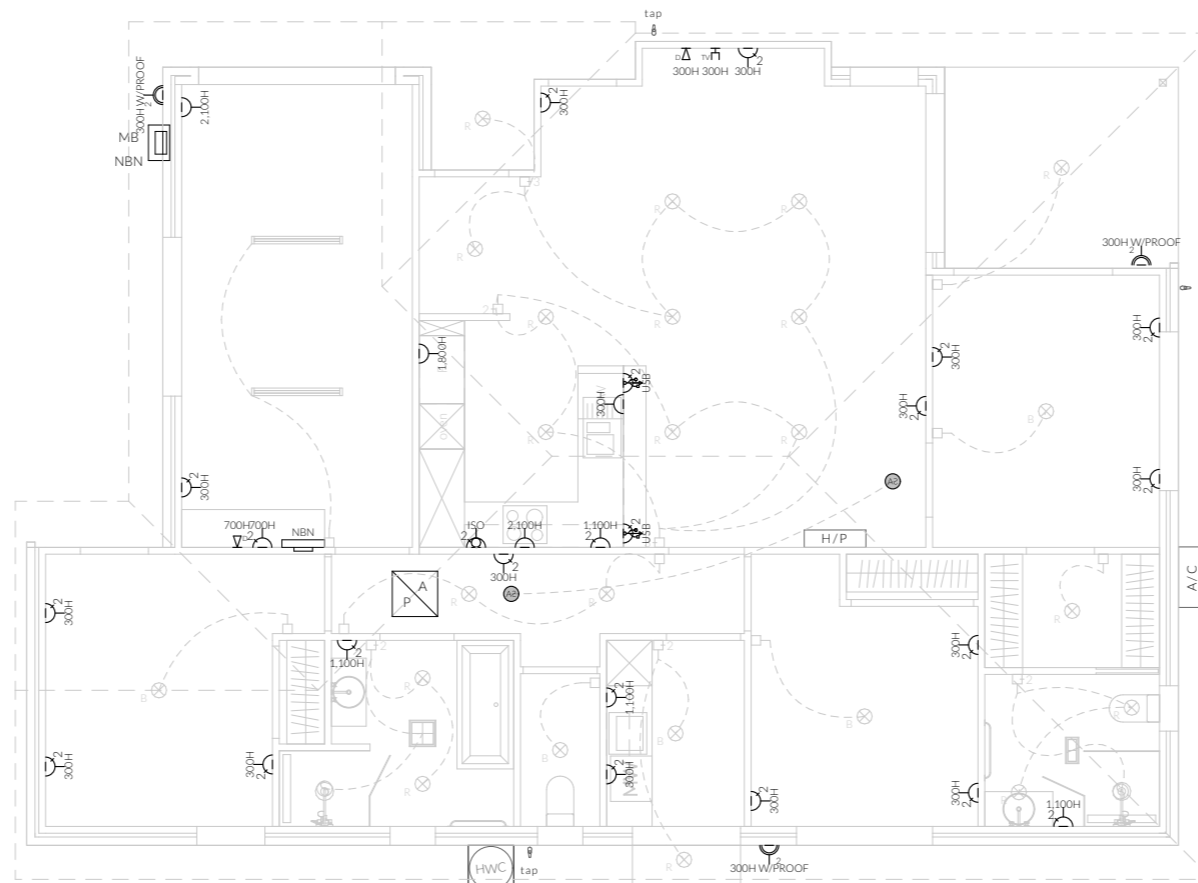

Electrical Plan - Power

### Notes

U.N.O ceilings are to be plasterboard.

- o-----o Dimmable Circuit
- t-----t Timer Circuit(as fan note)
- PB - Plasterboard
- CS - Cement Sheet Eaves
- PW - Plywood Ceiling
- TB - Timber Batten Ceiling

**PINNACLE**  
 PINNACLE DRAFTING & DESIGN  
 7/3 Abernant Way, Cambridge 7170  
 03 6248 4218  
 admin@pinnacledrafting.com.au  
 www.pinnacledrafting.com.au  
 Licence: CC6073Y

### U1 - Electrical Plan

Revision: DA - 06  
 Approved by: JRM

Scale: 1:100 @ A3  
 Pg. No: A1.05

Proposal: Unit Development  
 Client: Lyden Developments  
 Address: 77 Fouche Avenue, Old Beach 7017

Date: 11/02/2026  
 Drawn by: MM  
 Job No: 065-2023  
 Engineer: TBA  
 Building Surveyor: LTBS

Issue Date  
 DA - 02 21.02.2025  
 DA - 03 14.03.2025  
 DA - 04 07.04.2025  
 DA - 05 11.02.2026  
 DA - 06 07.04.2026

Description  
 Council RFI, add turning paths  
 TasWater RFI, relocate units 1,2,3  
 Council RFI, driveway and services  
 Revise plans to match civil design  
 Council RFI




These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.



NOT FOR CONSTRUCTION



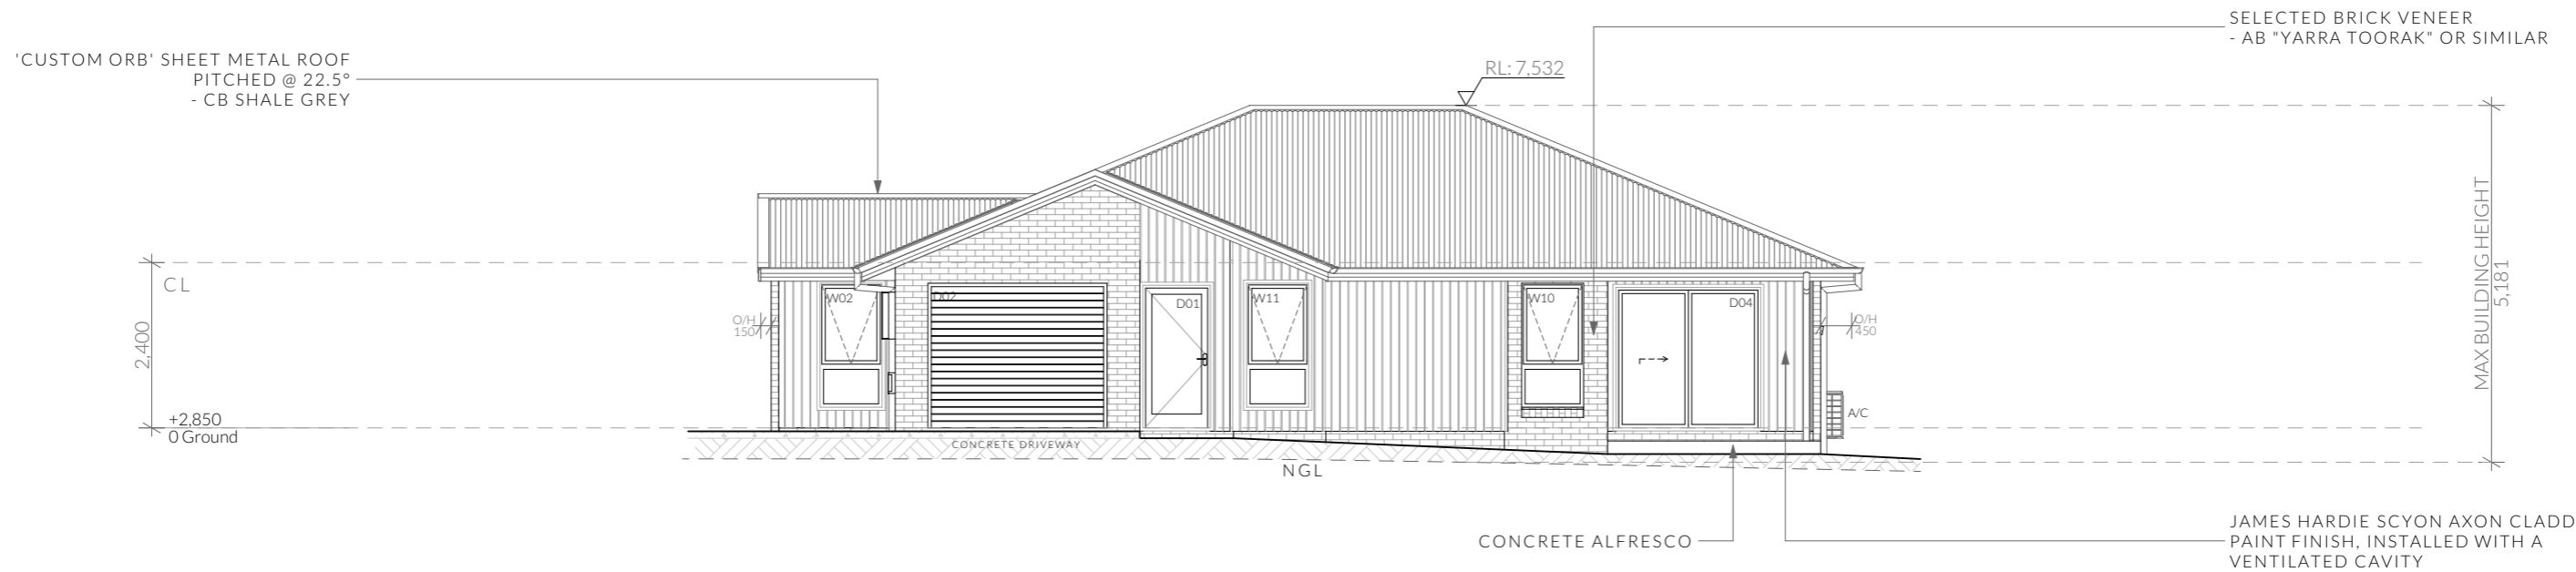

U2 -North Elevation

1:100



U2 -South Elevation

1:100

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of: 100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2


Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700


NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U2 - Elevations</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:100 @A3</b>  Pg. No: <b>A2.02</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																							
DA - 02	21.02.2025	Council RFI, add turning paths																								
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																								
DA - 04	07.04.2025	Council RFI, driveway and services																								
DA - 05	11.02.2026	Revise plans to match civil design																								
DA - 06	07.04.2026	Council RFI																								

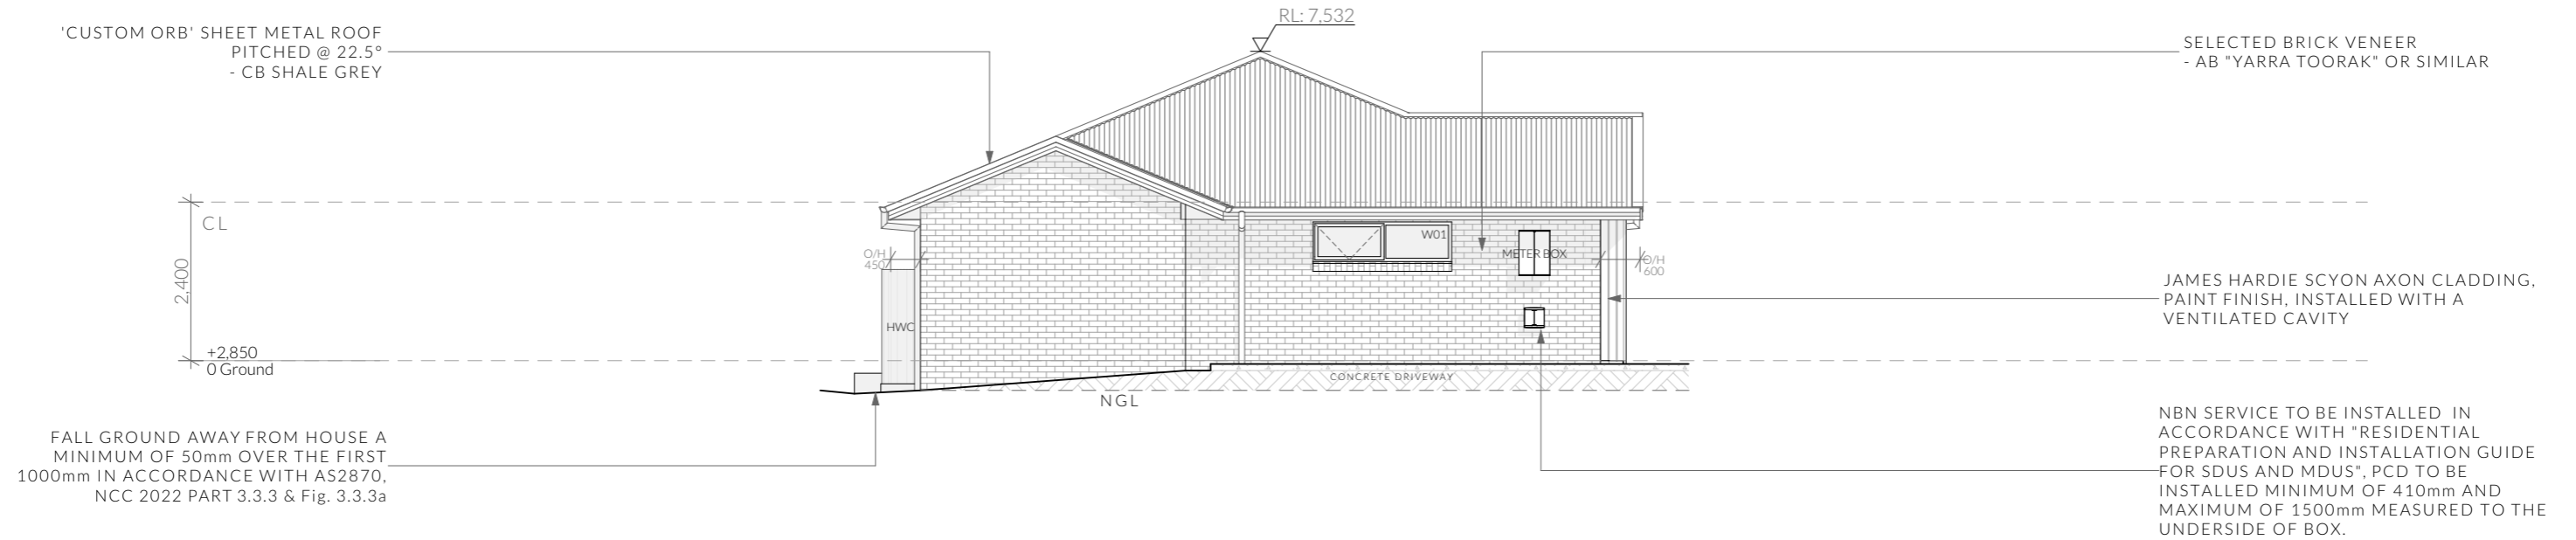

U2 - East Elevation

1:100

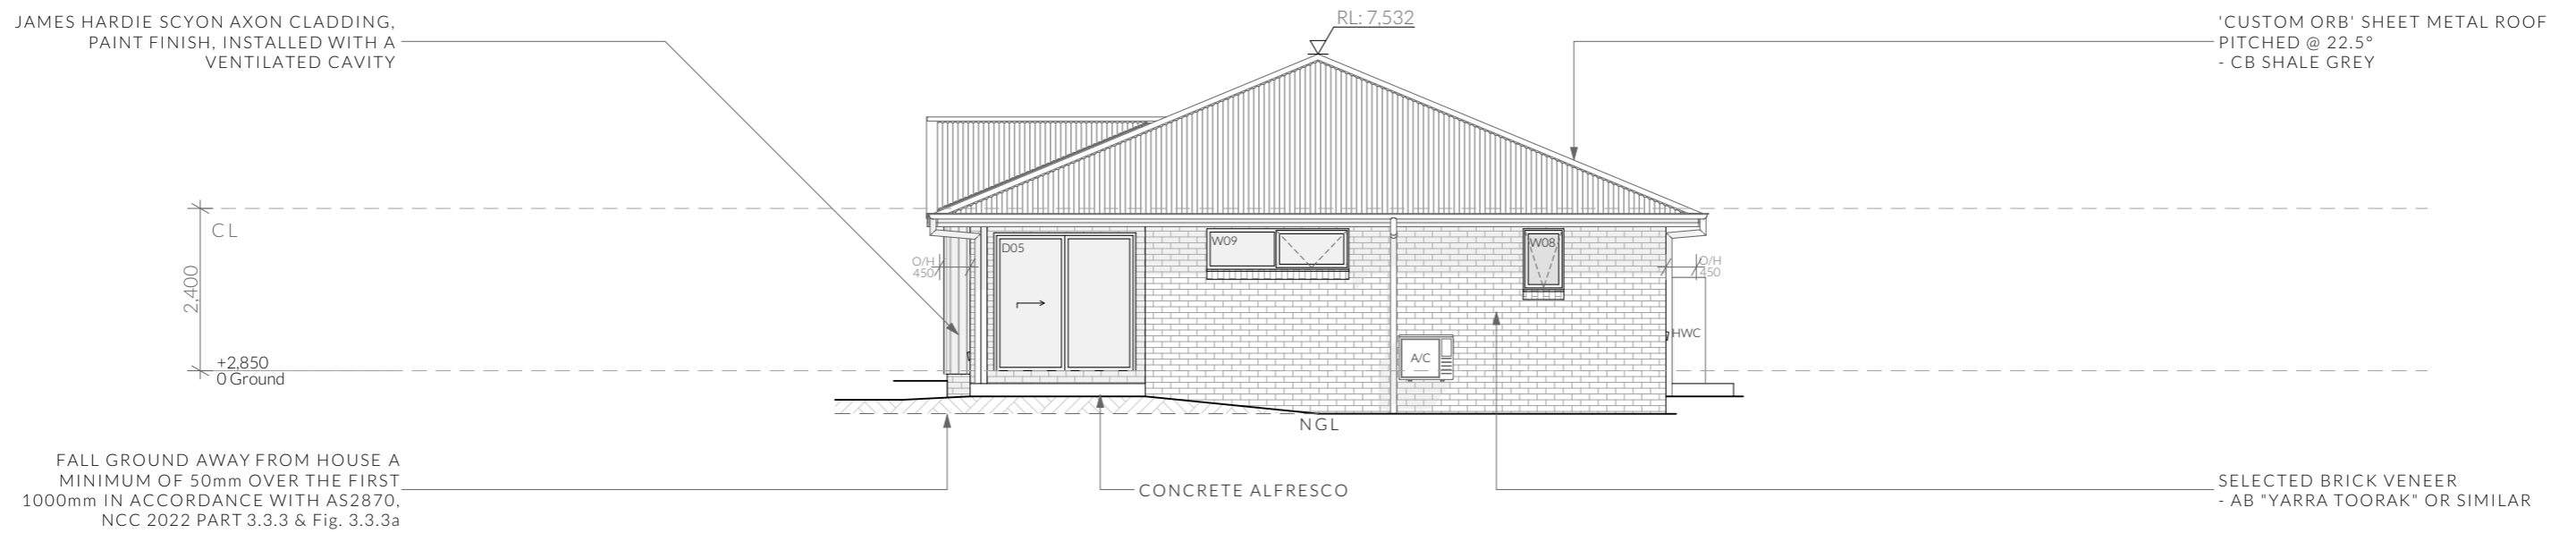

U2 - West Elevation

1:100

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of: 100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

NOT FOR CONSTRUCTION

<p>PINNACLE</p>	<p>PINNACLE DRAFTING &amp; DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y</p>	<p><b>U2 - Elevations</b></p> <p>Revision: <b>DA - 06</b> Approved by: <b>JRM</b></p>	<p>Scale: <b>1:100 @ A3</b> Pg. No: <b>A2.03</b></p>	<p>Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017</p>	<p>Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS</p>	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting/producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	<p>Lydenbuilders</p> <p>bdca BUILDING DESIGNERS ASSOCIATION OF AUSTRALIA</p>
	Issue	Date	Description																							
DA - 02	21.02.2025	Council RFI, add turning paths																								
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																								
DA - 04	07.04.2025	Council RFI, driveway and services																								
DA - 05	11.02.2026	Revise plans to match civil design																								
DA - 06	07.04.2026	Council RFI																								

**Ventilation of roof spaces NCC 2022**

**Part 10.8.3**

A roof must have a roof space that-

- (a) is located-
  - (i) immediately above the primary insulation layer; or
  - (ii) immediately above sarking with a vapour permeance of not less than 1.14 µg/N.s, which is immediately above the primary insulation layer; or
  - (iii) immediately above ceiling insulation; and
- (b) has a height of not less than 20 mm; and
- (c) is either-
  - (i) ventilated to outdoor air through evenly distributed openings in accordance with Table 10.8.3; or
  - (ii) located immediately underneath the roof tiles of an unsarked tiled roof.

**Stormwater Notes**

All gutters, downpipes and rain heads to be designed and installed in compliance with AS3500.3 & NCC 2022 Volume II Part 7.4.

**Roofing Cladding**

Roof cladding, flashings, cappings, roof sheeting and fixings are to be installed in accordance with NCC 2022 Volume II Part 7.2 for sheet roofing and Part 7.3 for tiled and shingle roofing.

**Eaves & Soffit Linings**

To comply with NCC 2022 Vol II Part 7.5.5 and where provided, external fibre-cement sheets and linings used as eaves and soffit linings must-

- (a) comply with AS/NZS 2908.2 or ISO 8336; and
- (b) be fixed in accordance with Table 7.5.5 and Figure 7.5.5 using-
  - (i) 2.8 x 30 mm fibre-cement nails; or
  - (ii) No. 8 wafer head screws (for 4.5 mm and 6 mm sheets only); or
  - (iii) No. 8 self embedding head screws (for 6 mm sheets only).

Refer to table 7.5.5 for trimmer and fastener spacings.

ROOF PITCH	VENTILATION OF OPENINGS (TABLE 10.8.3)
>15° AND <75°	7,000 mm <sup>2</sup> /m provided at the eaves and 5,000 mm <sup>2</sup> /m at high level, plus an additional 18,000 mm <sup>2</sup> /m at the eaves if the roof has a cathedral ceiling
(1) Ventilation openings are specified as a minimum free open area per metre length of the longest horizontal dimension of the roof. (2) For the purposes of this Table, high level openings are openings provided at the ridge or not more than 900 mm below the ridge or highest point of the roof space, measured vertically.	

**REQUIRED NUMBER OF ROOF VENTS:**

ROOF PITCH >15° and <75°  
HIP/GABLE ROOF

**REQUIRED VENT AREA**

Low Vents = 0.38m<sup>2</sup> (55.37m x 7,000mm<sup>2</sup>)  
High Vents = 0.036m<sup>2</sup> (7.2m x 5,000mm<sup>2</sup>)


**EAVE VENTS**

BUILDERS EDGE EAVE VENT (EV4020)  
10x 400x200mm(0.042m<sup>2</sup>) VENTS EVENLY SPACED  
OR  
25mm CONTINUOUS VENT

**RIDGE VENT SYSTEM**

RIDGE CAP (Continuous 5mm gap in sarking)  
1x GABLE VENTS 300x300mm (0.09m<sup>2</sup>)

NOTE: GABLE VENTS SHALL BE INSTALLED WITHIN 900mm OF RIDGE

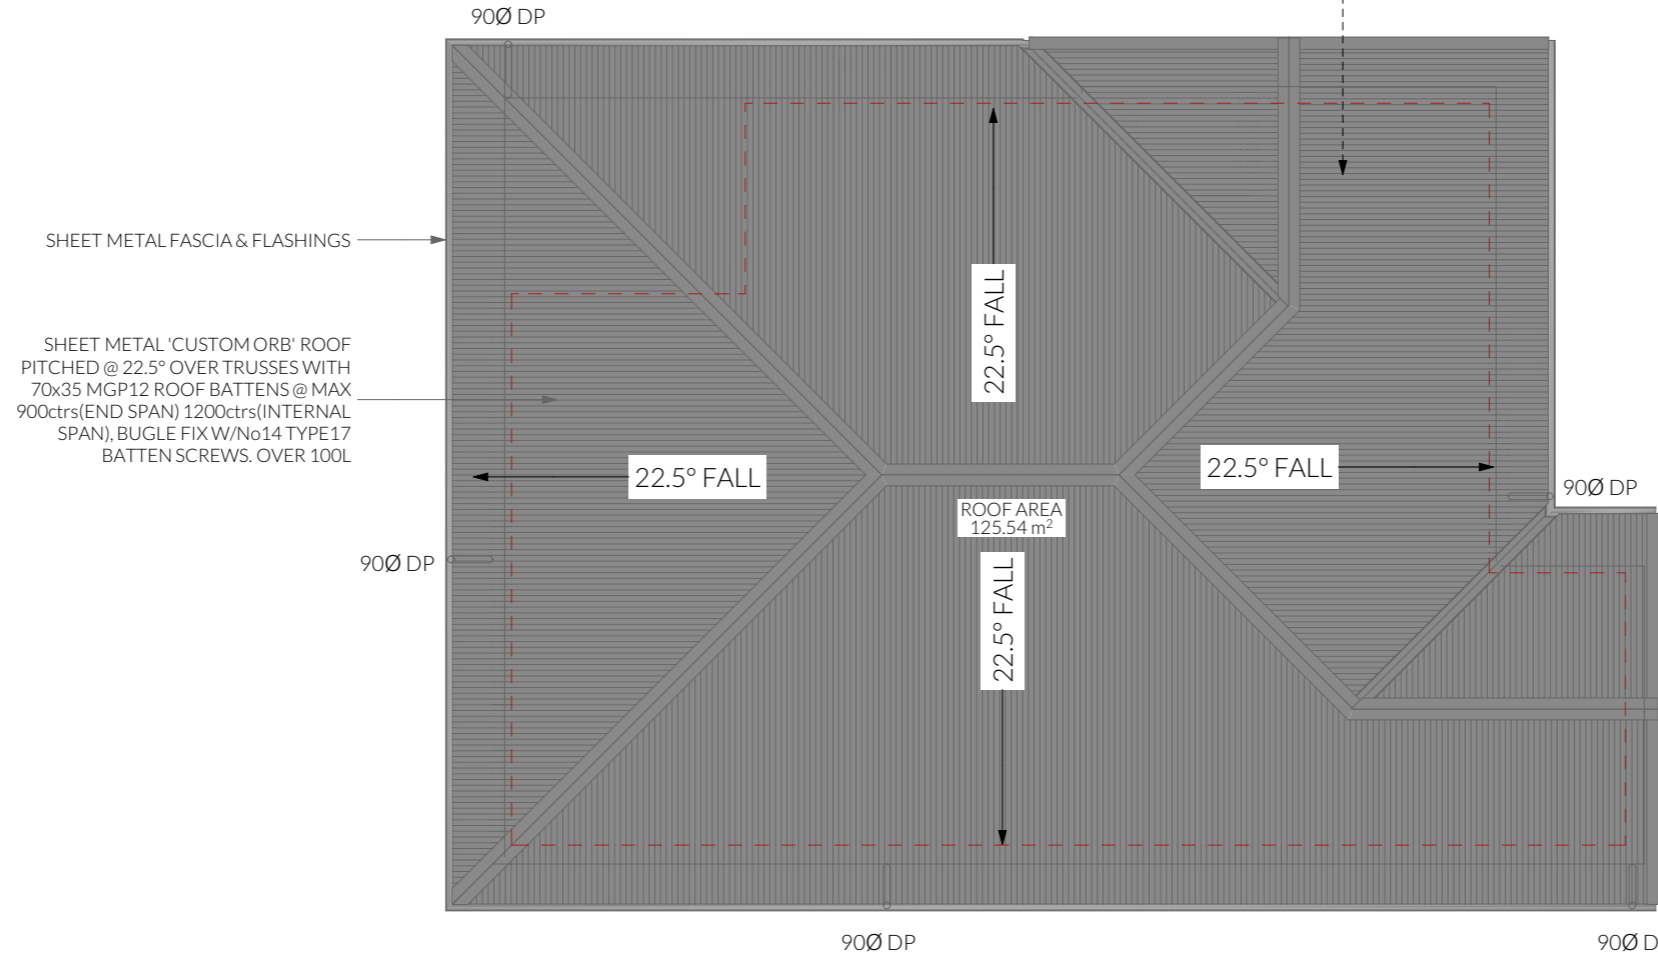

NOT FOR CONSTRUCTION

<b>PINNACLE</b> PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U2 - Roof Plan</b>	Scale: <b>1:100 @ A3</b> Pg. No: <b>A2.04</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting/producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																							
DA - 02	21.02.2025	Council RFI, add turning paths																								
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																								
DA - 04	07.04.2025	Council RFI, driveway and services																								
DA - 05	11.02.2026	Revise plans to match civil design																								
DA - 06	07.04.2026	Council RFI																								
Revision: <b>DA - 06</b> Approved by: <b>JRM</b>																										

### Smoke Alarms Part 9.5 of NCC 2022

- Smoke alarms must-
- (a) be located in-
    - (i) a Class 1a building in accordance with 9.5.2 and 9.5.4; and
    - (ii) a Class 1b building in accordance with 9.5.3 and 9.5.4; and
  - (b) comply with AS 3786, except that in a Class 10a private garage where the use of the area is likely to result in smoke alarms causing spurious signals, any other alarm deemed suitable in accordance with AS 1670.1 may be installed provided that smoke alarms complying with AS 3786 are installed elsewhere in the Class 1 building; and
  - (c) be powered from the consumer mains source where a consumer mains source is supplied to the building; and be interconnected where there is more than one alarm.

- In a Class 1a building, smoke alarms must be located in-
- (a) any storey containing bedrooms, every corridor or hallway associated with a bedroom, or if there is no corridor or hallway, in an area between the bedrooms and the remainder of the building; and
  - (b) each other storey not containing bedrooms.

- Smoke alarms required by 9.5.2 and 9.5.3 must be installed on or near the ceiling, in accordance with the following:
- (a) Where a smoke alarm is located on the ceiling it must be-
    - (i) a minimum of 300 mm away from the corner junction of the wall and ceiling; and
    - (ii) between 500 mm and 1500 mm away from the high point and apexes of the ceiling, if the room has a sloping ceiling.
  - (b) Where (a) is not possible, the smoke alarm may be installed on the wall, and located a minimum of 300 mm and a maximum of 500 mm off the ceiling at the junction with the wall.

### Note: Exhaust Fans

- Exhaust fans to comply with NCC 2022 Vol 2 Part 10.8.2 and have:
- An exhaust system installed in a kitchen, bathroom, sanitary compartment or laundry must have a minimum flow rate of-
    - (a) 25 L/s for a bathroom or sanitary compartment; and
    - (b) 40 L/s for a kitchen or laundry.
  - Exhaust from a kitchen, kitchen range hood, bathroom, sanitary compartment or laundry must discharge directly or via a shaft or duct to outdoor air.
  - Where a venting clothes dryer is installed, it must discharge directly or via a shaft or duct to outdoor air.
  - An exhaust system that is not run continuously and is serving a bathroom or sanitary compartment that is not ventilated in accordance with 10.6.2(a) must-
    - (a) be interlocked with the room's light switch; and
    - (b) include a run-on timer so that the exhaust system continues to operate for 10 minutes after the light switch is turned off.

### Note: Lighting

- Lighting layout may change, owner to confirm with builder prior to purchase/installation of exact quantity and location of electrical services provided that installation is compliant with AS3000 and artificial lighting allowances do not exceed:
- 5W/m<sup>2</sup> in class 1a dwellings
  - 4W/m<sup>2</sup> to veranda, balcony or the like
  - 3W/m<sup>2</sup> in a class 10a dwelling associated with the class 1a dwelling


U.N.O - All downlights are to be Insulation Contact (IC) rated.

### Preparation for future Solar Installation:


Should the solar design be required for future installation, 2/25mm solarflex (or similar) conduits marked "solar" are to be installed from the meter box to the roof space.

### ELECTRICAL LEGEND - UNIT 2

Symbol	Description	Allowance	Quantity
	DATA - CAT 6 (RJ45) - 1 GANG		2
	DATA - TV CONNECTION		1
	FAN - 3 IN 1 (2 LAMP)	10W (LIGHT)	1
	FAN - 3 IN 1 (4 LAMP)	10W (LIGHT)	1
	FAN - CEILING - EXHAUST		2
	GPO - (1) SINGLE		4
	GPO - (2) DOUBLE		20
	GPO - (2) DOUBLE (WITH COOKTOP ISOLATOR SWITCH)		1
	GPO - (2) DOUBLE (WITH USB CHARGER)		2
	GPO - WEATHER PROOF DOUBLE		3
	LIGHT - CEILING - BATTEN FITTING	20W	5
	LIGHT - CEILING - DOWNLIGHT RECESSED	10W	19
	LIGHT - CEILING - LED BATTEN	20W	2
	SERVICE - SMOKE ALARM		2
	SWITCH - LIGHT 1 GANG		9
	SWITCH - LIGHT 2 GANG		4
	SWITCH - LIGHT 3 GANG		2

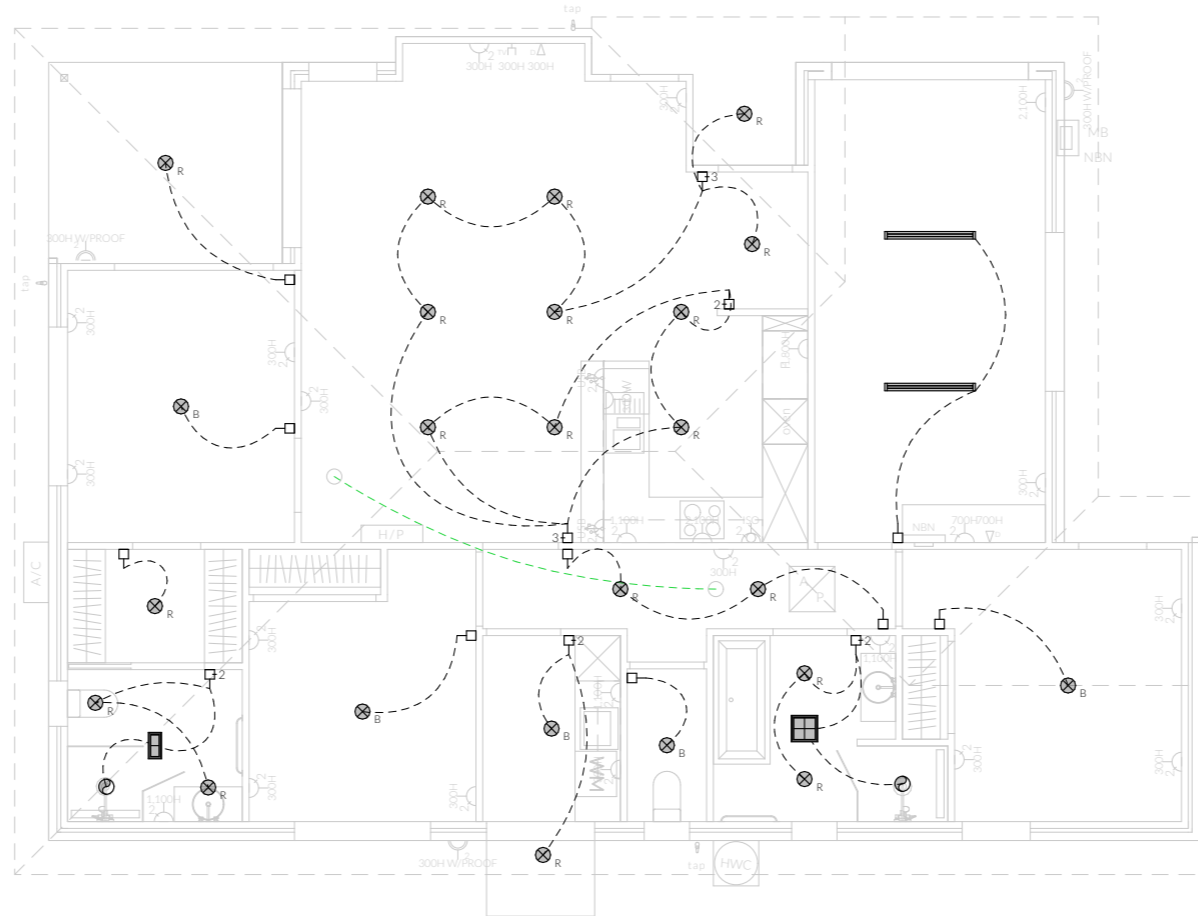

Electrical Plan - Light/Reflected Ceiling

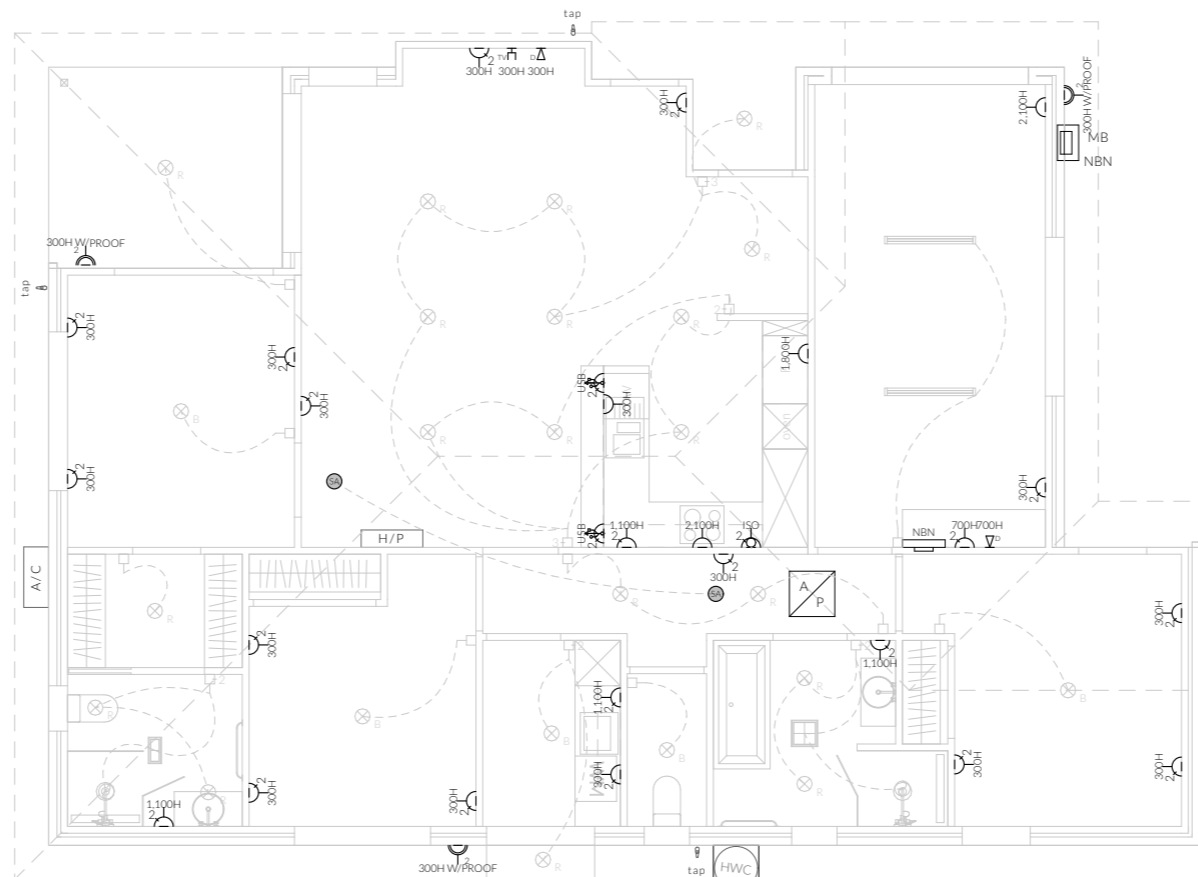

Electrical Plan - Power

### Notes

- U.N.O ceilings are to be plasterboard.
- ◁-----▷ Dimmable Circuit
- ↑-----↑ Timer Circuit(as fan note)
- PB - Plasterboard
- CS - Cement Sheet Eaves
- PW - Plywood Ceiling
- TB - Timber Batten Ceiling

**PINNACLE**  
 PINNACLE DRAFTING & DESIGN  
 7/3 Abernant Way, Cambridge 7170  
 03 6248 4218  
 admin@pinnacledrafting.com.au  
 www.pinnacledrafting.com.au  
 Licence: CC6073Y

**U2 - Electrical Plan**  
 Scale: 1:100 @ A3  
 Pg. No: A2.05  
 Revision: DA - 06  
 Approved by: JRM

Proposal: Unit Development  
 Client: Lyden Developments  
 Address: 77 Fouche Avenue, Old Beach 7017

Date: 11/02/2026  
 Drawn by: MM  
 Job No: 065-2023  
 Engineer: TBA  
 Building Surveyor: LTBS




Issue Date Description  
 DA - 02 21.02.2025 Council RFI, add turning paths  
 DA - 03 14.03.2025 TasWater RFI, relocate units 1,2,3  
 DA - 04 07.04.2025 Council RFI, driveway and services  
 DA - 05 11.02.2026 Revise plans to match civil design  
 DA - 06 07.04.2026 Council RFI





These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting/producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.



NOT FOR CONSTRUCTION

-  Access Panel
-  Articulation Joint
-  Smoke Alarm

-  - BATTS TO WALL
-  - SOUND INSULATION

### Construction of sanitary compartments 10.4.2 of NCC 2022

The door to a fully enclosed sanitary compartment must -

- open outwards; or
- slide; or
- be readily removable from the outside of the compartment.

unless there is a clear space of at least 1.2 m, measured in accordance with Figure 10.4.2 of NCC 2022 Vol II, between the closet pan within the *sanitary compartment* and the doorway.

### Note: Safe Movement & Egress

Openable windows greater than 4m above the surface below are to be fitted with a device to limit opening or a suitable screen so a 125mm sphere cannot pass through. Except for Bedrooms, where the requirement is for heights above 2m. Refer to clauses 11.3.7 and 11.3.8 of NCC 2022 for further information on suitable protective devices.

### Note: Paved Areas

All paths and patios to fall away from dwelling.

### Note: Stair Construction

All stairs to be constructed in accordance with NCC Vol II 2022 Part 11.2.2:

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

For stairways serving non-habitable room used infrequently, refer to table 11.2.2(b).

Landings to comply with Clause 11.2.5 and be a minimum of 750mm deep measured 500mm from the inside edge of the landing.

Slip resistance of treads, nosings and ramps to comply with Clause 11.2.4.

### Heights of rooms & other spaces 10.3.1 of NCC 2022


Heights of rooms and other spaces must not be less than;

- (a) in a *habitable room* excluding a kitchen - 2.4 m; and
- (b) in a kitchen - 2.1 m; and
- (c) in a corridor, passageway or the like - 2.1 m; and
- (d) in a bathroom, shower room, laundry, *sanitary compartment*, airlock, pantry, storeroom, garage, car parking area or the like - 2.1 m; and
- (e) in a room or space with a sloping ceiling or projections below the ceiling line within- See NCC directly for these items
- (f) in a stairway, ramp, *landing*, or the like - 2.0 m measured vertically above the nosing line of stairway treads or the floor surface of a ramp, *landing* or the like.



If required onsite, the builder may work within the tolerances of the above as specified within the NCC 2022 Vol II. Builder to contact *Pinnacle* before undertaking works.


### Unit 3 Floor Areas

Floor Area	134.55m <sup>2</sup>
Alfresco	11.63m <sup>2</sup>
Porch	2.69m <sup>2</sup>

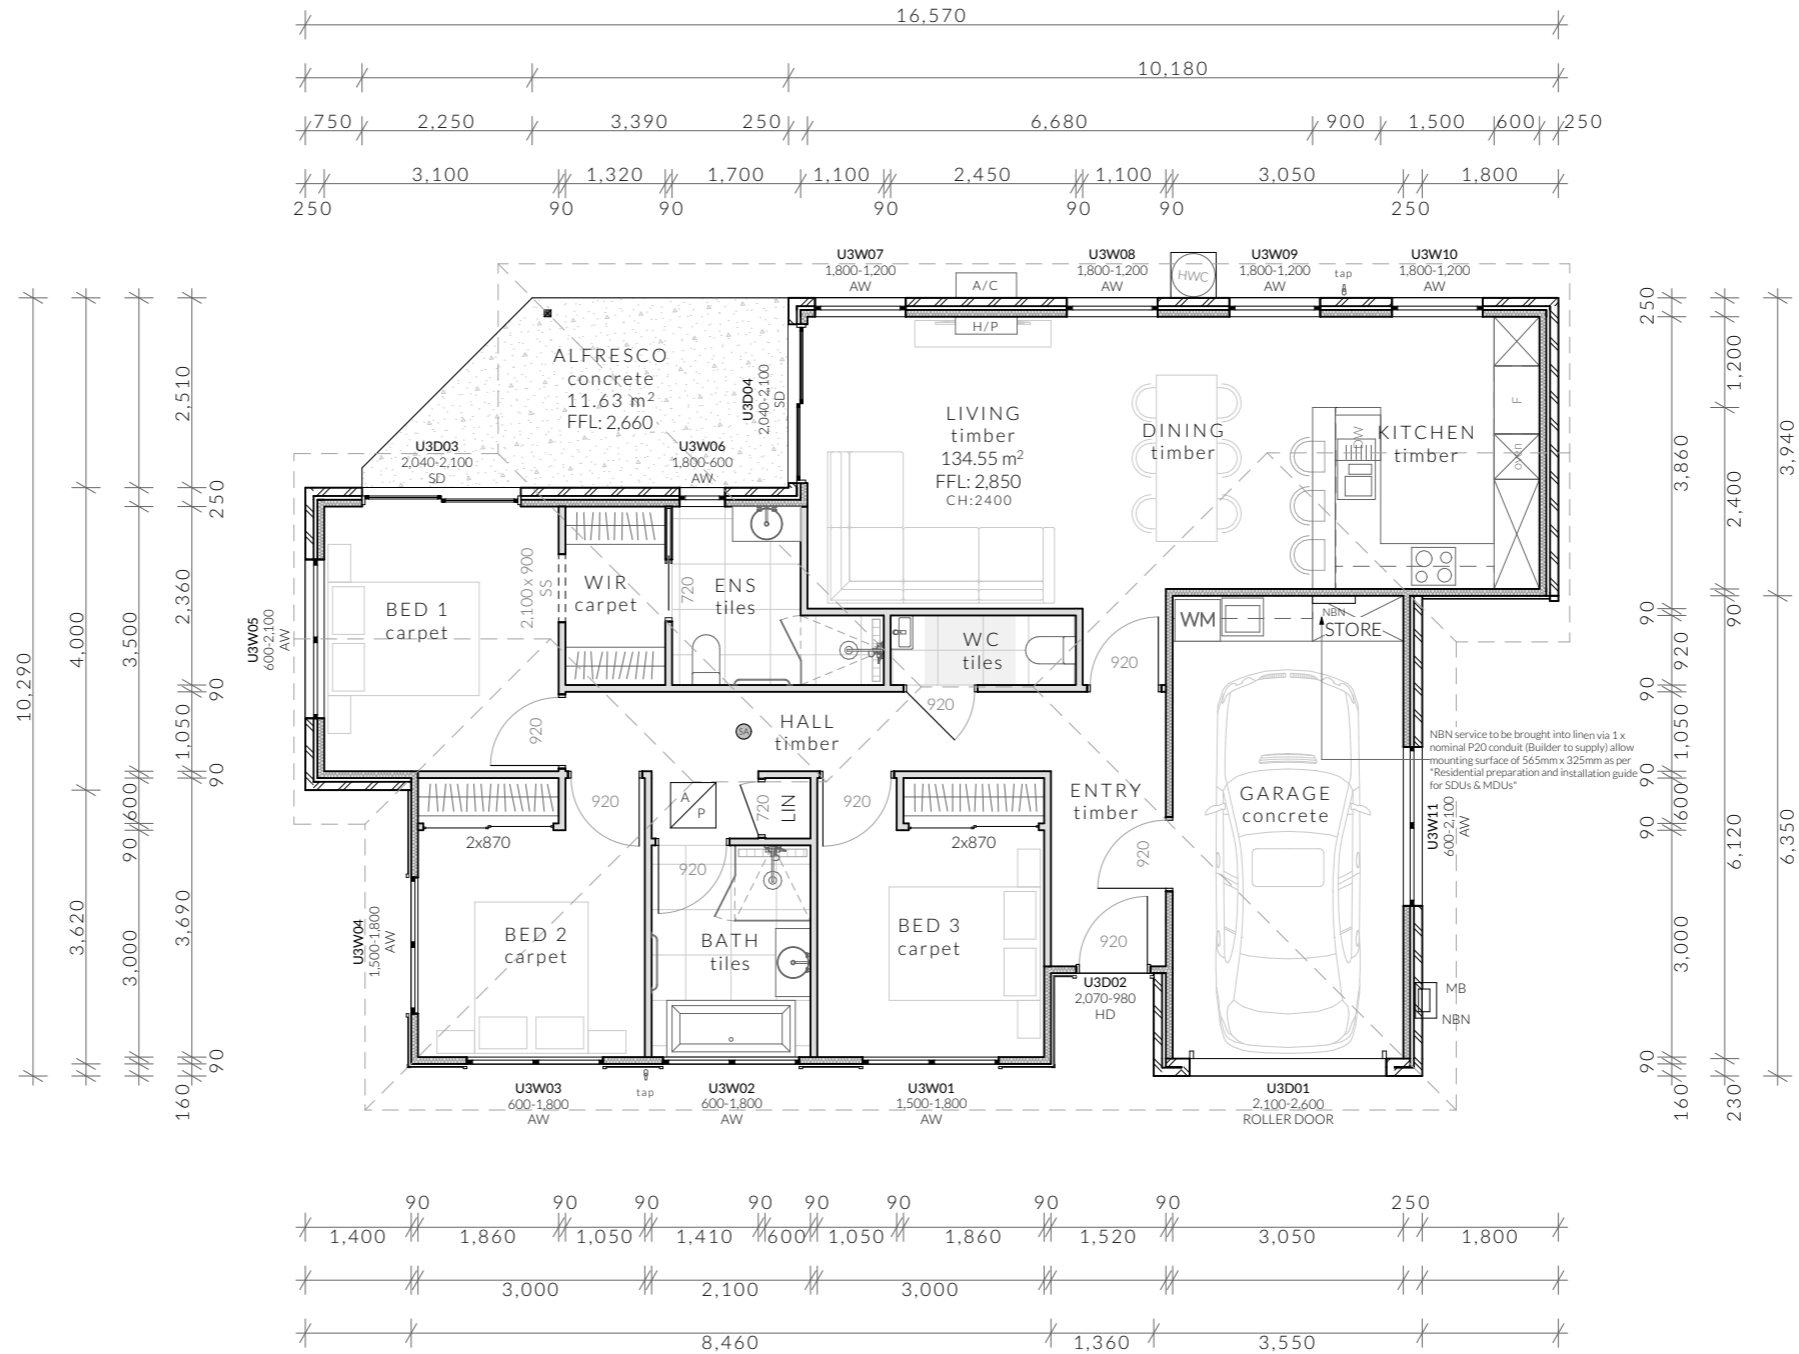

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U3 - Floor Plan</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:100 @A3</b>  Pg. No: <b>A3.01</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA-02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA-03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA-04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA-05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA-06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA-02	21.02.2025	Council RFI, add turning paths	DA-03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA-04	07.04.2025	Council RFI, driveway and services	DA-05	11.02.2026	Revise plans to match civil design	DA-06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	
	Issue	Date	Description																								
DA-02	21.02.2025	Council RFI, add turning paths																									
DA-03	14.03.2025	TasWater RFI, relocate units 1,2,3																									
DA-04	07.04.2025	Council RFI, driveway and services																									
DA-05	11.02.2026	Revise plans to match civil design																									
DA-06	07.04.2026	Council RFI																									

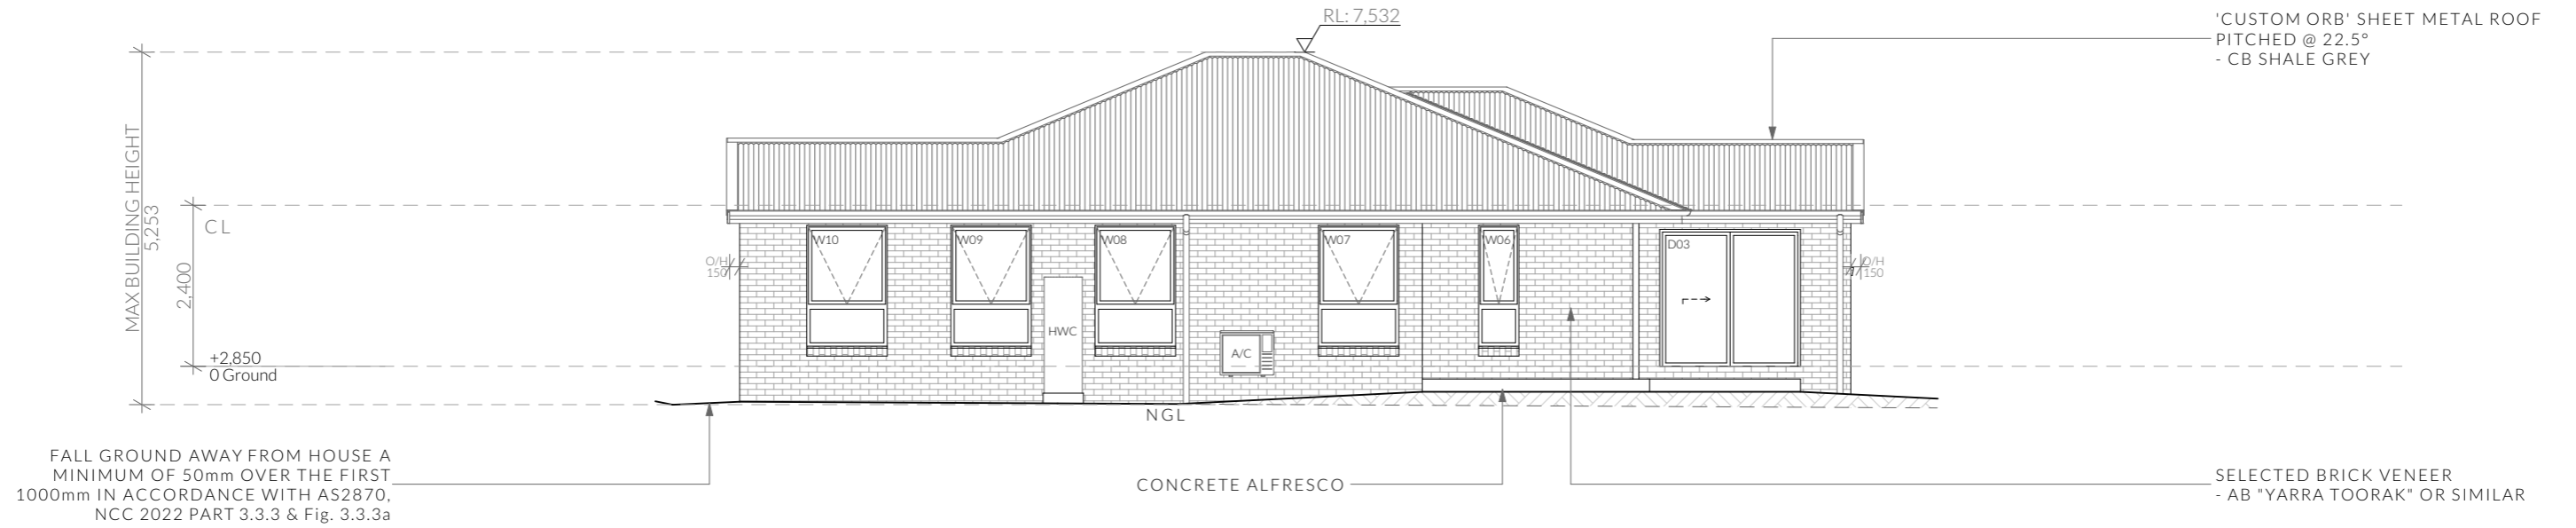

U3 - North Elevation

1:100



U3 - South Elevation

1:100

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of: 100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2



Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

NOT FOR CONSTRUCTION

<p>PINNACLE PINNACLE DRAFTING &amp; DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y</p>	<p><b>U3 - Elevations</b></p> <p>Revision: <b>DA - 06</b> Approved by: <b>JRM</b></p>	<p>Scale: <b>1:100 @ A3</b> Pg. No: <b>A3.02</b></p>	<p>Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017</p>	<p>Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS</p>	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	<p>Lydenbuilders BUILDING DESIGNERS ASSOCIATION OF AUSTRALIA</p>
	Issue	Date	Description																						
DA - 02	21.02.2025	Council RFI, add turning paths																							
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																							
DA - 04	07.04.2025	Council RFI, driveway and services																							
DA - 05	11.02.2026	Revise plans to match civil design																							
DA - 06	07.04.2026	Council RFI																							

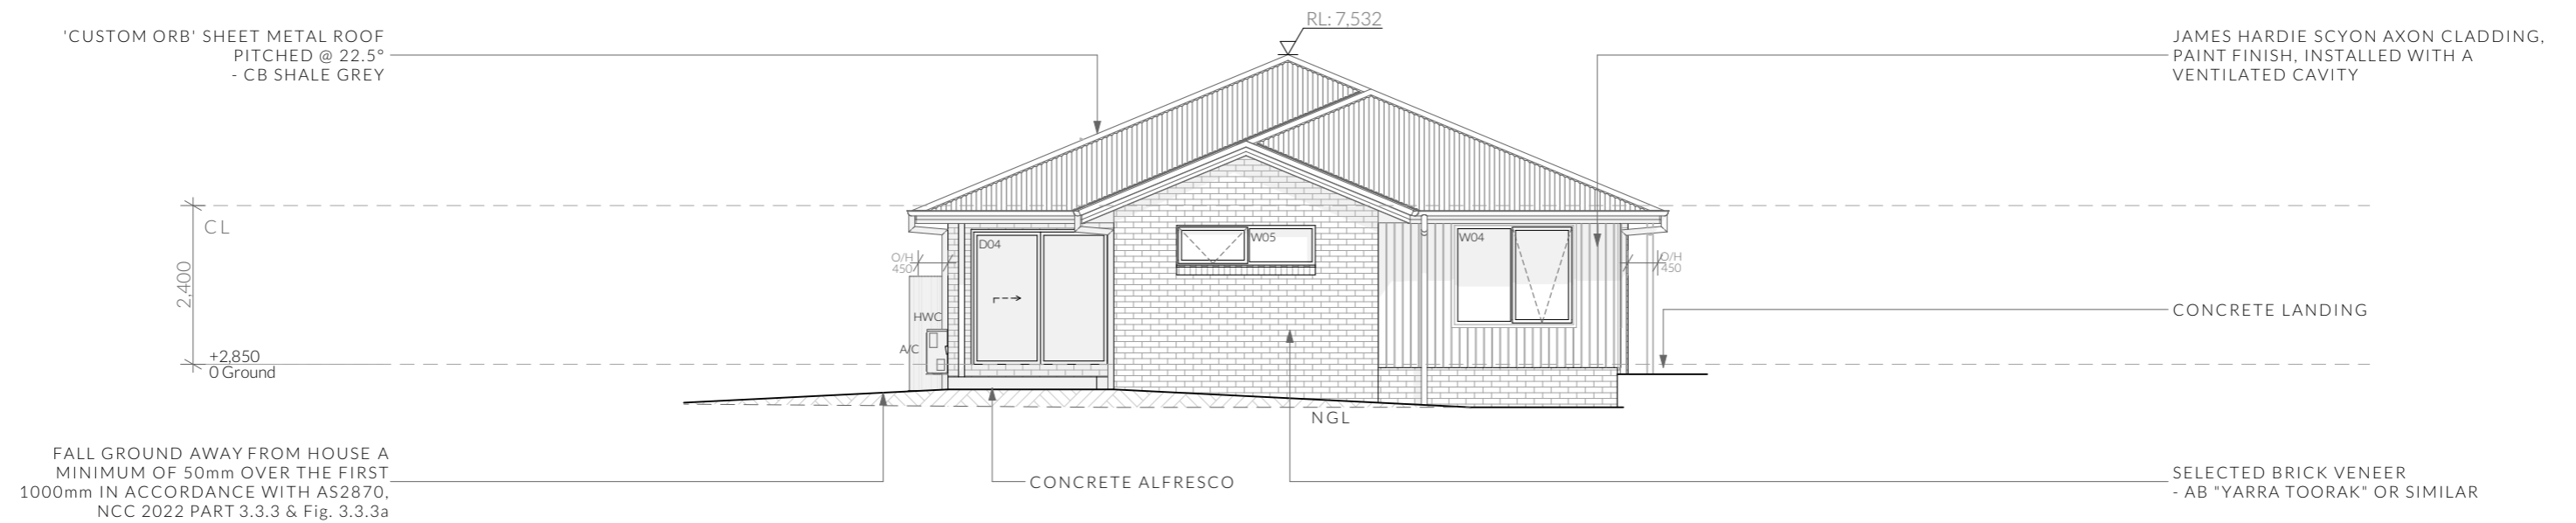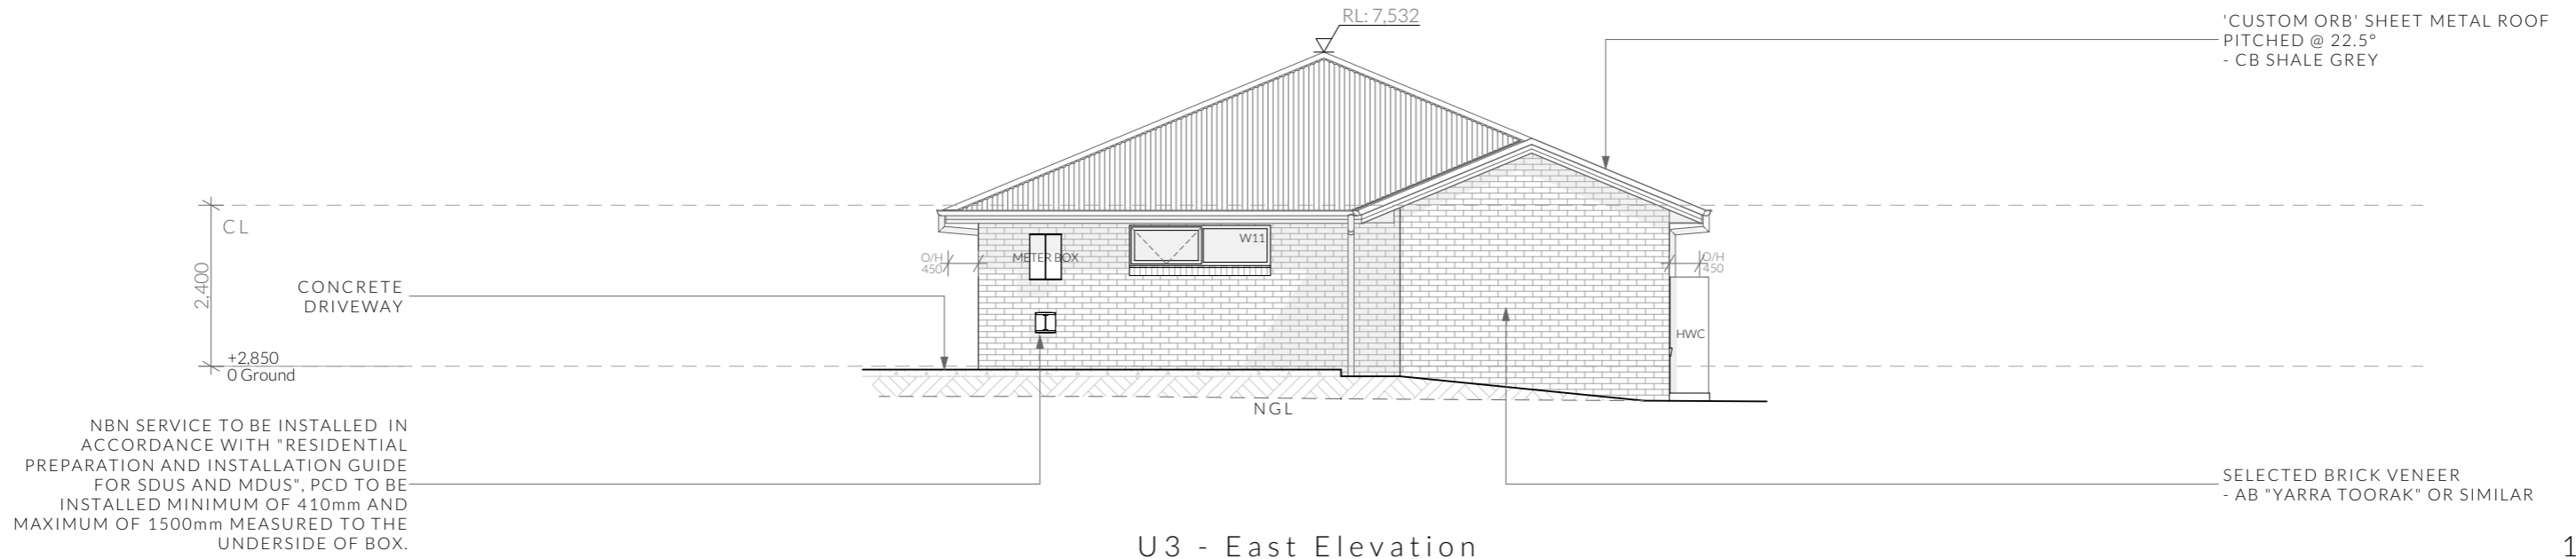

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of: 100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernart Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U3 - Elevations</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:100 @ A3</b>  Pg. No: <b>A3.03</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	 
	Issue	Date	Description																							
DA - 02	21.02.2025	Council RFI, add turning paths																								
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																								
DA - 04	07.04.2025	Council RFI, driveway and services																								
DA - 05	11.02.2026	Revise plans to match civil design																								
DA - 06	07.04.2026	Council RFI																								

**Ventilation of roof spaces NCC 2022**

**Part 10.8.3**

A roof must have a roof space that-

- (a) is located-
  - (i) immediately above the primary insulation layer; or
  - (ii) immediately above sarking with a vapour permeance of not less than 1.14 µg/N.s, which is immediately above the primary insulation layer; or
  - (iii) immediately above ceiling insulation; and
- (b) has a height of not less than 20 mm; and
- (c) is either-
  - (i) ventilated to outdoor air through evenly distributed openings in accordance with Table 10.8.3; or
  - (ii) located immediately underneath the roof tiles of an unsarked tiled roof.

**Stormwater Notes**

All gutters, downpipes and rain heads to be designed and installed in compliance with AS3500.3 & NCC 2022 Volume II Part 7.4.

**Roofing Cladding**

Roof cladding, flashings, cappings, roof sheeting and fixings are to be installed in accordance with NCC 2022 Volume II Part 7.2 for sheet roofing and Part 7.3 for tiled and shingle roofing.


**Eaves & Soffit Linings**

To comply with NCC 2022 Vol II Part 7.5.5 and where provided, external fibre-cement sheets and linings used as eaves and soffit linings must-

- (a) comply with AS/NZS 2908.2 or ISO 8336; and
- (b) be fixed in accordance with Table 7.5.5 and Figure 7.5.5 using-
  - (i) 2.8 x 30 mm fibre-cement nails; or
  - (ii) No. 8 wafer head screws (for 4.5 mm and 6 mm sheets only); or
  - (iii) No. 8 self embedding head screws (for 6 mm sheets only).

Refer to table 7.5.5 for trimmer and fastener spacings.

ROOF PITCH	VENTILATION OF OPENINGS (TABLE 10.8.3)
>15° AND <75°	7,000 mm <sup>2</sup> /m provided at the eaves and 5,000 mm <sup>2</sup> /m at high level, plus an additional 18,000 mm <sup>2</sup> /m at the eaves if the roof has a cathedral ceiling
(1) Ventilation openings are specified as a minimum free open area per metre length of the longest horizontal dimension of the roof. (2) For the purposes of this Table, high level openings are openings provided at the ridge or not more than 900 mm below the ridge or highest point of the roof space, measured vertically.	

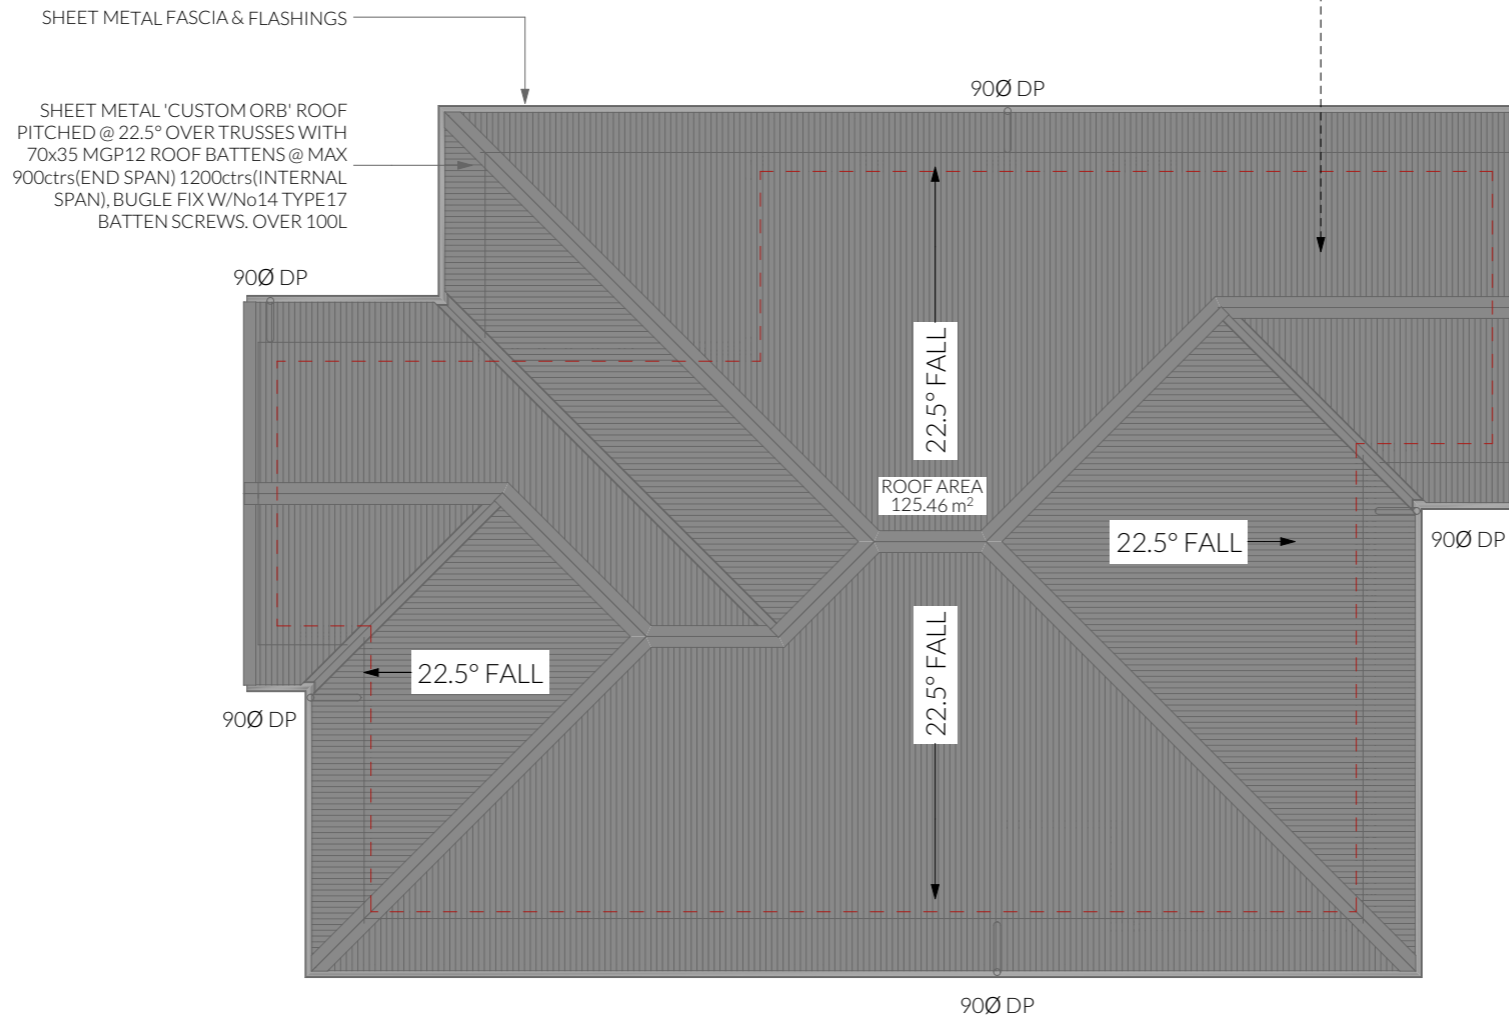

**REQUIRED NUMBER OF ROOF VENTS:**

ROOF PITCH >15° and <75°  
HIP/GABLE ROOF

**REQUIRED VENT AREA**

Low Vents = 0.39m<sup>2</sup> (57.03m x 7,000mm<sup>2</sup>)  
High Vents = 0.052m<sup>2</sup> (10.56m x 5,000mm<sup>2</sup>)

**EAVE VENTS**

BUILDERS EDGE EAVE VENT (EV4020)  
10x 400x200mm (0.042m<sup>2</sup>) VENTS EVENLY SPACED  
OR  
25mm CONTINUOUS VENT

**RIDGE VENT SYSTEM**

RIDGE CAP (Continuous 5mm gap in sarking)  
2x GABLE VENTS 300x300mm (0.09m<sup>2</sup>)

NOTE: GABLE VENTS SHALL BE INSTALLED WITHIN 900mm OF RIDGE

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U3 - Roof Plan</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:100 @ A3</b>  Pg. No: <b>A3.04</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																								
DA - 02	21.02.2025	Council RFI, add turning paths																									
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																									
DA - 04	07.04.2025	Council RFI, driveway and services																									
DA - 05	11.02.2026	Revise plans to match civil design																									
DA - 06	07.04.2026	Council RFI																									

**Smoke Alarms Part 9.5 of NCC 2022**

- Smoke alarms must-
- (a) be located in-
    - (i) a Class 1a building in accordance with 9.5.2 and 9.5.4; and
    - (ii) a Class 1b building in accordance with 9.5.3 and 9.5.4; and
  - (b) comply with AS 3786, except that in a Class 10a private garage where the use of the area is likely to result in smoke alarms causing spurious signals, any other alarm deemed suitable in accordance with AS 1670.1 may be installed provided that smoke alarms complying with AS 3786 are installed elsewhere in the Class 1 building; and
  - (c) be powered from the consumer mains source where a consumer mains source is supplied to the building; and be interconnected where there is more than one alarm.

- In a Class 1a building, smoke alarms must be located in-
- (a) any storey containing bedrooms, every corridor or hallway associated with a bedroom, or if there is no corridor or hallway, in an area between the bedrooms and the remainder of the building; and
  - (b) each other storey not containing bedrooms.

- Smoke alarms required by 9.5.2 and 9.5.3 must be installed on or near the ceiling, in accordance with the following:
- (a) Where a smoke alarm is located on the ceiling it must be-
    - (i) a minimum of 300 mm away from the corner junction of the wall and ceiling; and
    - (ii) between 500 mm and 1500 mm away from the high point and apexes of the ceiling, if the room has a sloping ceiling.
  - (b) Where (a) is not possible, the smoke alarm may be installed on the wall, and located a minimum of 300 mm and a maximum of 500 mm off the ceiling at the junction with the wall.

**Note: Exhaust Fans**

- Exhaust fans to comply with NCC 2022 Vol 2 Part 10.8.2 and have:
- An exhaust system installed in a kitchen, bathroom, sanitary compartment or laundry must have a minimum flow rate of-
    - (a) 25 L/s for a bathroom or sanitary compartment; and
    - (b) 40 L/s for a kitchen or laundry.
  - Exhaust from a kitchen, kitchen range hood, bathroom, sanitary compartment or laundry must discharge directly or via a shaft or duct to outdoor air.
  - Where a venting clothes dryer is installed, it must discharge directly or via a shaft or duct to outdoor air.
  - An exhaust system that is not run continuously and is serving a bathroom or sanitary compartment that is not ventilated in accordance with 10.6.2(a) must-
    - (a) be interlocked with the room's light switch; and
    - (b) include a run-on timer so that the exhaust system continues to operate for 10 minutes after the light switch is turned off.


**Note: Lighting**

- Lighting layout may change, owner to confirm with builder prior to purchase/installation of exact quantity and location of electrical services provided that installation is compliant with AS3000 and artificial lighting allowances do not exceed:
- 5W/m<sup>2</sup> in class 1a dwellings
  - 4W/m<sup>2</sup> to veranda, balcony or the like
  - 3W/m<sup>2</sup> in a class 10a dwelling associated with the class 1a dwelling


U.N.O - All downlights are to be Insulation Contact (IC) rated.

**Preparation for future Solar Installation:**

Should the solar design be required for future installation, 2/25mm solarflex (or similar) conduits marked "solar" are to be installed from the meter box to the roof space.

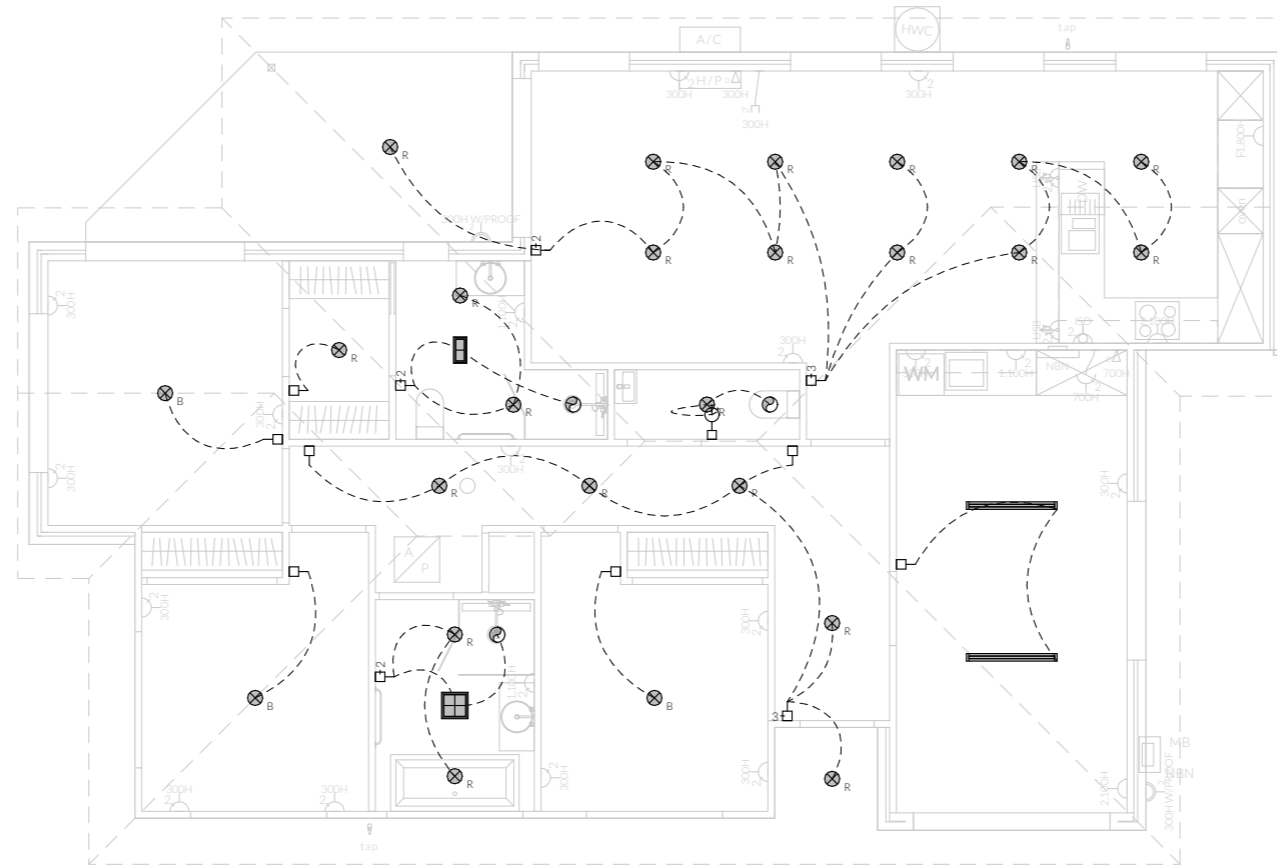

Electrical Plan - Light/Reflected Ceiling

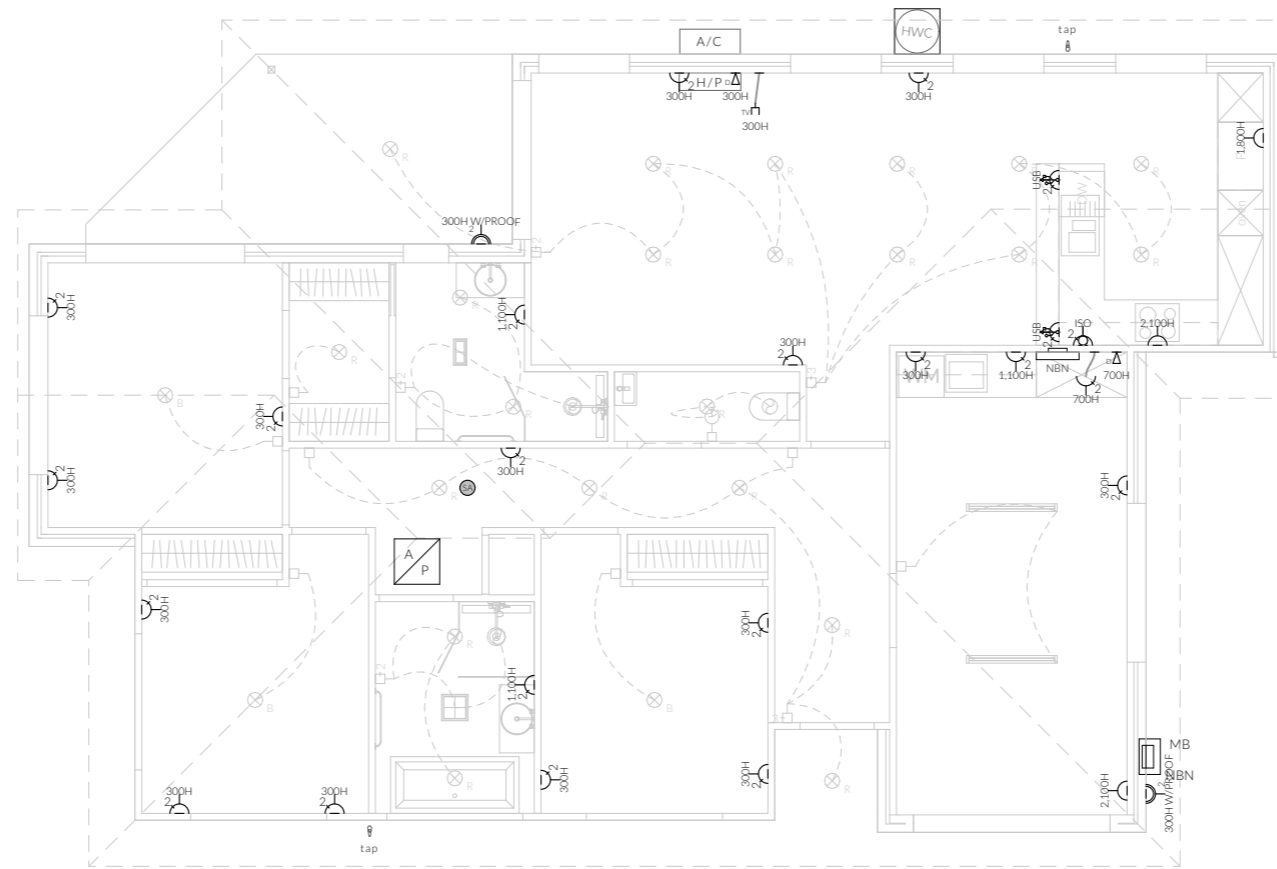

Electrical Plan - Power

**ELECTRICAL LEGEND - UNIT 3**




Symbol	Description	Allowance	Quantity
700H	DATA - CAT 6 (RJ45) - 1 GANG		2
300H	DATA - TV CONNECTION		1
[Symbol]	FAN - 3 IN 1 (2 LAMP)	10W (LIGHT)	1
[Symbol]	FAN - 3 IN 1 (4 LAMP)	10W (LIGHT)	1
[Symbol]	FAN - CEILING - EXHAUST		3
2.100H	GPO - (1) SINGLE		3
1.100H	GPO - (2) DOUBLE		19
[Symbol]	GPO - (2) DOUBLE (WITH COOKTOP ISOLATOR SWITCH)		1
[Symbol]	GPO - (2) DOUBLE (WITH USB CHARGER)		2
300H/W/PROOF	GPO - WEATHER PROOF DOUBLE		2
[Symbol]	LIGHT - CEILING - BATTEN FITTING	20W	3
[Symbol]	LIGHT - CEILING - DOWNLIGHT RECESSED	10W	22
[Symbol]	LIGHT - CEILING - LED BATTEN	20W	2
[Symbol]	SERVICE - SMOKE ALARM		1
[Symbol]	SWITCH - LIGHT 1 GANG		7
[Symbol]	SWITCH - LIGHT 2 GANG		3
[Symbol]	SWITCH - LIGHT 3 GANG		2
[Symbol]	SWITCH - WITH TIMER		1

**Notes**

- U.N.O ceilings are to be plasterboard.
- o-----o Dimmable Circuit
- |-----| Timer Circuit(as fan note)
- PB - Plasterboard
- CS - Cement Sheet Eaves
- PW - Plywood Ceiling
- TB - Timber Batten Ceiling

NOT FOR CONSTRUCTION

<p>PINNACLE DRAFTING &amp; DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y</p>	<p><b>U3 - Electrical Plan</b></p> <p>Revision: DA - 06 Approved by: JRM</p>	<p>Scale: 1:100 @ A3 Pg. No: A3.05</p>	<p>Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017</p>	<p>Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS</p>	<p>Issue Date</p> <p>DA - 02 21.02.2025 DA - 03 14.03.2025 DA - 04 07.04.2025 DA - 05 11.02.2026 DA - 06 07.04.2026</p>	<p>Description</p> <p>Council RFI, add turning paths TasWater RFI, relocate units 1,2,3 Council RFI, driveway and services Revise plans to match civil design Council RFI</p>		<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	
--	--	--	--	---	---	---	--	--	--

-  Access Panel
-  Articulation Joint
-  Smoke Alarm

-  - BATTS TO WALL
-  - SOUND INSULATION

### Construction of sanitary compartments 10.4.2 of NCC 2022

The door to a fully enclosed sanitary compartment must -

- open outwards; or
- slide; or
- be readily removable from the outside of the compartment.

unless there is a clear space of at least 1.2 m, measured in accordance with Figure 10.4.2 of NCC 2022 Vol II, between the closet pan within the sanitary compartment and the doorway.

### Note: Safe Movement & Egress

Openable windows greater than 4m above the surface below are to be fitted with a device to limit opening or a suitable screen so a 125mm sphere cannot pass through. Except for Bedrooms, where the requirement is for heights above 2m. Refer to clauses 11.3.7 and 11.3.8 of NCC 2022 for further information on suitable protective devices.

### Note: Paved Areas

All paths and patios to fall away from dwelling.

### Note: Stair Construction

All stairs to be constructed in accordance with NCC Vol II 2022 Part 11.2.2:

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

For stairways serving non-habitable room used infrequently, refer to table 11.2.2(b).

Landings to comply with Clause 11.2.5 and be a minimum of 750mm deep measured 500mm from the inside edge of the landing.

Slip resistance of treads, nosings and ramps to comply with Clause 11.2.4.

### Heights of rooms & other spaces 10.3.1 of NCC 2022


Heights of rooms and other spaces must not be less than;

- (a) in a habitable room excluding a kitchen - 2.4 m; and
- (b) in a kitchen - 2.1 m; and
- (c) in a corridor, passageway or the like - 2.1 m; and
- (d) in a bathroom, shower room, laundry, sanitary compartment, airlock, pantry, storeroom, garage, car parking area or the like - 2.1 m; and
- (e) in a room or space with a sloping ceiling or projections below the ceiling line within- See NCC directly for these items
- (f) in a stairway, ramp, landing, or the like - 2.0 m measured vertically above the nosing line of stairway treads or the floor surface of a ramp, landing or the like.



If required onsite, the builder may work within the tolerances of the above as specified within the NCC 2022 Vol II. Builder to contact Pinnacle before undertaking works.

### Unit 4 Floor Areas

Floor Area	134.55m <sup>2</sup>
Alfresco	11.63m <sup>2</sup>
Porch	2.69m <sup>2</sup>

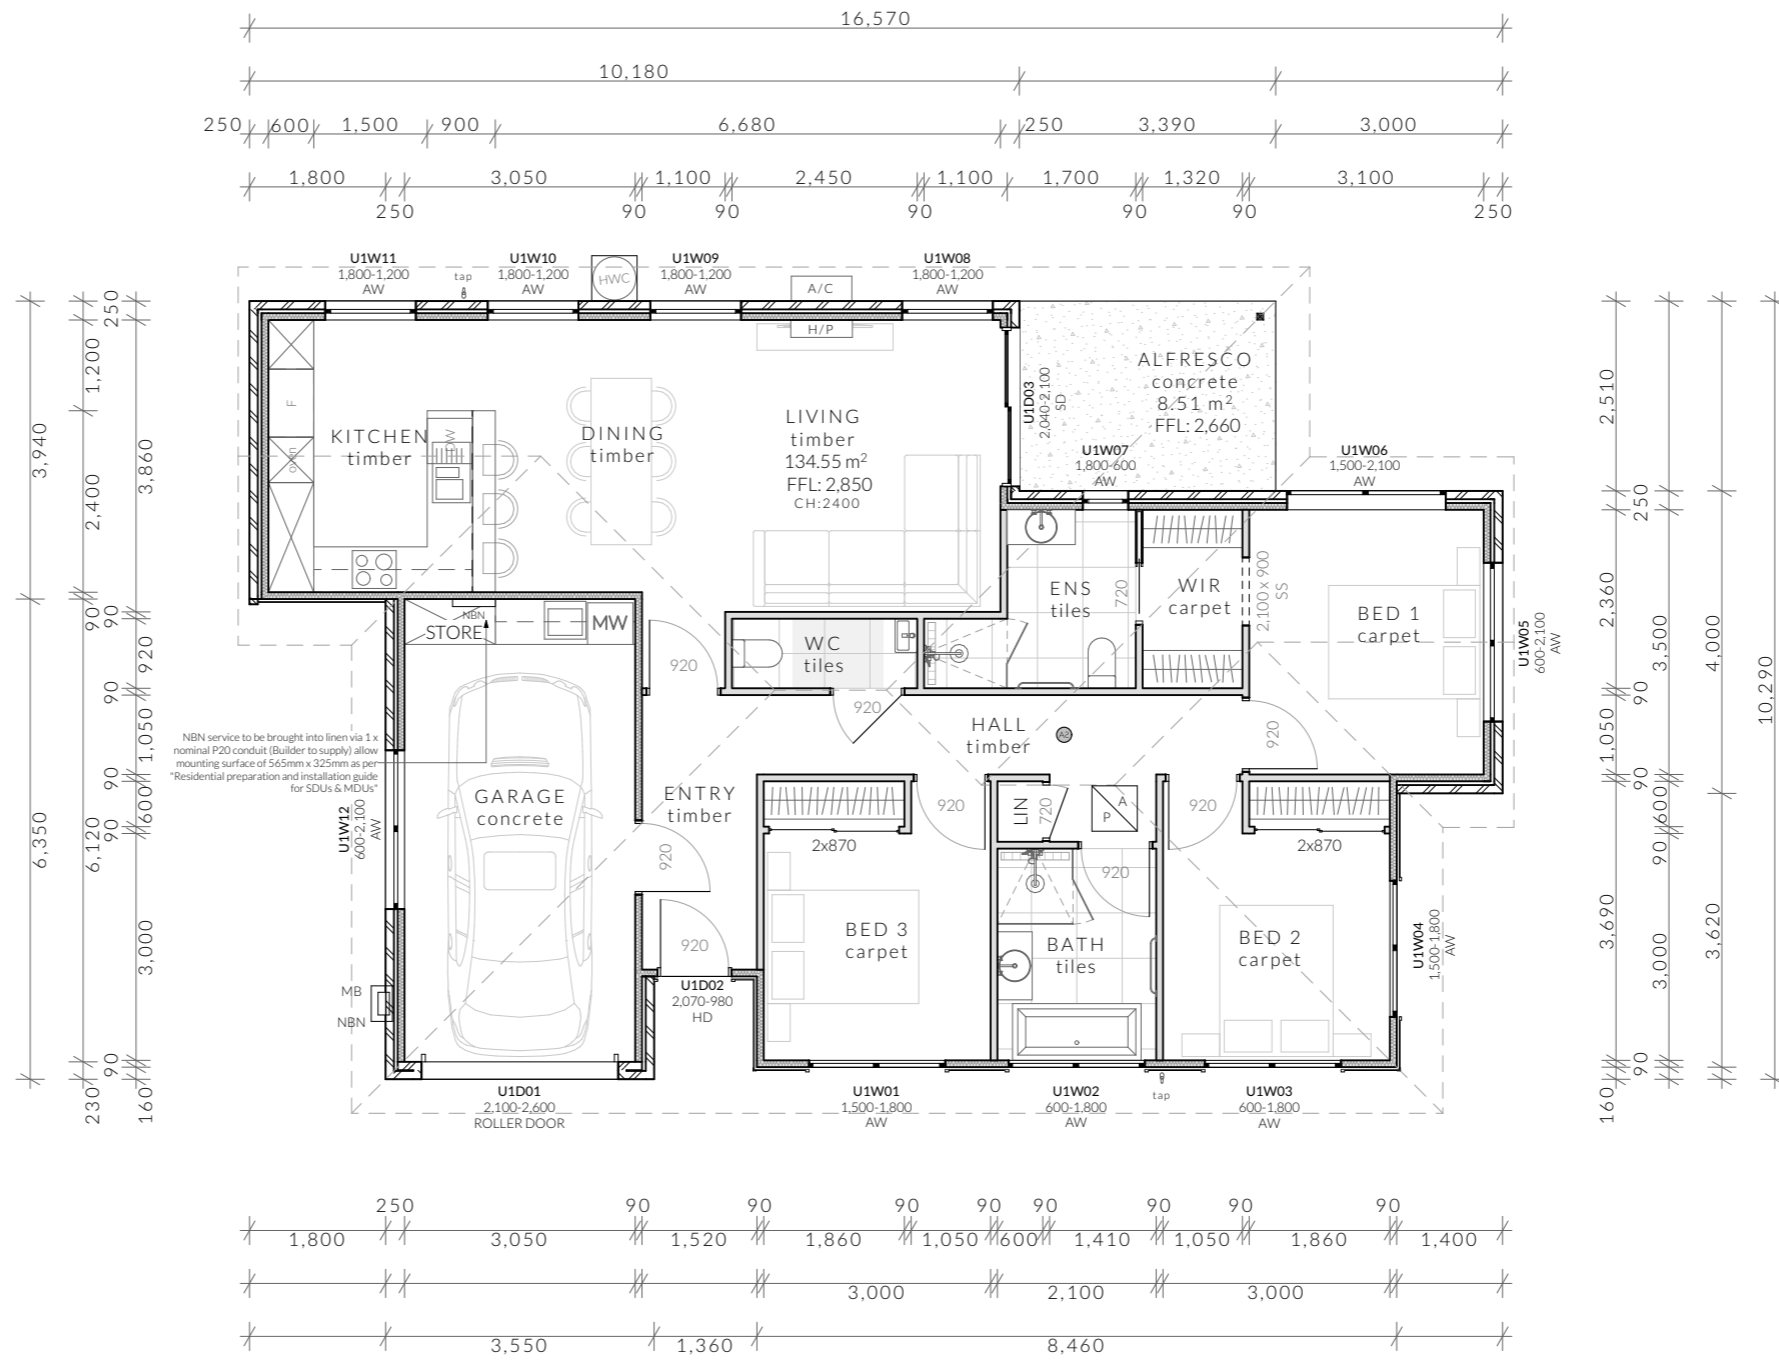


NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U4 - Floor Plan</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:100 @ A3</b>  Pg. No: <b>A4.01</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	
	Issue	Date	Description																								
DA - 02	21.02.2025	Council RFI, add turning paths																									
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																									
DA - 04	07.04.2025	Council RFI, driveway and services																									
DA - 05	11.02.2026	Revise plans to match civil design																									
DA - 06	07.04.2026	Council RFI																									



U4 - North Elevation

1:100

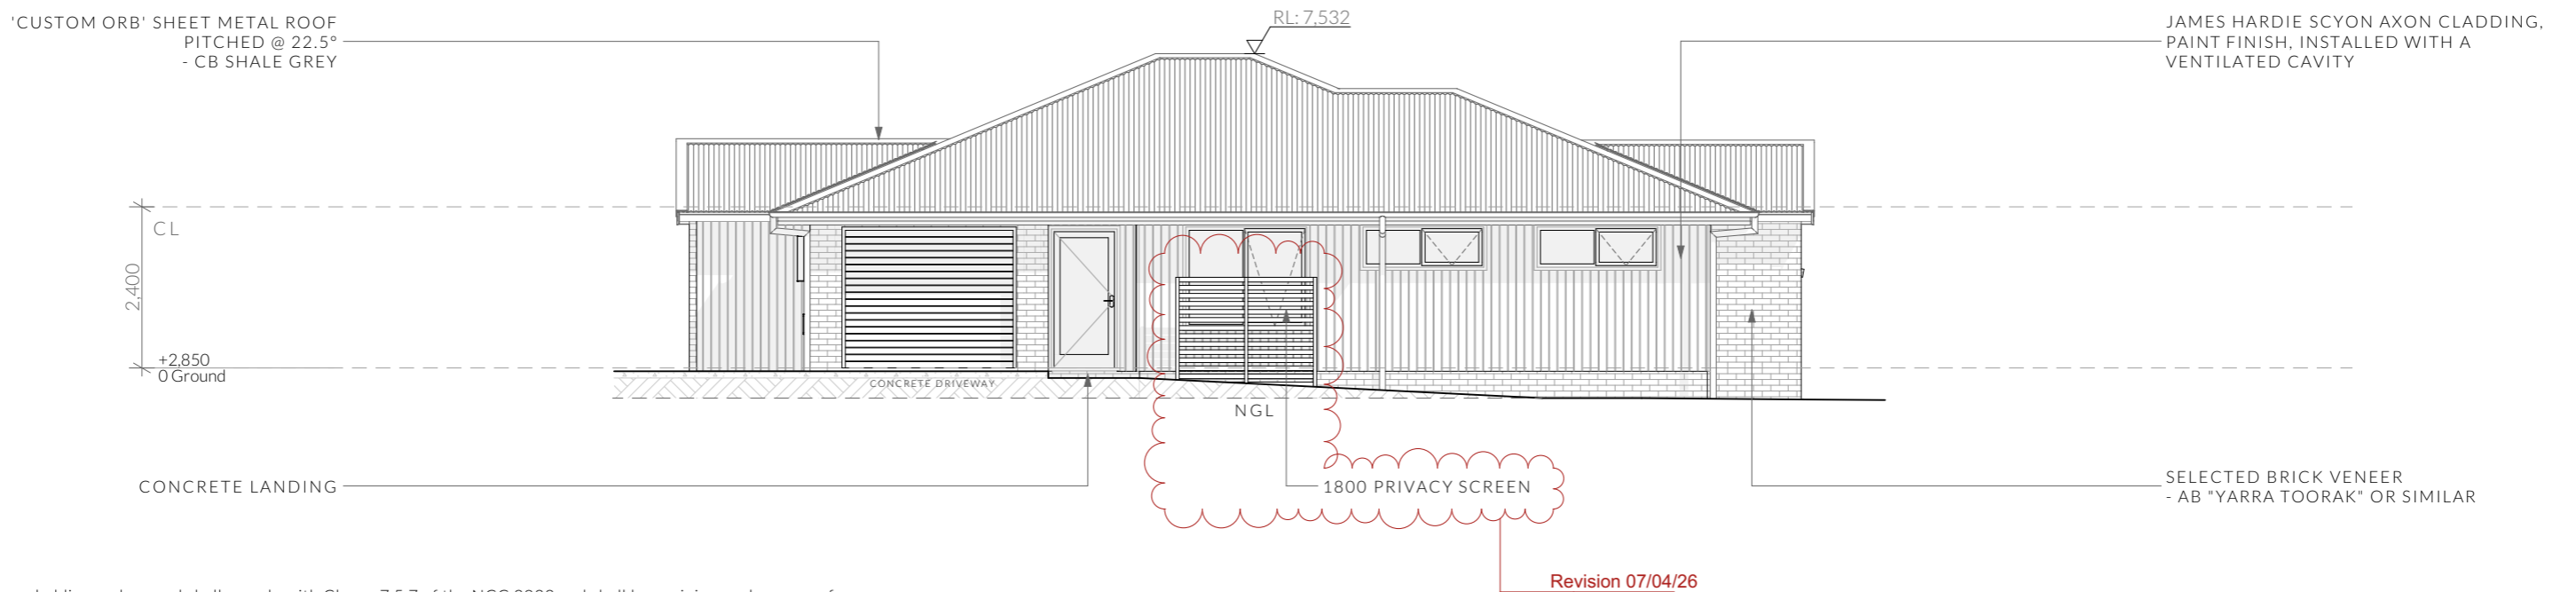

U4 - South Elevation

1:100

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of: 100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700


NOT FOR CONSTRUCTION

<p>PINNACLE PINNACLE DRAFTING &amp; DESIGN 7/3 Abernart Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y</p>	<p><b>U4 - Elevations</b></p> <p>Revision: <b>DA - 06</b> Approved by: <b>JRM</b></p>	<p>Scale: <b>1:100 @ A3</b> Pg. No: <b>A4.02</b></p>	<p>Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017</p>	<p>Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS</p>	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	<p>Lydenbuilders bdaa BUILDING DESIGNERS ASSOCIATION OF AUSTRALIA</p>
	Issue	Date	Description																						
DA - 02	21.02.2025	Council RFI, add turning paths																							
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																							
DA - 04	07.04.2025	Council RFI, driveway and services																							
DA - 05	11.02.2026	Revise plans to match civil design																							
DA - 06	07.04.2026	Council RFI																							

JAMES HARDIE SCYON AXON CLADDING,  
PAINT FINISH, INSTALLED WITH A  
VENTILATED CAVITY

'CUSTOM ORB' SHEET METAL ROOF  
PITCHED @ 22.5°  
- CB SHALE GREY

CL  
2,400  
+2,850  
0 Ground

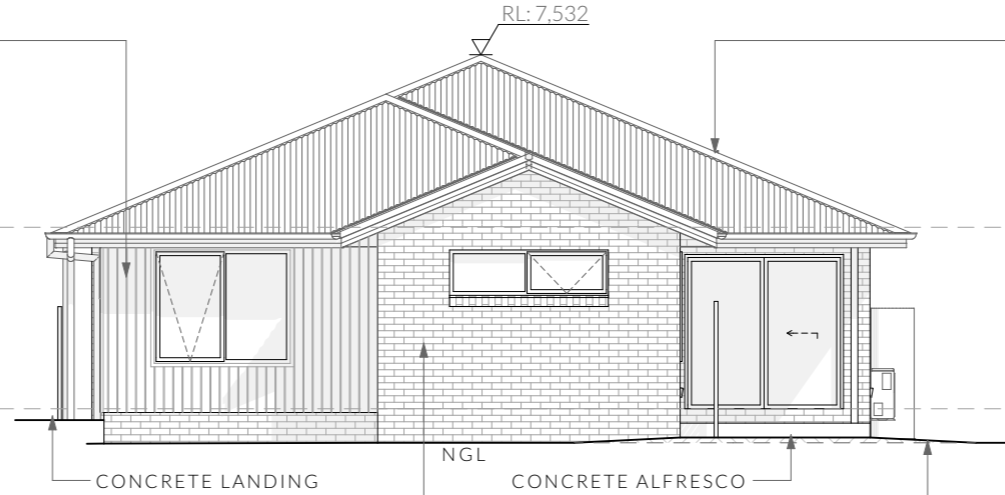

SELECTED BRICK VENEER  
- AB "YARRA TOORAK" OR SIMILAR

FALL GROUND AWAY FROM HOUSE A  
MINIMUM OF 50mm OVER THE FIRST  
1000mm IN ACCORDANCE WITH AS2870,  
NCC 2022 PART 3.3.3 & Fig. 3.3.3a

U4 - East Elevation


1:100

CL  
2,400  
+2,850  
0 Ground

SELECTED BRICK VENEER  
- AB "YARRA TOORAK" OR SIMILAR

'CUSTOM ORB' SHEET METAL ROOF  
PITCHED @ 22.5°  
- CB SHALE GREY

CL  
2,400  
+2,850  
0 Ground

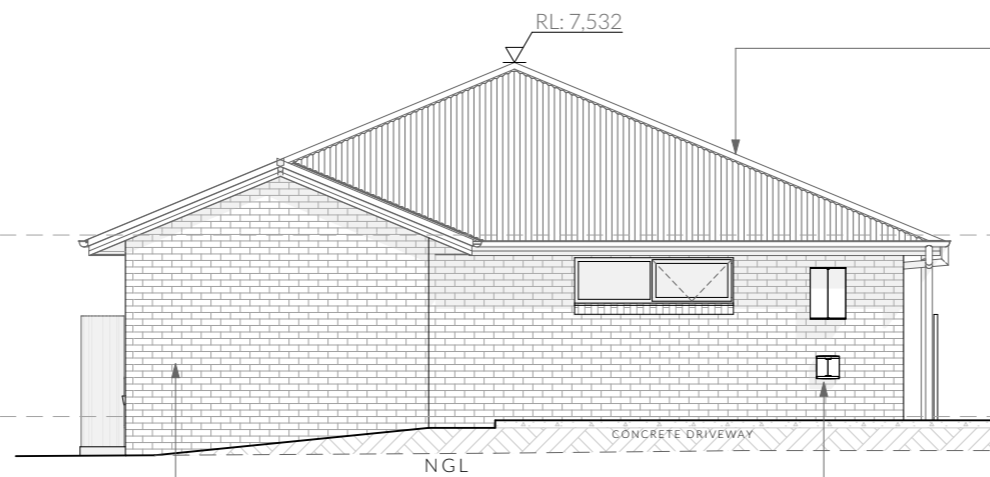

NBN SERVICE TO BE INSTALLED IN  
ACCORDANCE WITH "RESIDENTIAL  
PREPARATION AND INSTALLATION GUIDE  
FOR SDUS AND MDUS", PCD TO BE  
INSTALLED MINIMUM OF 410mm AND  
MAXIMUM OF 1500mm MEASURED TO THE  
UNDERSIDE OF BOX.

U4 - West Elevation

1:100

**NOTE**

Clearances between cladding and ground shall comply with Clause 7.5.7 of the NCC 2022 and shall be a minimum clearance of:  
100mm in low rainfall intensity areas or sandy, well-drained areas; or 50mm above impermeable areas that slope away from the building; or 150mm in any other case.

Wall cladding must extend a minimum of 50 mm below the bearer or lowest horizontal part of the suspended floor framing.

U.N.O in builders specifications or located in saline environments or if using a glazed finish brick, brickwork is to be installed in stretcher bond pattern with raked joints.

As per NCC parts 11.3.7 and 11.3.8,

Openable windows greater than 4m above ground level are to be fitted with a device to limit the opening or a suitable screen so a 125mm sphere cannot pass through, and withstand a force of 250N. Except for bedrooms, where the requirement is for heights above 2m.

All stairs to be constructed in accordance with NCC 2022 Vol II Part 11.2.2

Riser: Min 115mm - Max 190mm

Going: Min 240mm - Max 355mm

Slope (2R+G): Max 550 - Min 700

NOT FOR CONSTRUCTION

PINNACLE

PINNACLE DRAFTING & DESIGN  
7/3 Abernant Way, Cambridge 7170  
03 6248 4218  
admin@pinnacledrafting.com.au  
www.pinnacledrafting.com.au  
Licence: CC6073Y

**U4 - Elevations**

Revision: **DA - 06**  
Approved by: **JRM**

Scale:  
**1:100** @ A3  
Pg. No:  
**A4.03**

Proposal: Unit Development  
Client: Lyden Developments  
Address: 77 Fouche Avenue, Old Beach 7017

Date: 11/02/2026  
Drawn by: MM  
Job No: 065-2023  
Engineer: TBA  
Building Surveyor: LTBS

Issue	Date
DA - 02	21.02.2025
DA - 03	14.03.2025
DA - 04	07.04.2025
DA - 05	11.02.2026
DA - 06	07.04.2026

Description
Council RFI, add turning paths
TasWater RFI, relocate units 1,2,3
Council RFI, driveway and services
Revise plans to match civil design
Council RFI

These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.



**Ventilation of roof spaces NCC 2022**

**Part 10.8.3**

A roof must have a roof space that-

- (a) is located-
  - (i) immediately above the primary insulation layer; or
  - (ii) immediately above sarking with a vapour permeance of not less than 1.14 µg/N.s, which is immediately above the primary insulation layer; or
  - (iii) immediately above ceiling insulation; and
- (b) has a height of not less than 20 mm; and
- (c) is either-
  - (i) ventilated to outdoor air through evenly distributed openings in accordance with Table 10.8.3; or
  - (ii) located immediately underneath the roof tiles of an unsarked tiled roof.

**Stormwater Notes**

All gutters, downpipes and rain heads to be designed and installed in compliance with AS3500.3 & NCC 2022 Volume II Part 7.4.

**Roofing Cladding**

Roof cladding, flashings, cappings, roof sheeting and fixings are to be installed in accordance with NCC 2022 Volume II Part 7.2 for sheet roofing and Part 7.3 for tiled and shingle roofing.


**Eaves & Soffit Linings**

To comply with NCC 2022 Vol II Part 7.5.5 and where provided, external fibre-cement sheets and linings used as eaves and soffit linings must-

- (a) comply with AS/NZS 2908.2 or ISO 8336; and
- (b) be fixed in accordance with Table 7.5.5 and Figure 7.5.5 using-
  - (i) 2.8 x 30 mm fibre-cement nails; or
  - (ii) No. 8 wafer head screws (for 4.5 mm and 6 mm sheets only); or
  - (iii) No. 8 self embedding head screws (for 6 mm sheets only).

Refer to table 7.5.5 for trimmer and fastener spacings.

ROOF PITCH	VENTILATION OF OPENINGS (TABLE 10.8.3)
>15° AND <75°	7,000 mm <sup>2</sup> /m provided at the eaves and 5,000 mm <sup>2</sup> /m at high level, plus an additional 18,000 mm <sup>2</sup> /m at the eaves if the roof has a cathedral ceiling
(1) Ventilation openings are specified as a minimum free open area per metre length of the longest horizontal dimension of the roof. (2) For the purposes of this Table, high level openings are openings provided at the ridge or not more than 900 mm below the ridge or highest point of the roof space, measured vertically.	

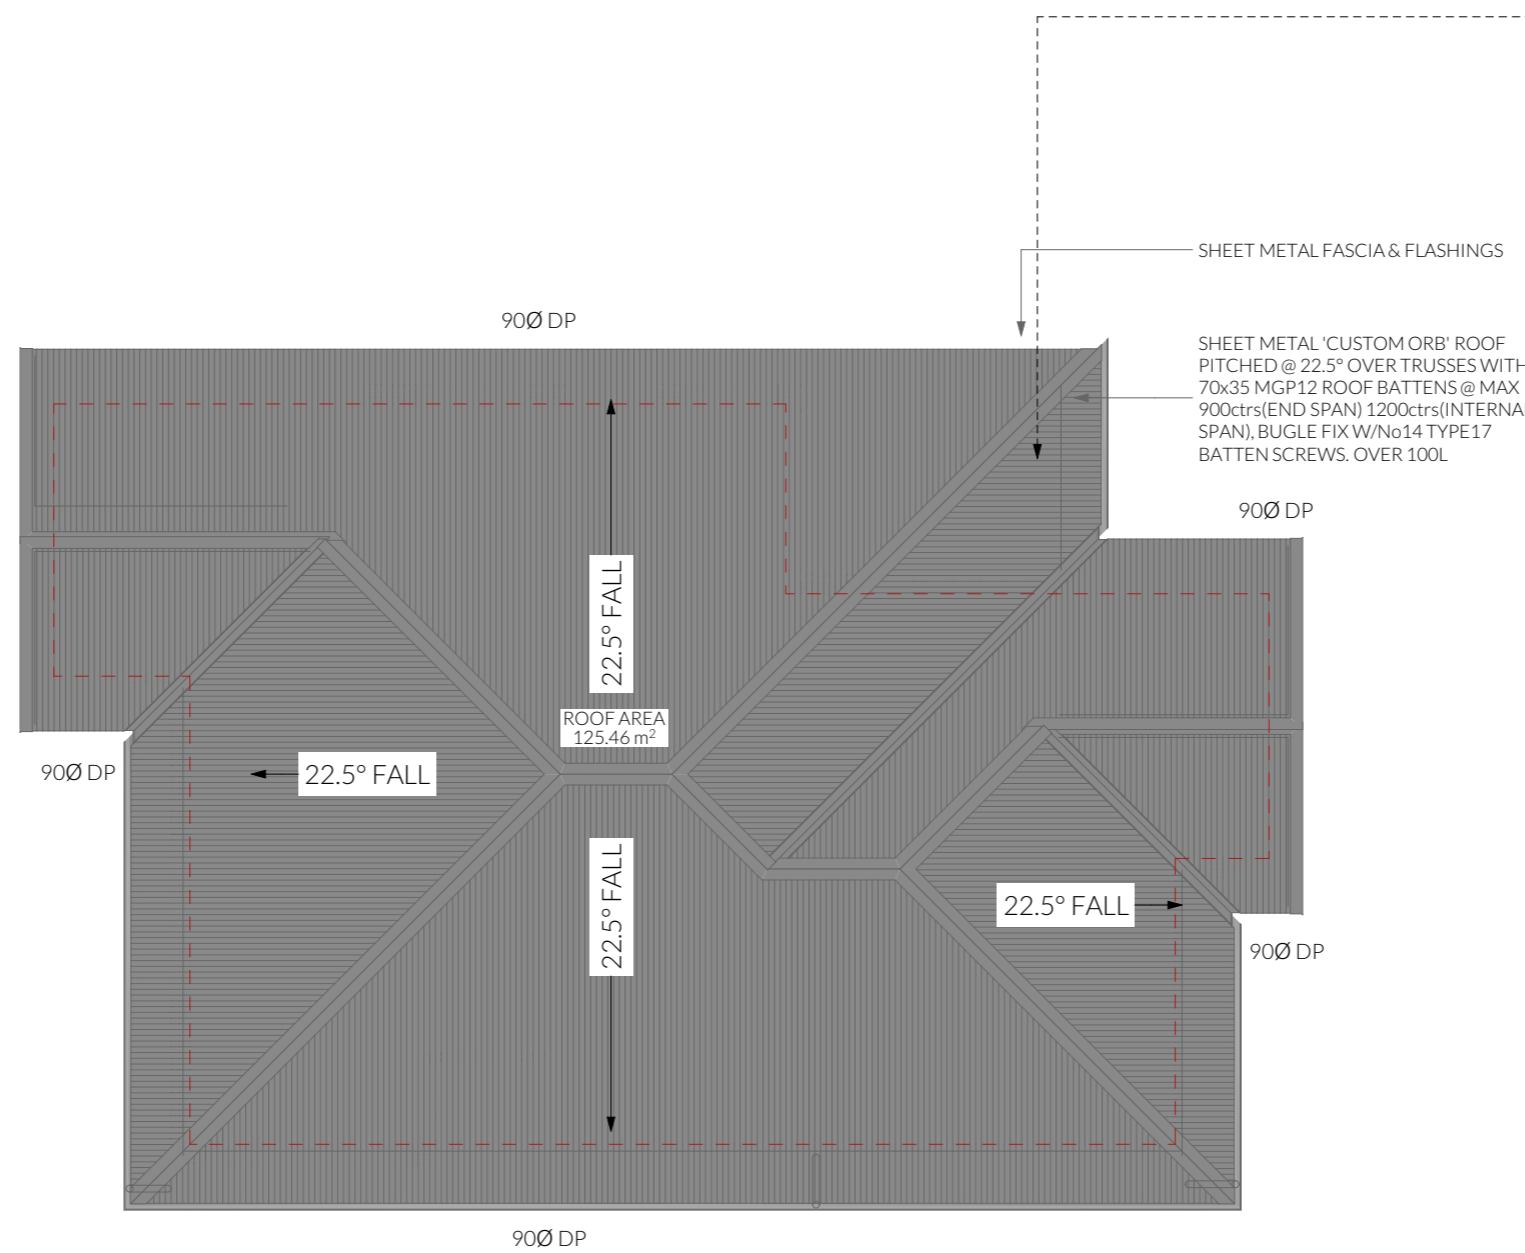

**REQUIRED NUMBER OF ROOF VENTS:**

ROOF PITCH >15° and <75°  
HIP/GABLE ROOF

**REQUIRED VENT AREA**

Low Vents = 0.39m<sup>2</sup> (57.03m x 7,000mm<sup>2</sup>)  
High Vents = 0.052m<sup>2</sup> (10.56m x 5,000mm<sup>2</sup>)

**EAVE VENTS**

BUILDERS EDGE EAVE VENT (EV4020)  
10x 400X200mm(0.042m<sup>2</sup>) VENTS EVENLY SPACED  
OR  
25mm CONTINUOUS VENT

**RIDGE VENT SYSTEM**

RIDGE CAP (Continuous 5mm gap in sarking)  
2x GABLE VENTS 300x300mm (0.09m<sup>2</sup>)

NOTE: GABLE VENTS SHALL BE INSTALLED WITHIN 900mm OF RIDGE

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>U4 - Roof Plan</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:100 @ A3</b>  Pg. No: <b>A4.04</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																								
DA - 02	21.02.2025	Council RFI, add turning paths																									
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																									
DA - 04	07.04.2025	Council RFI, driveway and services																									
DA - 05	11.02.2026	Revise plans to match civil design																									
DA - 06	07.04.2026	Council RFI																									

**ELECTRICAL LEGEND - UNIT 4**

Symbol	Description	Allowance	Quantity
--------	-------------	-----------	----------

**Smoke Alarms Part 9.5 of NCC 2022**

- Smoke alarms must-
- (a) be located in-
    - (i) a Class 1a building in accordance with 9.5.2 and 9.5.4; and
    - (ii) a Class 1b building in accordance with 9.5.3 and 9.5.4; and
  - (b) comply with AS 3786, except that in a Class 10a private garage where the use of the area is likely to result in smoke alarms causing spurious signals, any other alarm deemed suitable in accordance with AS 1670.1 may be installed provided that smoke alarms complying with AS 3786 are installed elsewhere in the Class 1 building; and
  - (c) be powered from the consumer mains source where a consumer mains source is supplied to the building; and be interconnected where there is more than one alarm.

- In a Class 1a building, smoke alarms must be located in-
- (a) any storey containing bedrooms, every corridor or hallway associated with a bedroom, or if there is no corridor or hallway, in an area between the bedrooms and the remainder of the building; and
  - (b) each other storey not containing bedrooms.

- Smoke alarms required by 9.5.2 and 9.5.3 must be installed on or near the ceiling, in accordance with the following:
- (a) Where a smoke alarm is located on the ceiling it must be-
    - (i) a minimum of 300 mm away from the corner junction of the wall and ceiling; and
    - (ii) between 500 mm and 1500 mm away from the high point and apexes of the ceiling, if the room has a sloping ceiling.
  - (b) Where (a) is not possible, the smoke alarm may be installed on the wall, and located a minimum of 300 mm and a maximum of 500 mm off the ceiling at the junction with the wall.

**Note: Exhaust Fans**

- Exhaust fans to comply with NCC 2022 Vol 2 Part 10.8.2 and have:
- An exhaust system installed in a kitchen, bathroom, sanitary compartment or laundry must have a minimum flow rate of-
    - (a) 25 L/s for a bathroom or sanitary compartment; and
    - (b) 40 L/s for a kitchen or laundry.
  - Exhaust from a kitchen, kitchen range hood, bathroom, sanitary compartment or laundry must discharge directly or via a shaft or duct to outdoor air.
  - Where a venting clothes dryer is installed, it must discharge directly or via a shaft or duct to outdoor air.
  - An exhaust system that is not run continuously and is serving a bathroom or sanitary compartment that is not ventilated in accordance with 10.6.2(a) must-
    - (a) be interlocked with the room's light switch; and
    - (b) include a run-on timer so that the exhaust system continues to operate for 10 minutes after the light switch is turned off.


**Note: Lighting**

- Lighting layout may change, owner to confirm with builder prior to purchase/installation of exact quantity and location of electrical services provided that installation is compliant with AS3000 and artificial lighting allowances do not exceed:
- 5W/m<sup>2</sup> in class 1a dwellings
  - 4W/m<sup>2</sup> to veranda, balcony or the like
  - 3W/m<sup>2</sup> in a class 10a dwelling associated with the class 1a dwelling


U.N.O - All downlights are to be Insulation Contact (IC) rated.

**Preparation for future Solar Installation:**

Should the solar design be required for future installation, 2/25mm solarflex (or similar) conduits marked "solar" are to be installed from the meter box to the roof space.

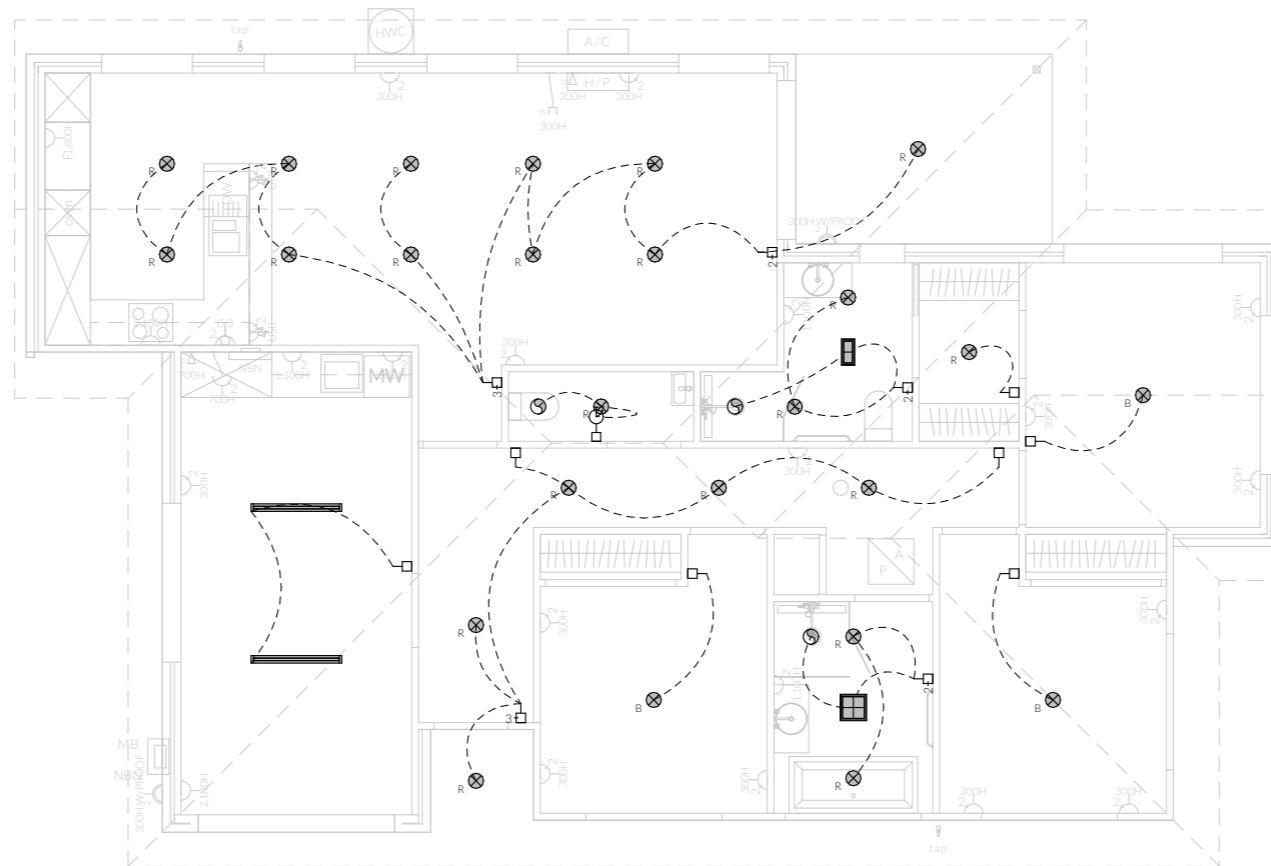

Electrical Plan - Light/Reflected Ceiling

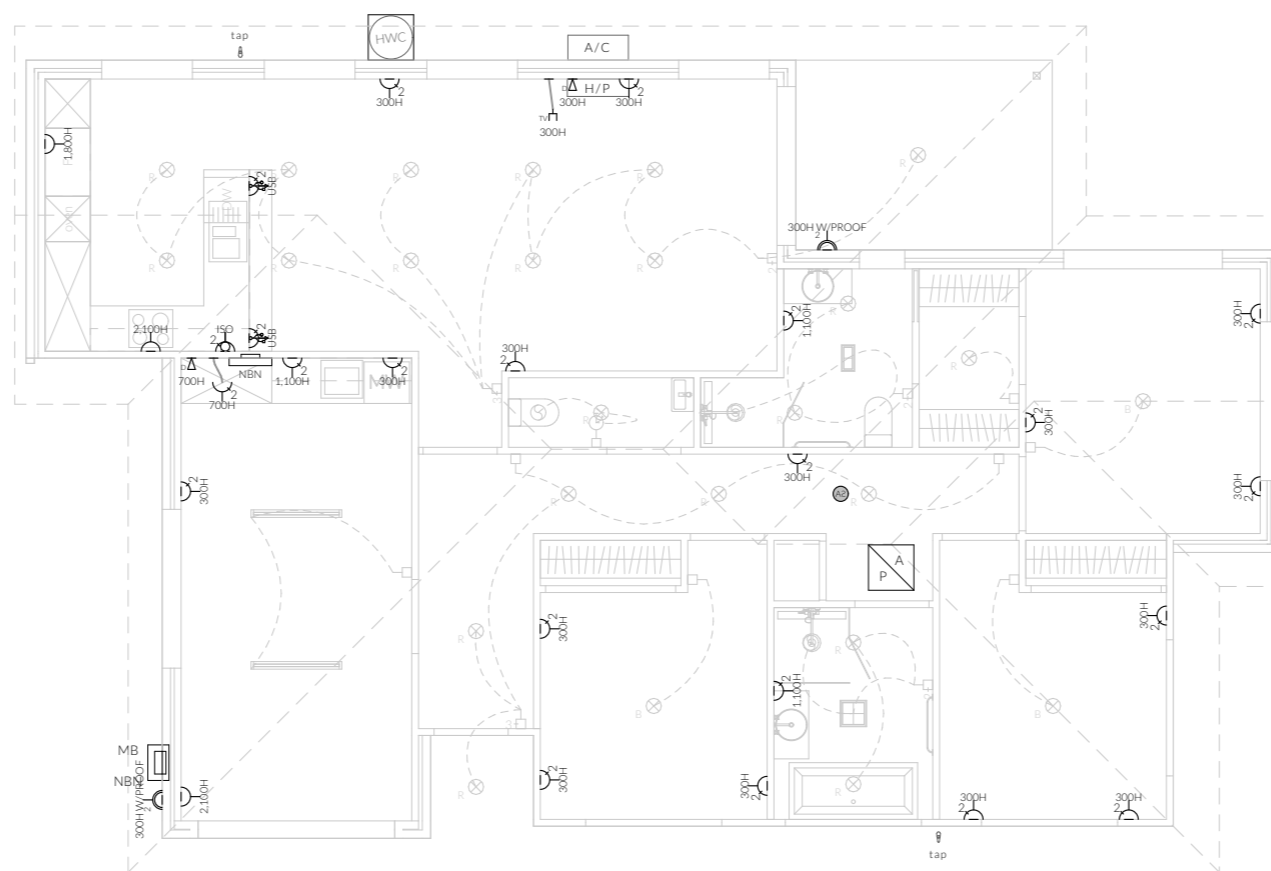

Electrical Plan - Power

**Notes**

U.N.O ceilings are to be plasterboard.

- o-----o Dimmable Circuit
- t-----t Timer Circuit(as fan note)
- PB - Plasterboard
- CS - Cement Sheet Eaves
- PW - Plywood Ceiling
- TB - Timber Batten Ceiling

NOT FOR CONSTRUCTION


<p>PINNACLE DRAFTING &amp; DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y</p>	<p><b>U4 - Electrical Plan</b></p> <p>Revision: <b>DA - 06</b> Approved by: <b>JRM</b></p>	<p>Scale: <b>1:100 @ A3</b> Pg. No: <b>A4.05</b></p>	<p>Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017</p>	<p>Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS</p>	<p>Issue Date</p> <p>DA - 02 21.02.2025 DA - 03 14.03.2025 DA - 04 07.04.2025 DA - 05 11.02.2026 DA - 06 07.04.2026</p>	<p>Description</p> <p>Council RFI, add turning paths TasWater RFI, relocate units 1,2,3 Council RFI, driveway and services Revise plans to match civil design Council RFI</p>		<p>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</p>	<p>Lydenbuilders BUILDING DESIGNERS ASSOCIATION OF AUSTRALIA</p>
--	--	--	--	---	---	---	--	--	--

**Vehicle Movement Notes**

- Movement templates demonstrate the ability of vehicles to enter intersection in a forwards direction and leave in a forwards direction.

- The base dimensions of the vehicle template represent the B85 (85th Percentile) Vehicle

- The swept path of the vehicle represent the outer extents of the vehicle.

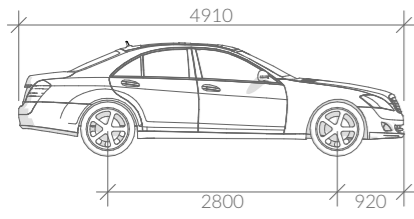

**B85 Vehicle Dimensions**

- Width: 1870
- Track: 1770
- L-L Time: 6.0
- Turning Radius: 5800

**Parking Space requirements**

As defined by the Parking and Sustainable Transport Code - Table C2.3

**Parking Dimensions - 90°**

- Width: 2600 2800 3000 3200
- Length: 5400 5400 5400 5400
- Aisle Width: 6400 5800 5200 4800

**Parking Dimensions - 45°**

- Width: 2600
- Length: 5400
- Aisle Width: 3500

**Parking Dimensions - Parallel**

- Width: 2300
- Length: 6700
- Aisle Width: 3600

**Legend**

- - Solar Bollard Lighting
- ▽ - Spotlight with Sensor

**Turning Path Legend**



















- LINE OF BODY
- 300mm BODY CLEARANCE
- ← DIRECTION OF TRAVEL



NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>Parking</b>  Revision: DA - 06 Approved by: JRM	Scale: 1:200 @ A3 Pg. No: C.01	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		<p><small>These drawings are the property of Pinnacle Drafting &amp; Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING &amp; DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.</small></p>	 
	Issue	Date	Description																								
DA - 02	21.02.2025	Council RFI, add turning paths																									
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																									
DA - 04	07.04.2025	Council RFI, driveway and services																									
DA - 05	11.02.2026	Revise plans to match civil design																									
DA - 06	07.04.2026	Council RFI																									

**Legend**

-  - General Waste Bin
-  - Recycling Bin
-  - Green Waste Bin
-  - Clothesline
-  - Air Conditioner unit
-  - Meter Box
-  - Hot Water Cylinder
-  - 1.8m to 2.1m Paling Fence
-  - 1.7m high Timber Screen
-  - 1.2m Timber Fence
-  - Solar Bollard Lighting
-  - Spotlight with Sensor
-  - Seeded Lawn
-  - Mulched Garden Bed
-  - Gravel Area - Fine
-  - Decorative Pebble
-  - Water
-  - Paving

**Note**  
Refer to Planting Schedule & Details page for plant information.





Revision 07/04/25

Revision 07/04/26

PIT TO BE LOCATED OUTSIDE OF THE FENCING

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>Landscaping Plan</b>  Revision: <b>DA - 06</b> Approved by: <b>JRM</b>	Scale: <b>1:200 @ A3</b> Pg. No: <b>L01</b>	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI		These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting/producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																								
DA - 02	21.02.2025	Council RFI, add turning paths																									
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																									
DA - 04	07.04.2025	Council RFI, driveway and services																									
DA - 05	11.02.2026	Revise plans to match civil design																									
DA - 06	07.04.2026	Council RFI																									

**Planting Schedule**


Symbol	Name	Qty	Pot Size	Height	Spread
	Abelia sp. or similar	1	tubestock	2,000	2,000
	Anigozanthos sp. or similar	11	35L	900	900
	Callistemon sp. or similar	3	35L	3,500	3,000
	Dianella tasmanica or similar	8	tubestock	1,000	1,000
	Eremophila sp. or similar	1	140mm	2,500	2,500
	Hebe sp. or similar	5	tubestock	1,000	1,000
	Lavandula sp. or similar	8	140mm	700	800
	Lomandra sp. or similar	14	tubestock	600	800
	Rhagosa sp. or similar	10	35L	1,500	1,800

**Notes**

- Liase with superintendent where clay or ground water is encountered during excavation of planting hole.
- Tree supports:
  - Trees <3m high use stakes
  - Trees >3m high use guy wires
- Place plants upright and in centre of hole.

**KEY**


- SLOW RELEASE FERTILISER
- PLANTING MIX

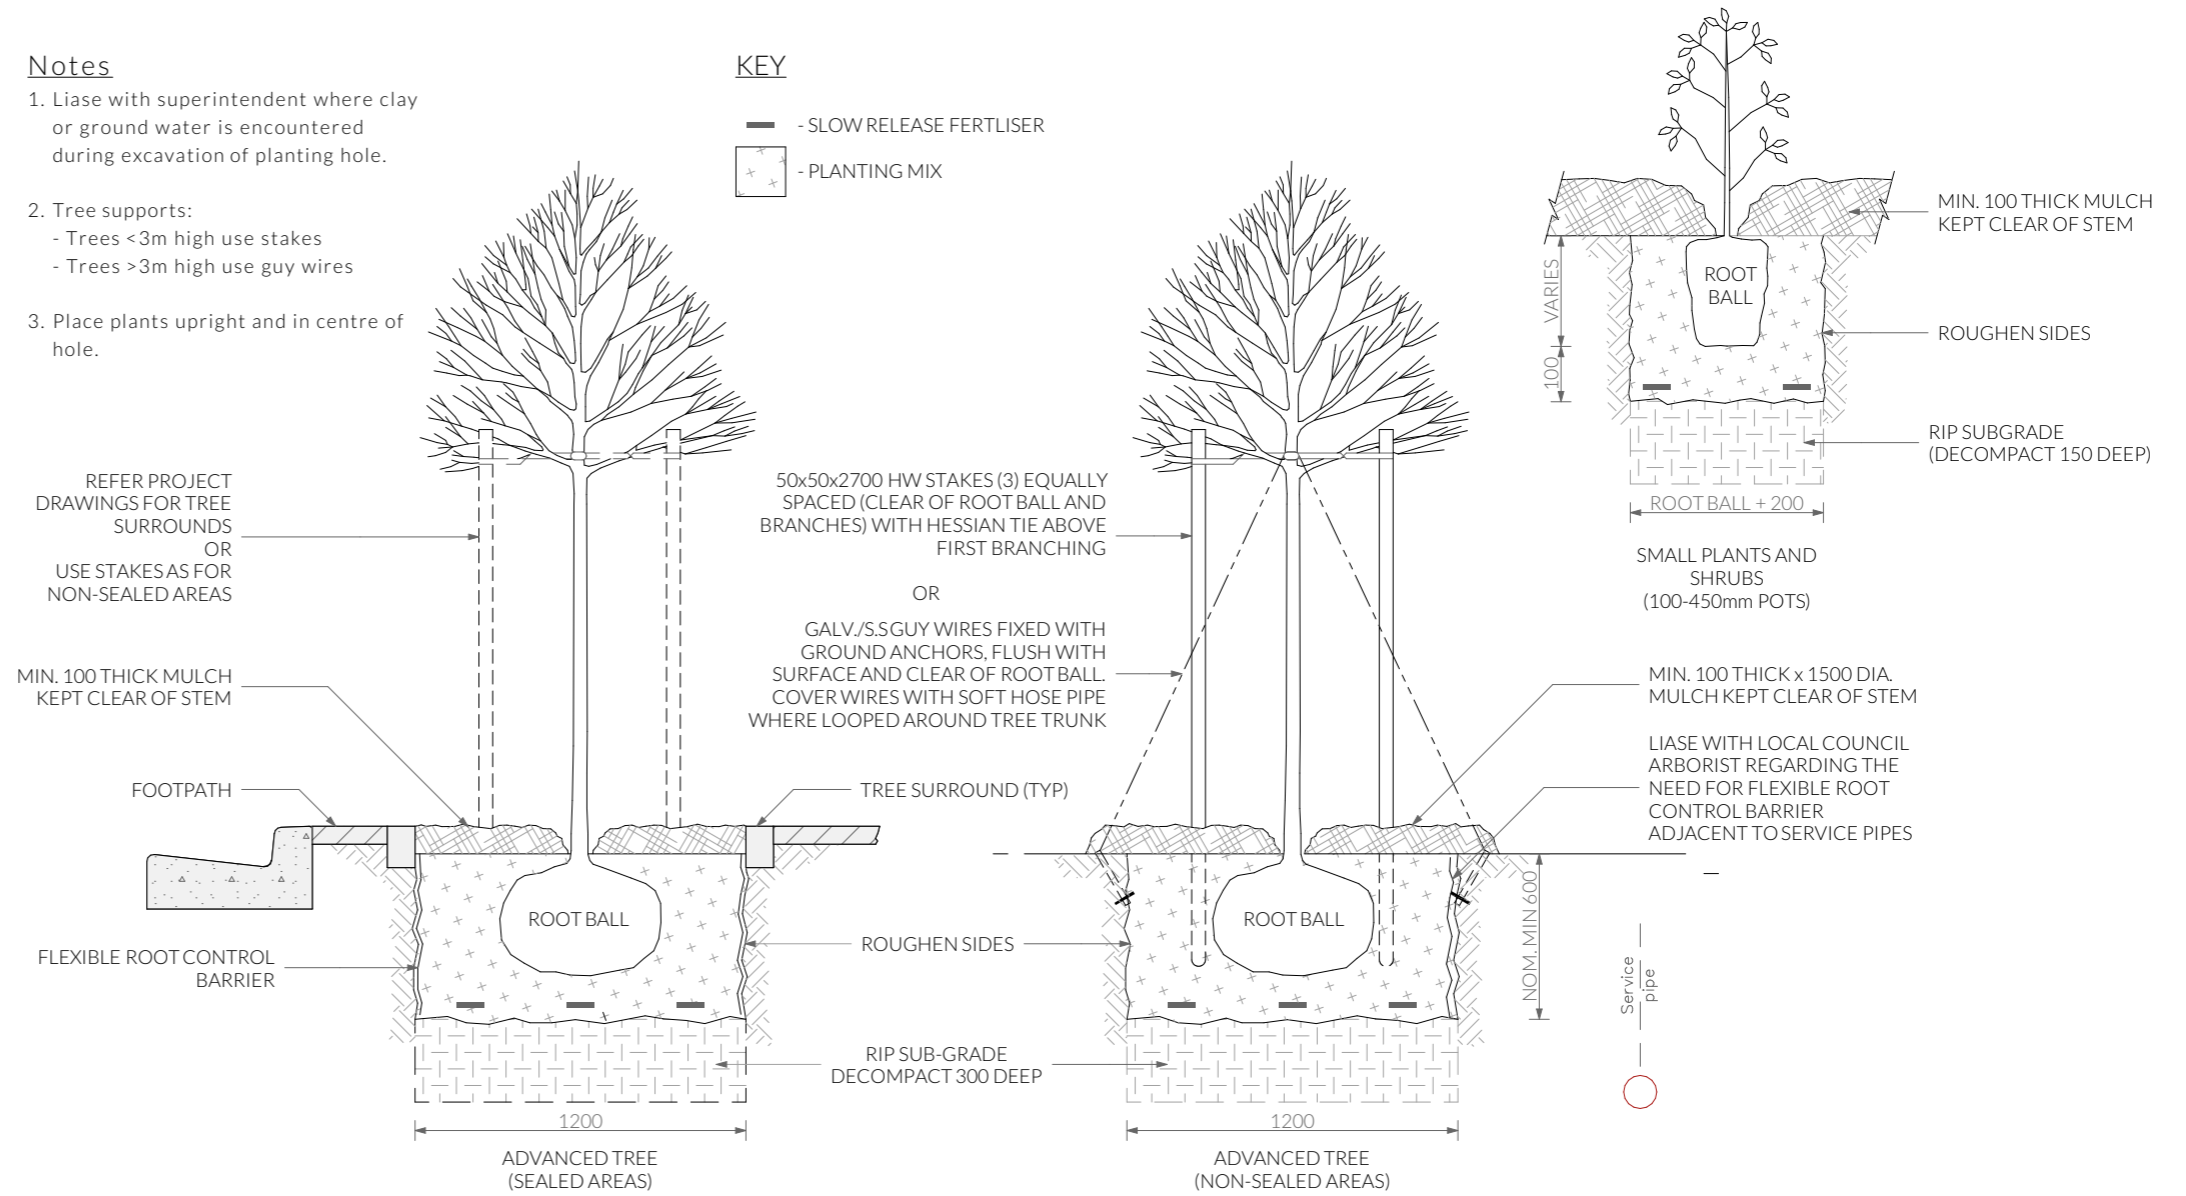

**Note**

Plants have been selected to be drought tolerant and low maintenance once established, it is recommended that a dripper system or similar be put into place until established. Plant locations are indicative and may be altered where suitable growing conditions cannot be met. Garden areas to be mulched with 75mm cover of selected mulch and plants are to be fertilised 6 monthly or where required until established. Garden edges are to be timber, steel, or brick. Plantings that are unsuccessful will be replaced where required.

**Tree and Shrub Planting**

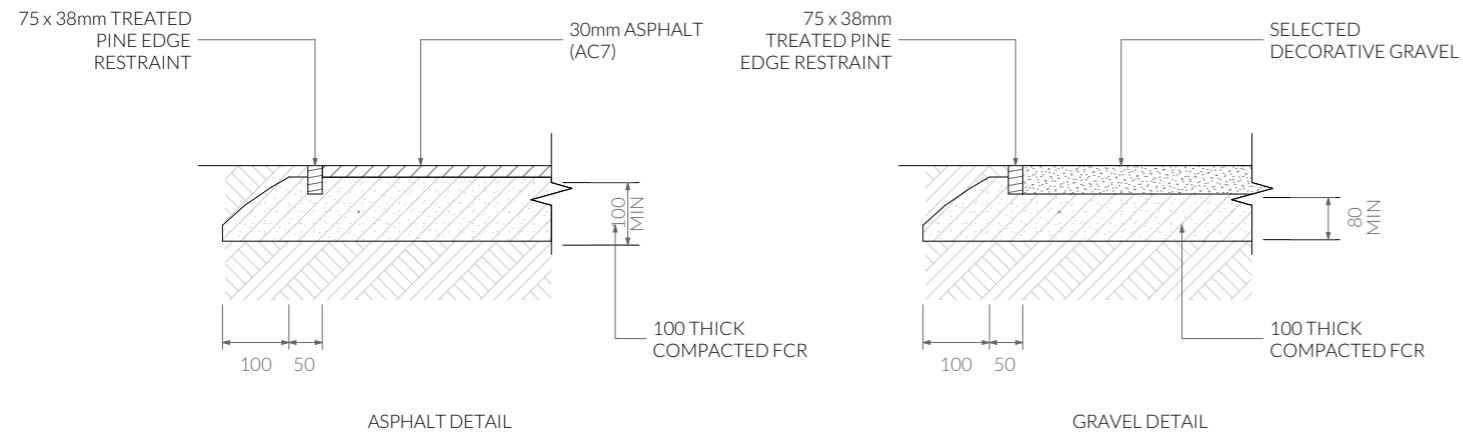

**Pavement Details**


1:20

NOT FOR CONSTRUCTION

	PINNACLE DRAFTING & DESIGN 7/3 Abernant Way, Cambridge 7170 03 6248 4218 admin@pinnacledrafting.com.au www.pinnacledrafting.com.au Licence: CC6073Y	<b>Planting Schedule &amp; Details</b>  Scale: @A3 Pg. No: L.02 Approved by: DA - 06 JRM	Proposal: Unit Development Client: Lyden Developments Address: 77 Fouche Avenue, Old Beach 7017	Date: 11/02/2026 Drawn by: MM Job No: 065-2023 Engineer: TBA Building Surveyor: LTBS	<table border="1"> <thead> <tr> <th>Issue</th> <th>Date</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>DA - 02</td> <td>21.02.2025</td> <td>Council RFI, add turning paths</td> </tr> <tr> <td>DA - 03</td> <td>14.03.2025</td> <td>TasWater RFI, relocate units 1,2,3</td> </tr> <tr> <td>DA - 04</td> <td>07.04.2025</td> <td>Council RFI, driveway and services</td> </tr> <tr> <td>DA - 05</td> <td>11.02.2026</td> <td>Revise plans to match civil design</td> </tr> <tr> <td>DA - 06</td> <td>07.04.2026</td> <td>Council RFI</td> </tr> </tbody> </table>	Issue	Date	Description	DA - 02	21.02.2025	Council RFI, add turning paths	DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3	DA - 04	07.04.2025	Council RFI, driveway and services	DA - 05	11.02.2026	Revise plans to match civil design	DA - 06	07.04.2026	Council RFI	These drawings are the property of Pinnacle Drafting & Design Pty Ltd, reproduction in whole or part is strictly forbidden without written consent. © 2026. These drawings are to be read in conjunction with all drawings and documentation by Engineers, Surveyors and any other consultants referred to within this drawing set as well as any Certificate of Likely Compliance and/or permit documentation. DO NOT SCALE FROM DRAWINGS. All Contractors are to verify dimensions on site before commencing any orders, works or requesting/producing shop drawings. ANY AND ALL DISCREPANCIES DISCOVERED BY OUTSIDE PARTIES ARE TO BE BROUGHT TO THE ATTENTION OF PINNACLE DRAFTING & DESIGN PTY LTD AS SOON AS PRACTICABLE. This document must be printed in colour. Pinnacle Drafting takes no responsibility for any errors, issues, or omissions caused by contractors and builders not following colour-printed plans.	 
	Issue	Date	Description																						
DA - 02	21.02.2025	Council RFI, add turning paths																							
DA - 03	14.03.2025	TasWater RFI, relocate units 1,2,3																							
DA - 04	07.04.2025	Council RFI, driveway and services																							
DA - 05	11.02.2026	Revise plans to match civil design																							
DA - 06	07.04.2026	Council RFI																							


**CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT  
77 FOUCHE AVENUE, OLD BEACH  
FOR LYDEN DEVELOPMENTS**

DRAWING No.	DRAWING TITLE
H25038-G01	LOCALITY PLAN & DRAWING INDEX
H25038-C01	OVERALL DRIVEWAY & SERVICES PLAN
H25038-C02	OVERALL SEWER & WATER SUPPLY PLAN
H25038-C03	ENLARGED DRIVEWAY & SERVICES PLAN
H25038-C04	PIPE LONG SECTIONS & TYPICAL PAVEMENT SECTION
H25038-C05	VEHICLE TURNING PATHS - SHEET 1 OF 2
H25038-C06	VEHICLE TURNING PATHS - SHEET 2 OF 2

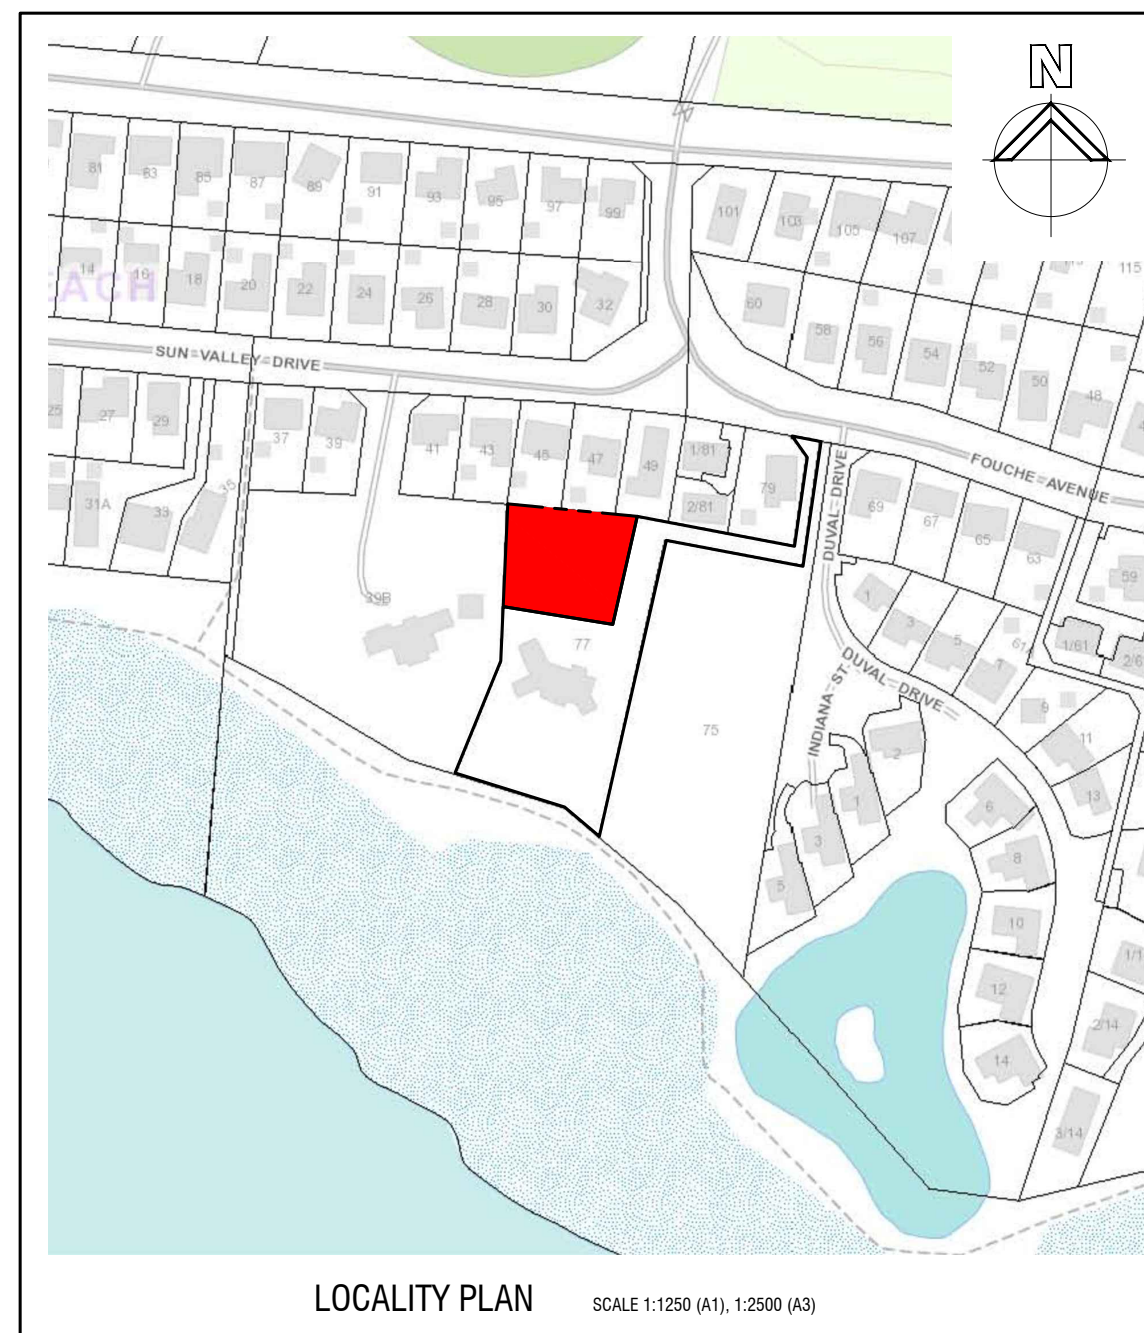

No.	Revision	Date	COPYRIGHT:	DESIGNED	DRAWN	CLIENT	DRAWING TITLE	DRG NO.	REV	
A	ISSUED FOR BUILDING APPROVAL	JAN 2026	*This document is and shall remain the property of Henry Design & Consulting. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission. Unauthorised use of this document is prohibited.*	PAH	PAH	LYDEN DEVELOPMENTS	CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT 77 FOUCHE AVENUE, OLD BEACH	H25038-G01	C	
B	AMENDED AS PER STORMWATER REPORT RECOMMENDATIONS	MAR 2026		CHECKED	APPROVED	PROJECT	77 FOUCHE AVENUE, OLD BEACH			
C	AMENDED TO BMC REQUIREMENTS	APR 2026		SCALE:	AS SHOWN	DATE:	JAN 2026	CAD FILE No:	77 FOUCHE AVE 03	SHEET OF

**Henry** design and consulting  
 ABN 91115 998 724  
 ACN 115 998 724  
 4 Fairisle Terrace  
 Howrah 7018 T.A.S.  
 E: phenny@netspace.net.au M: 0400 196 061

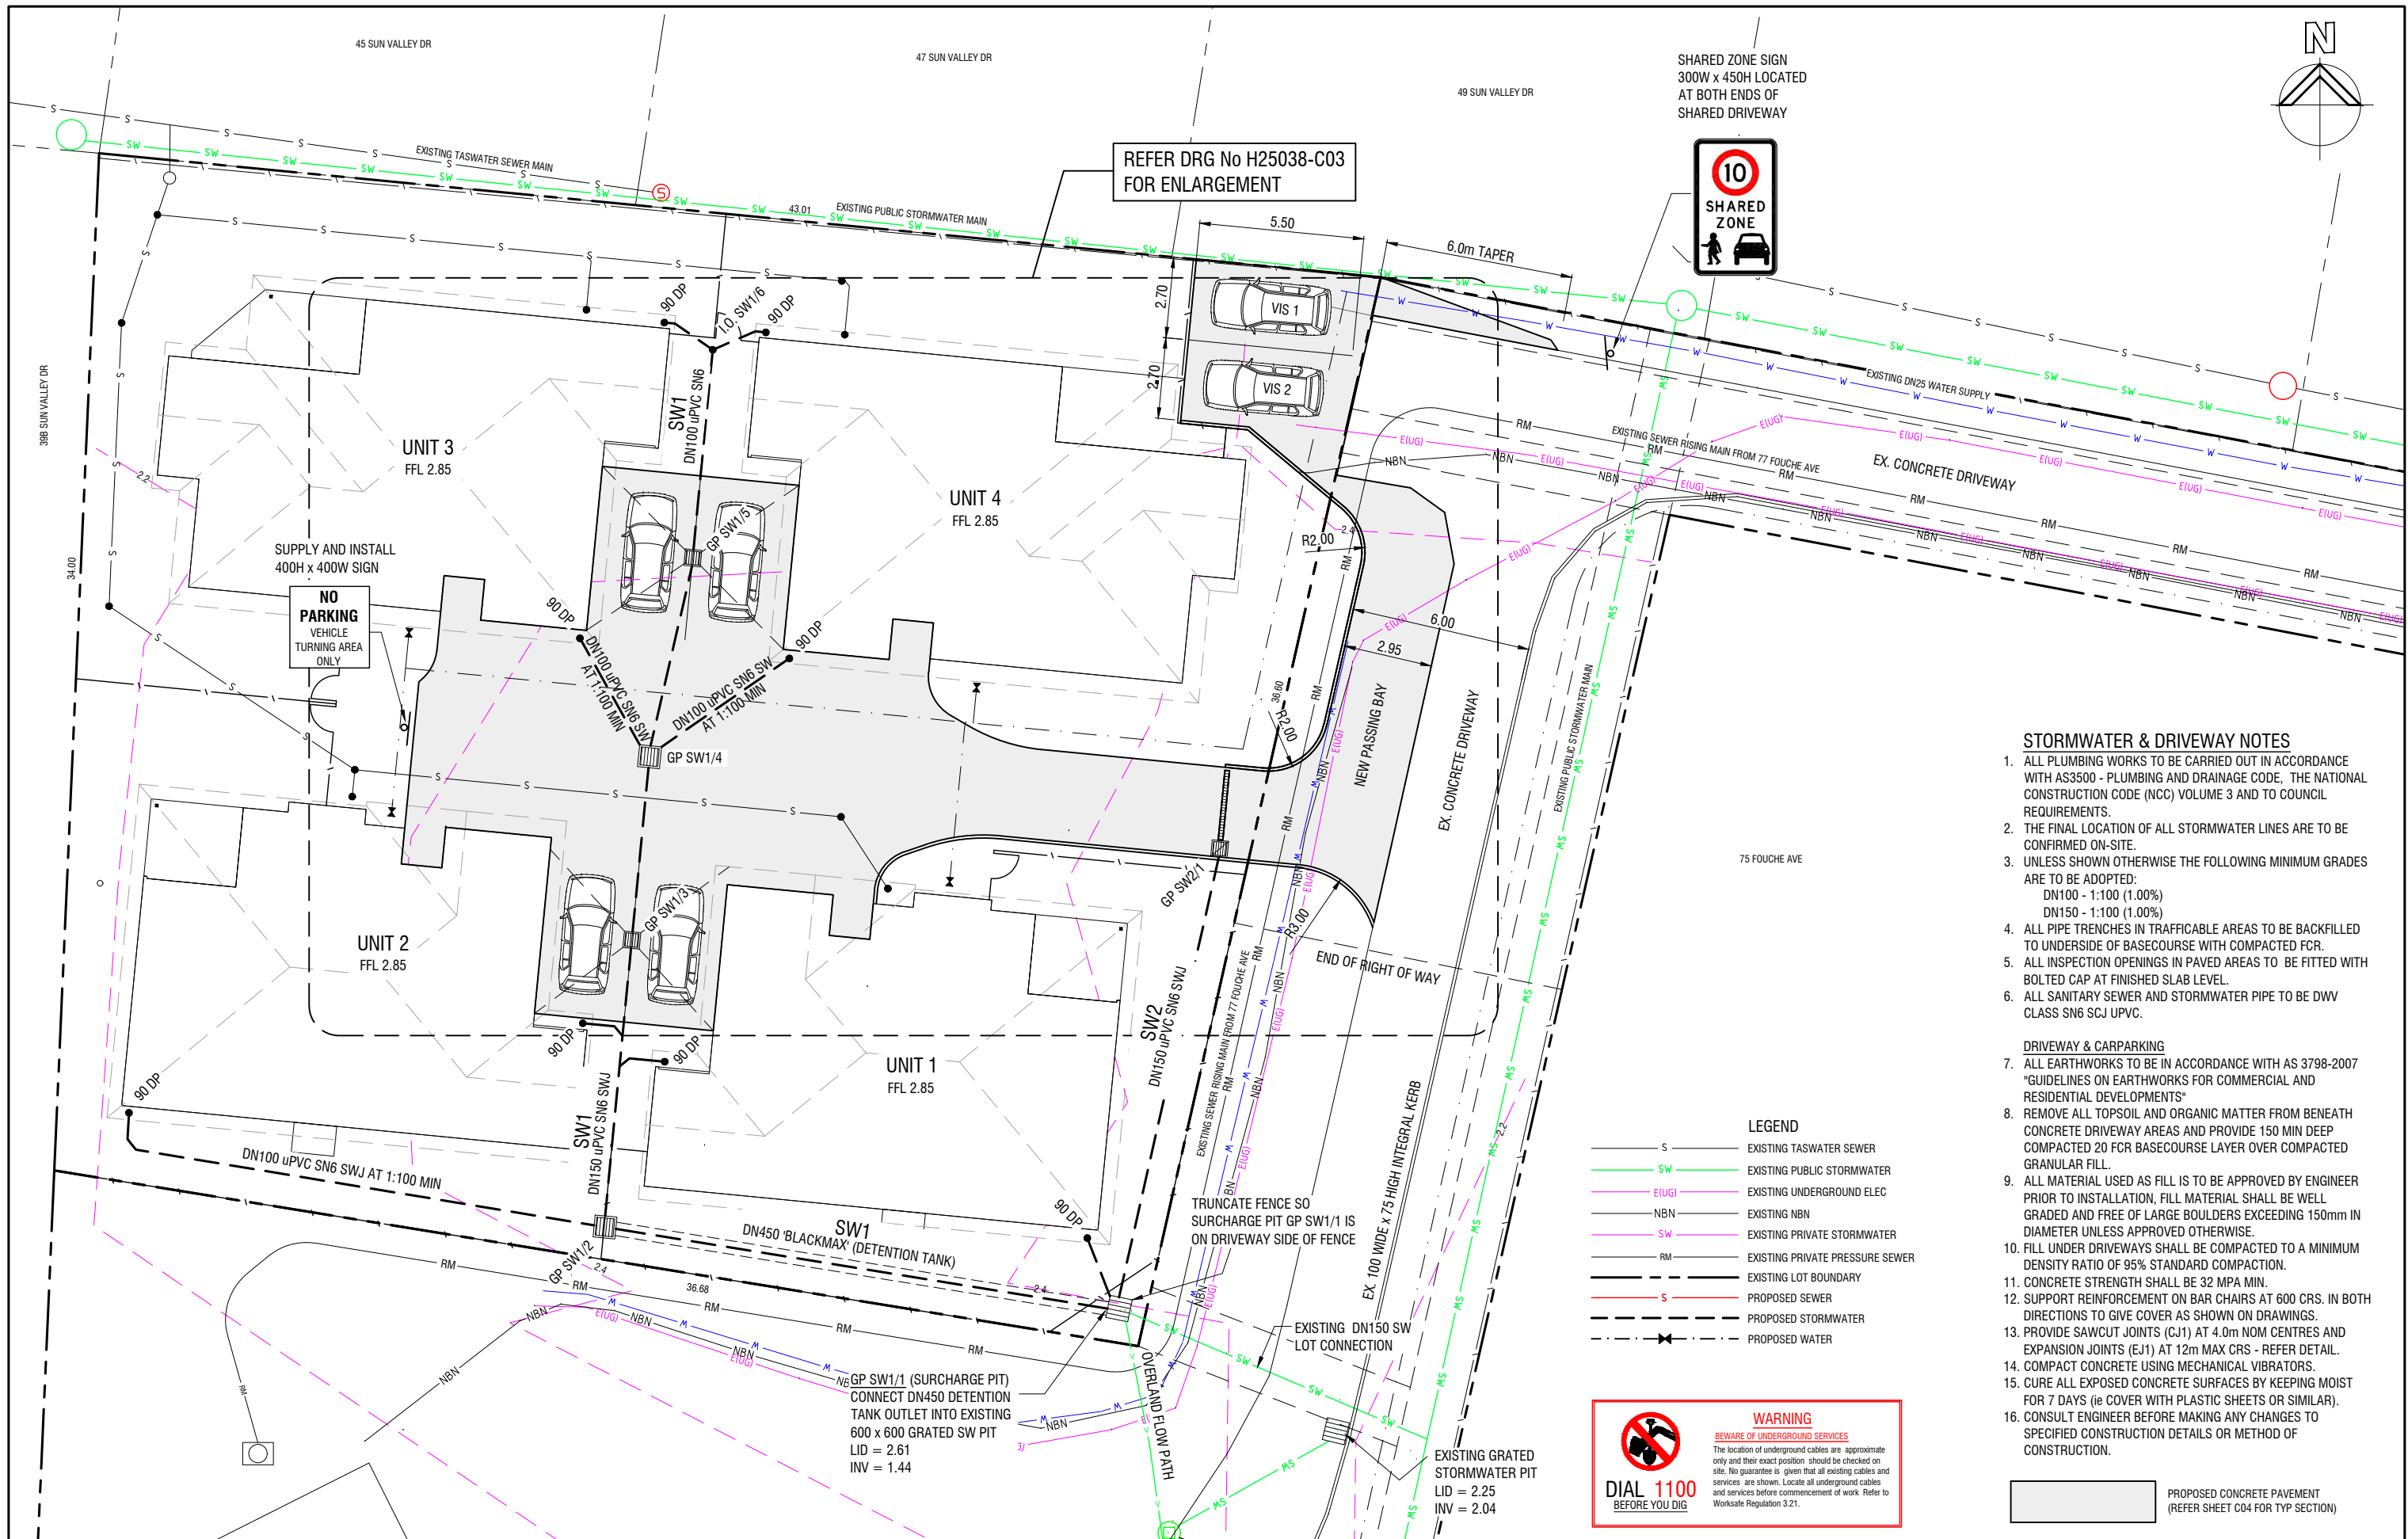

REFER DRG No H25038-C03 FOR ENLARGEMENT

SHARED ZONE SIGN  
300W x 450H LOCATED  
AT BOTH ENDS OF  
SHARED DRIVEWAY



**STORMWATER & DRIVEWAY NOTES**

1. ALL PLUMBING WORKS TO BE CARRIED OUT IN ACCORDANCE WITH AS3500 - PLUMBING AND DRAINAGE CODE, THE NATIONAL CONSTRUCTION CODE (NCC) VOLUME 3 AND TO COUNCIL REQUIREMENTS.
2. THE FINAL LOCATION OF ALL STORMWATER LINES ARE TO BE CONFIRMED ON-SITE.
3. UNLESS SHOWN OTHERWISE THE FOLLOWING MINIMUM GRADES ARE TO BE ADOPTED:  
DN100 - 1:100 (1.00%)  
DN150 - 1:100 (1.00%)
4. ALL PIPE TRENCHES IN TRAFFICABLE AREAS TO BE BACKFILLED TO UNDERSIDE OF BASECOURSE WITH COMPACTED FCR.
5. ALL INSPECTION OPENINGS IN PAVED AREAS TO BE FITTED WITH BOLTED CAP AT FINISHED SLAB LEVEL.
6. ALL SANITARY SEWER AND STORMWATER PIPE TO BE DWV CLASS SN6 SCJ UPVC.

**DRIVEWAY & CARPARKING**

7. ALL EARTHWORKS TO BE IN ACCORDANCE WITH AS 3798-2007 "GUIDELINES ON EARTHWORKS FOR COMMERCIAL AND RESIDENTIAL DEVELOPMENTS"
8. REMOVE ALL TOPSOIL AND ORGANIC MATTER FROM BENEATH CONCRETE DRIVEWAY AREAS AND PROVIDE 150 MIN DEEP COMPACTED 20 FCR BASECOURSE LAYER OVER COMPACTED GRANULAR FILL.
9. ALL MATERIAL USED AS FILL IS TO BE APPROVED BY ENGINEER PRIOR TO INSTALLATION, FILL MATERIAL SHALL BE WELL GRADED AND FREE OF LARGE BOULDERS EXCEEDING 150mm IN DIAMETER UNLESS APPROVED OTHERWISE.
10. FILL UNDER DRIVEWAYS SHALL BE COMPACTED TO A MINIMUM DENSITY RATIO OF 95% STANDARD COMPACTION.
11. CONCRETE STRENGTH SHALL BE 32 MPA MIN.
12. SUPPORT REINFORCEMENT ON BAR CHAIRS AT 600 CRS. IN BOTH DIRECTIONS TO GIVE COVER AS SHOWN ON DRAWINGS.
13. PROVIDE SAWCUT JOINTS (CJ1) AT 4.0m NOM CENTRES AND EXPANSION JOINTS (EJ1) AT 12m MAX CRS - REFER DETAIL.
14. COMPACT CONCRETE USING MECHANICAL VIBRATORS.
15. CURE ALL EXPOSED CONCRETE SURFACES BY KEEPING MOIST FOR 7 DAYS (ie COVER WITH PLASTIC SHEETS OR SIMILAR).
16. CONSULT ENGINEER BEFORE MAKING ANY CHANGES TO SPECIFIED CONSTRUCTION DETAILS OR METHOD OF CONSTRUCTION.

**LEGEND**



- S ——— EXISTING TASWATER SEWER
- SW ——— EXISTING PUBLIC STORMWATER
- (E)UG ——— EXISTING UNDERGROUND ELEC
- NBN ——— EXISTING NBN
- SW ——— EXISTING PRIVATE STORMWATER
- RM ——— EXISTING PRIVATE PRESSURE SEWER
- — — EXISTING LOT BOUNDARY
- S ——— PROPOSED SEWER
- SW ——— PROPOSED STORMWATER
- — — PROPOSED WATER

**WARNING**  
BEWARE OF UNDERGROUND SERVICES  
The location of underground cables are approximate only and their exact position should be checked on site. No guarantee is given that all existing cables and services are shown. Locate all underground cables and services before commencement of work. Refer to Worksafe Regulation 3.21.

**DIAL 1100**  
BEFORE YOU DIG

PROPOSED CONCRETE PAVEMENT  
(REFER SHEET C04 FOR TYP SECTION)

No.	Revision	Date	COPYRIGHT: "This document is and shall remain the property of Henry Design & Consulting. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission. Unauthorised use of this document is prohibited."		 ABN 91115 998 724 ACN 115 998 724 4 Fairisle Terrace Howrah 7018 TAS E: henry@netspace.net.au M: 0400 196 061	DESIGNED PAH	DRAWN PAH	CLIENT LYDEN DEVELOPMENTS	DRAWING TITLE CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT 77 FOUCHÉ AVENUE, OLD BEACH	DRG NO. H25038-C01	REV C
A	ISSUED FOR BUILDING APPROVAL	JAN 2026				CHECKED	APPROVED	PROJECT 77 FOUCHÉ AVENUE, OLD BEACH	OVERALL DRIVEWAY & SERVICES PLAN	SHEET OF	A1
B	AMENDED AS PER STORMWATER REPORT RECOMMENDATIONS	MAR 2026			SCALE: 1:100 (A1), 1:200 (A3)	DATE: JAN 2026	CAD FILE No: 77 FOUCHÉ AVE 03				
C	AMENDED TO BMC REQUIREMENTS	APR 2026									

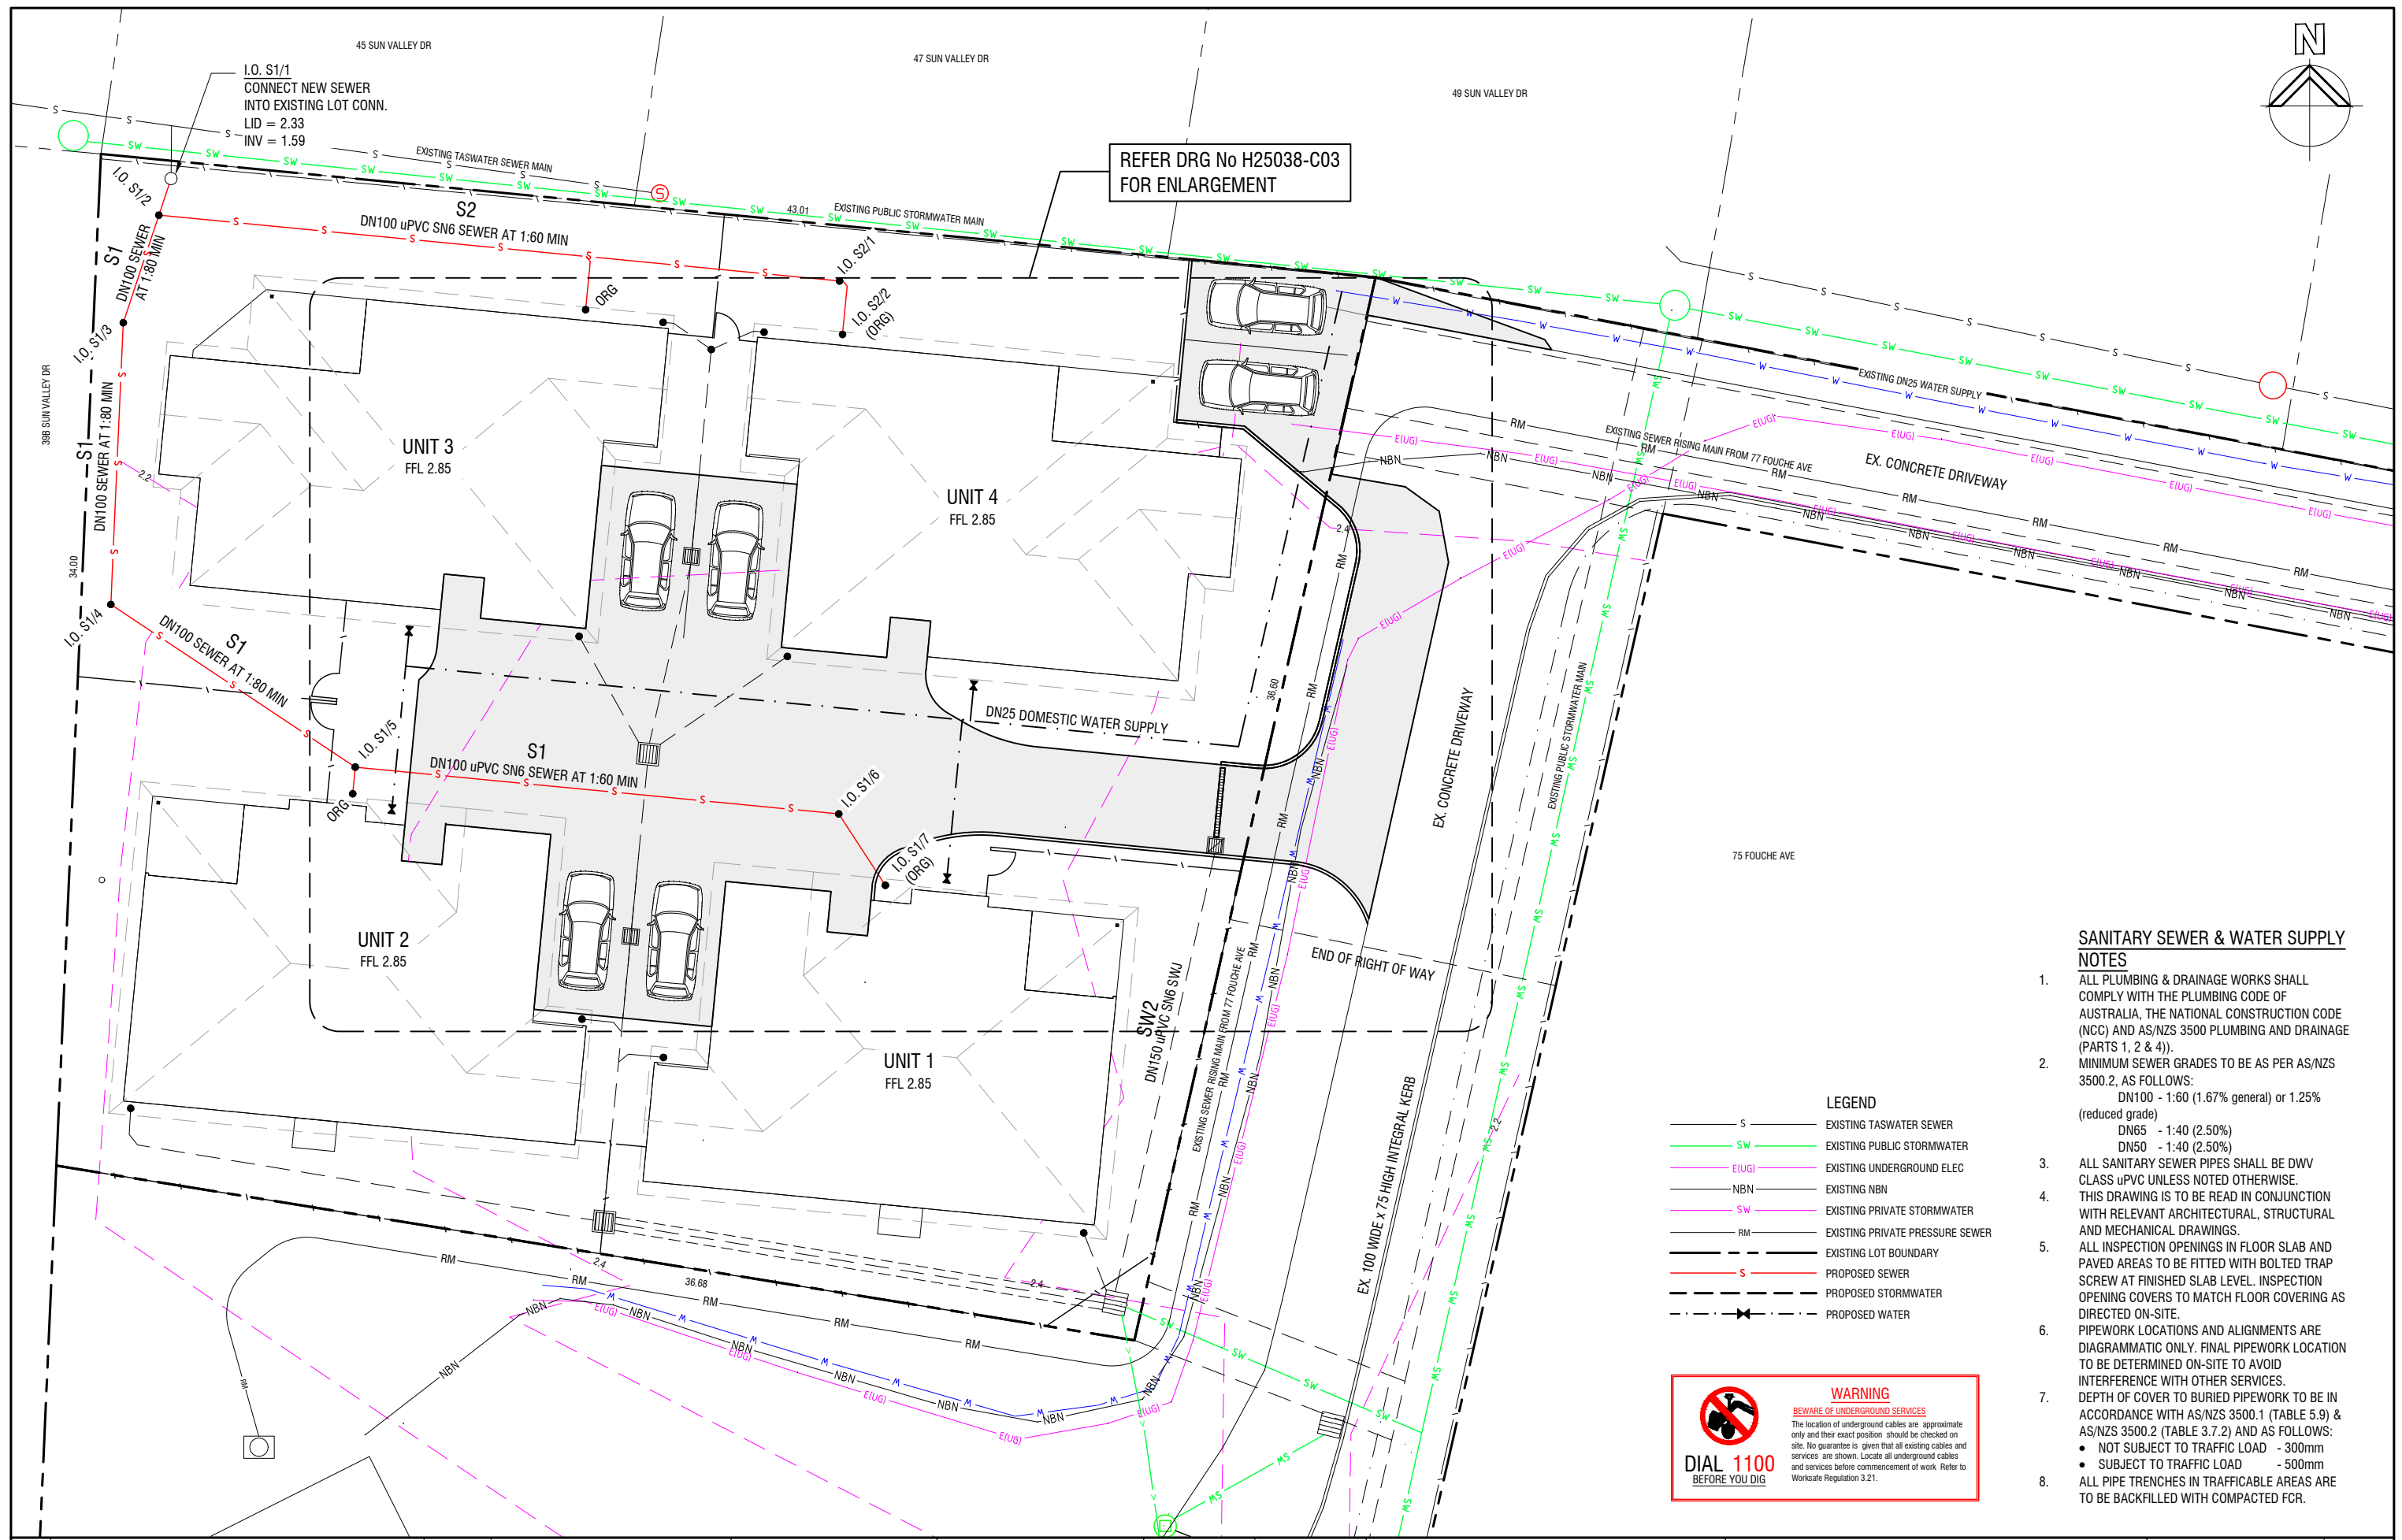

REFER DRG No H25038-C03  
FOR ENLARGEMENT

**SANITARY SEWER & WATER SUPPLY NOTES**

1. ALL PLUMBING & DRAINAGE WORKS SHALL COMPLY WITH THE PLUMBING CODE OF AUSTRALIA, THE NATIONAL CONSTRUCTION CODE (NCC) AND AS/NZS 3500 PLUMBING AND DRAINAGE (PARTS 1, 2 & 4).
2. MINIMUM SEWER GRADES TO BE AS PER AS/NZS 3500.2, AS FOLLOWS:  
DN100 - 1:60 (1.67% general) or 1.25% (reduced grade)  
DN65 - 1:40 (2.50%)  
DN50 - 1:40 (2.50%)
3. ALL SANITARY SEWER PIPES SHALL BE DWV CLASS uPVC UNLESS NOTED OTHERWISE. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL, STRUCTURAL AND MECHANICAL DRAWINGS.
5. ALL INSPECTION OPENINGS IN FLOOR SLAB AND PAVED AREAS TO BE FITTED WITH BOLTED TRAP SCREW AT FINISHED SLAB LEVEL. INSPECTION OPENING COVERS TO MATCH FLOOR COVERING AS DIRECTED ON-SITE.
6. PIPEWORK LOCATIONS AND ALIGNMENTS ARE DIAGRAMMATIC ONLY. FINAL PIPEWORK LOCATION TO BE DETERMINED ON-SITE TO AVOID INTERFERENCE WITH OTHER SERVICES.
7. DEPTH OF COVER TO BURIED PIPEWORK TO BE IN ACCORDANCE WITH AS/NZS 3500.1 (TABLE 5.9) & AS/NZS 3500.2 (TABLE 3.7.2) AND AS FOLLOWS:  
• NOT SUBJECT TO TRAFFIC LOAD - 300mm  
• SUBJECT TO TRAFFIC LOAD - 500mm
8. ALL PIPE TRENCHES IN TRAFFICABLE AREAS ARE TO BE BACKFILLED WITH COMPACTED FCR.

**LEGEND**

- S EXISTING TASWATER SEWER
- SW EXISTING PUBLIC STORMWATER
- E(UG) EXISTING UNDERGROUND ELEC
- NBN EXISTING NBN
- SW EXISTING PRIVATE STORMWATER
- RM EXISTING PRIVATE PRESSURE SEWER
- EXISTING LOT BOUNDARY
- S PROPOSED SEWER
- PROPOSED STORMWATER
- PROPOSED WATER

**WARNING**  
BEWARE OF UNDERGROUND SERVICES

The location of underground cables are approximate only and their exact position should be checked on site. No guarantee is given that all existing cables and services are shown. Locate all underground cables and services before commencement of work. Refer to Worksafe Regulation 3.21.

**DIAL 1100**  
BEFORE YOU DIG

No.	Revision	Date
A	ISSUED FOR BUILDING APPROVAL	JAN 2026
B	AMENDED AS PER STORMWATER REPORT RECOMMENDATIONS	MAR 2026
C	AMENDED TO BMC REQUIREMENTS	APR 2026

**COPYRIGHT:**  
This document is and shall remain the property of Henry Design & Consulting. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission. Unauthorised use of this document is prohibited.


**Henry** design and consulting  
 ABN 91115 998 724  
 ACN 115 998 724  
 4 Fairisle Terrace  
 Howrah 7018 TAS  
 E: phenny@netspace.net.au M: 0400 196 061

DESIGNED PAH	DRAWN PAH	CLIENT LYDEN DEVELOPMENTS
CHECKED	APPROVED	PROJECT 77 FOUCHE AVENUE, OLD BEACH
SCALE: 1:100 (A1), 1:200 (A3)		DATE: JAN 2026
		CAD FILE No: 77 FOUCHE AVE 03

DRAWING TITLE CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT 77 FOUCHE AVENUE, OLD BEACH	DRG NO. H25038-C02	REV C
OVERALL SEWER & WATER SUPPLY PLAN	SHEET OF	A1



No.	Revision	Date	<b>COPYRIGHT:</b> This document is and shall remain the property of Henry Design & Consulting. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission. Unauthorised use of this document is prohibited.	 ABN 91115 998 724 ACN 115 998 724 4 Fairisle Terrace Howrah 7018 TAS E: phenny@netspace.net.au M: 0400 196 061	DESIGNED	DRAWN	CLIENT	<b>DRAWING TITLE</b> CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT 77 FOUCHE AVENUE, OLD BEACH  ENLARGED DRIVEWAY & SERVICES PLAN	DRG NO.	REV
A	ISSUED FOR BUILDING APPROVAL	JAN 2026			PAH	PAH	LYDEN DEVELOPMENTS		H25038-C03	C
B	AMENDED AS PER STORMWATER REPORT RECOMMENDATIONS	MAR 2026			CHECKED	APPROVED	PROJECT			
C	AMENDED TO BMC REQUIREMENTS	APR 2026	SCALE:	DATE:	CAD FILE No:		SHEET OF	A1		
			1:50 (A1), 1:100 (A3)	JAN 2026	77 FOUCHE AVE 03					

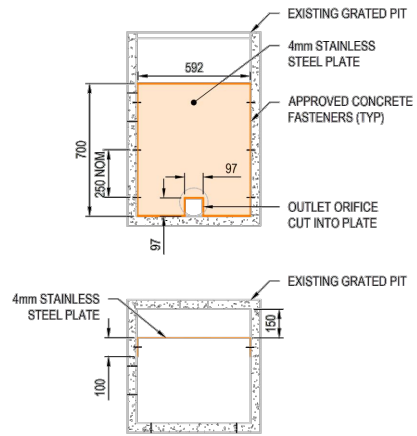


STAINLESS STEEL BAFFLE DETAILS


EXISTING GRATED SW PIT GP SW1/1

STORMWATER PIT SCHEDULE


PIT No.	PIT TYPE	PIT CLASS
EX GP SW1/1 (SURCHARGE PIT)	600 x 600 GRATED	EXISTING
GP SW1/2	600 x 600 GRATED	NON TRAFFICABLE
GP SW1/3	450 x 450 GRATED	CLASS 'B' TRAFFICABLE
GP SW1/4	600 x 600 GRATED	
GP SW1/5	450 x 450 GRATED	
GP SW2/1		

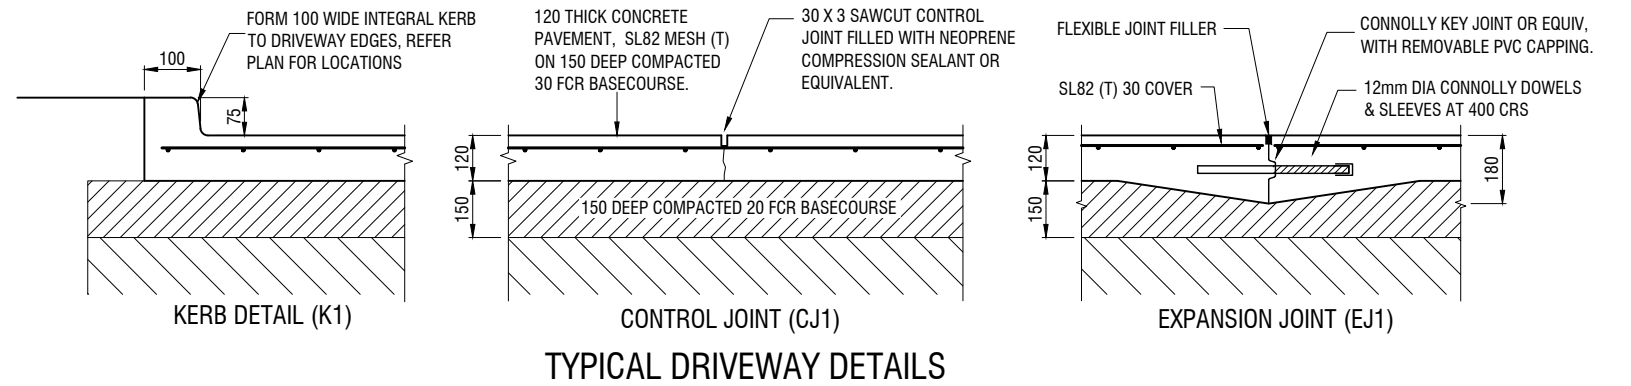


TYPICAL DRIVEWAY DETAILS

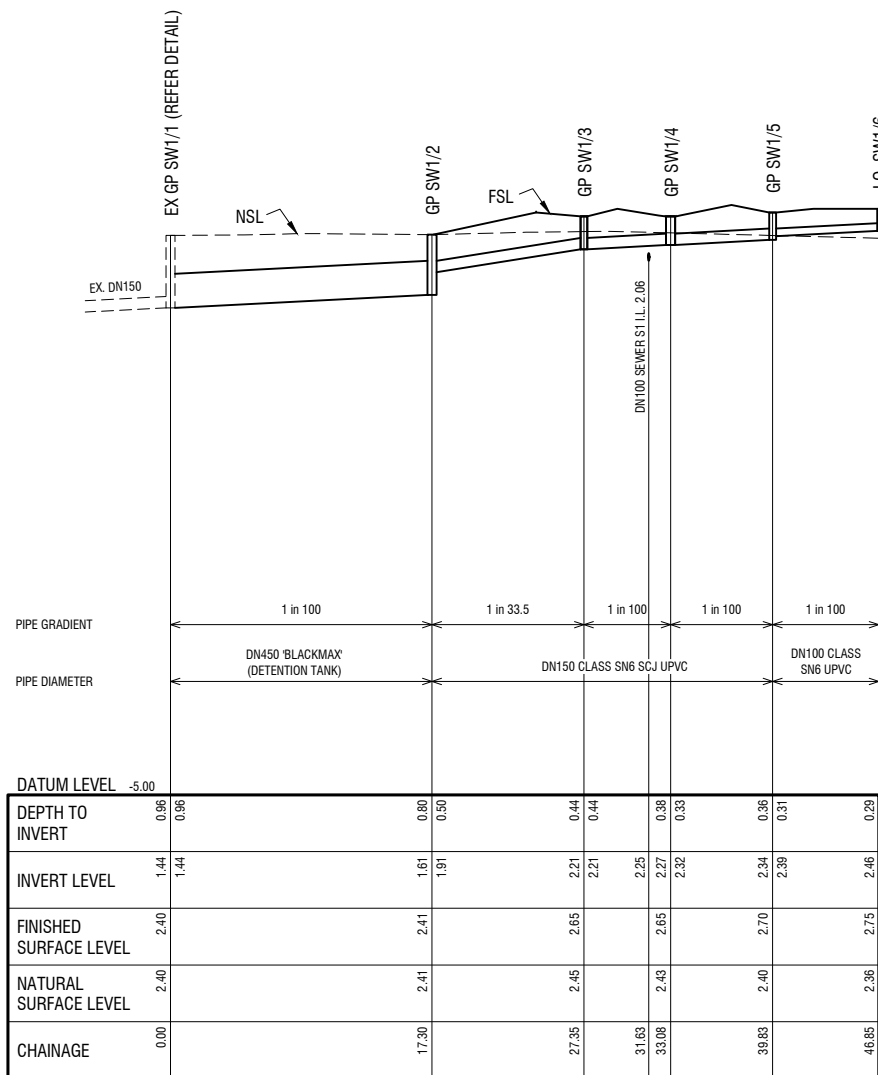


LONGITUDINAL SECTION - SW1  
HORIZONTAL SCALE 1:250  
VERTICAL SCALE 1:50

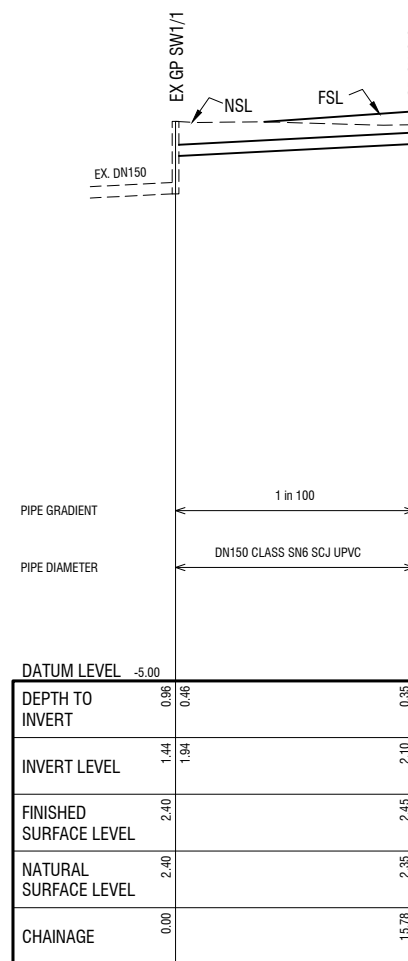

LONGITUDINAL SECTION - SW2  
HORIZONTAL SCALE 1:250  
VERTICAL SCALE 1:50




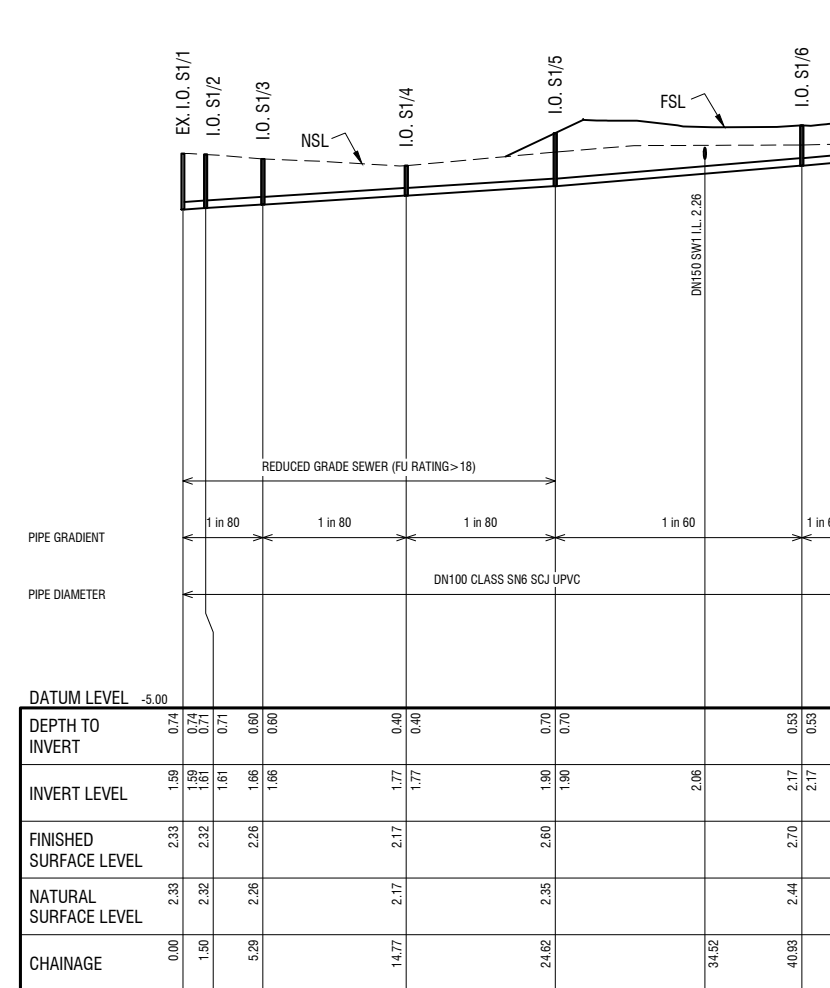


LONGITUDINAL SECTION - S1  
HORIZONTAL SCALE 1:250  
VERTICAL SCALE 1:50

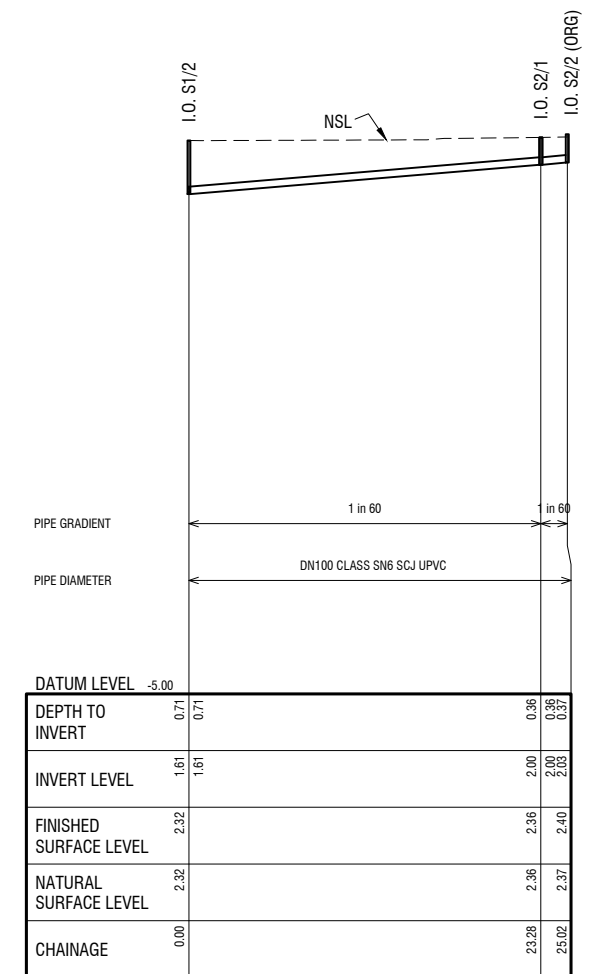


LONGITUDINAL SECTION - S2  
HORIZONTAL SCALE 1:250  
VERTICAL SCALE 1:50





No.	Revision	Date	COPYRIGHT:			DESIGNED	DRAWN	CLIENT	DRAWING TITLE		DRG NO.	REV
A	ISSUED FOR BUILDING APPROVAL	JAN 2026	This document is and shall remain the property of Henry Design & Consulting. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission. Unauthorised use of this document is prohibited.			PAH	PAH	LYDEN DEVELOPMENTS	CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT		H25038-C04	C
B	AMENDED AS PER STORMWATER REPORT RECOMMENDATIONS	MAR 2026						CHECKED	APPROVED	PROJECT		
C	AMENDED TO BMC REQUIREMENTS	APR 2026				ABN 91115 998 724 ACN 115 998 724 4 Fairisle Terrace Howrah 7018 TAS E: phenny@netspace.net.au M: 0400 196 061		SCALE:	DATE:	CAD FILE No:	PIPE LONG SECTIONS & TYP PAVEMENT SECTION	

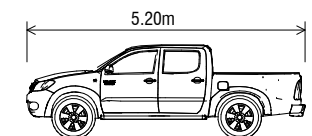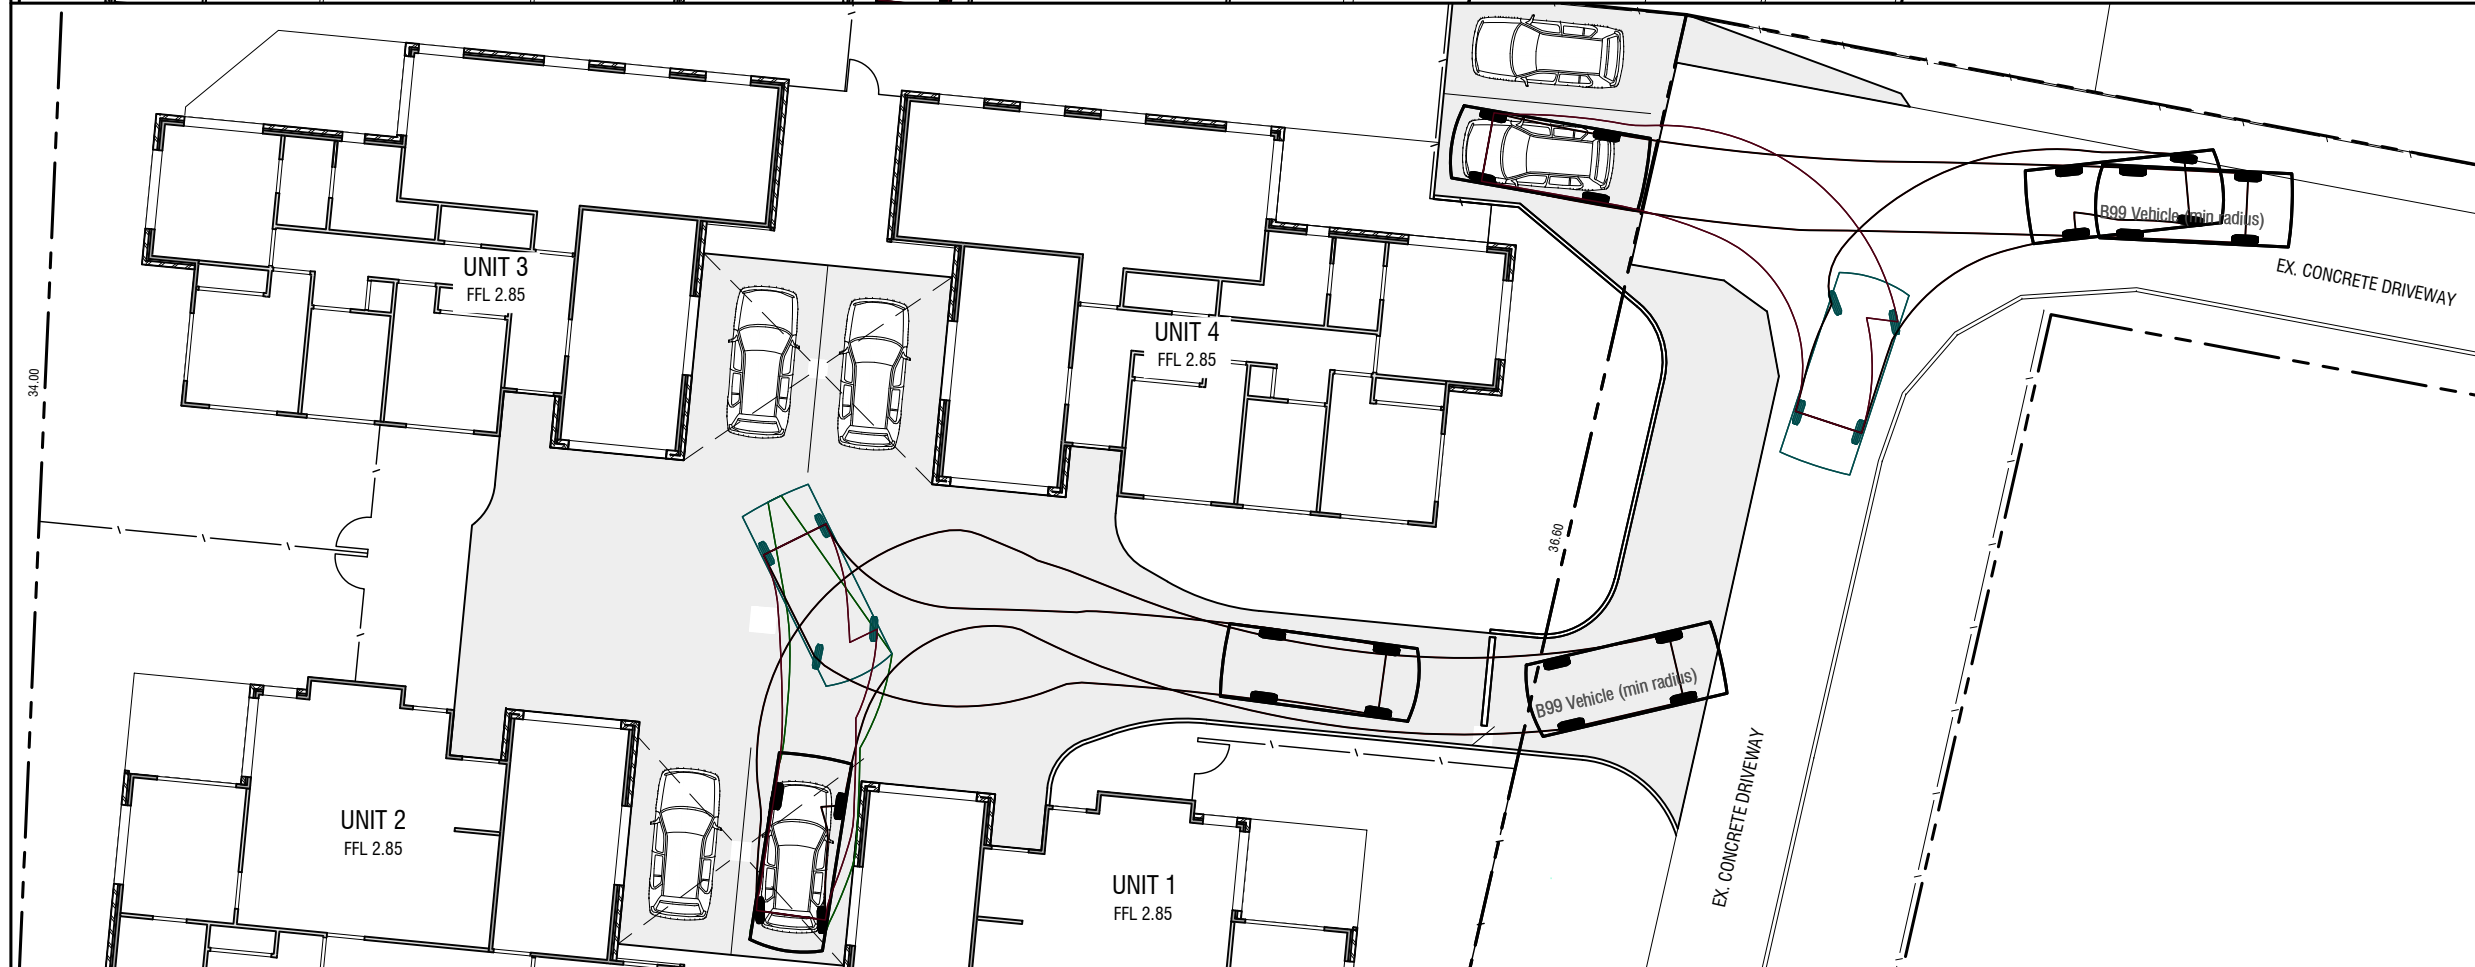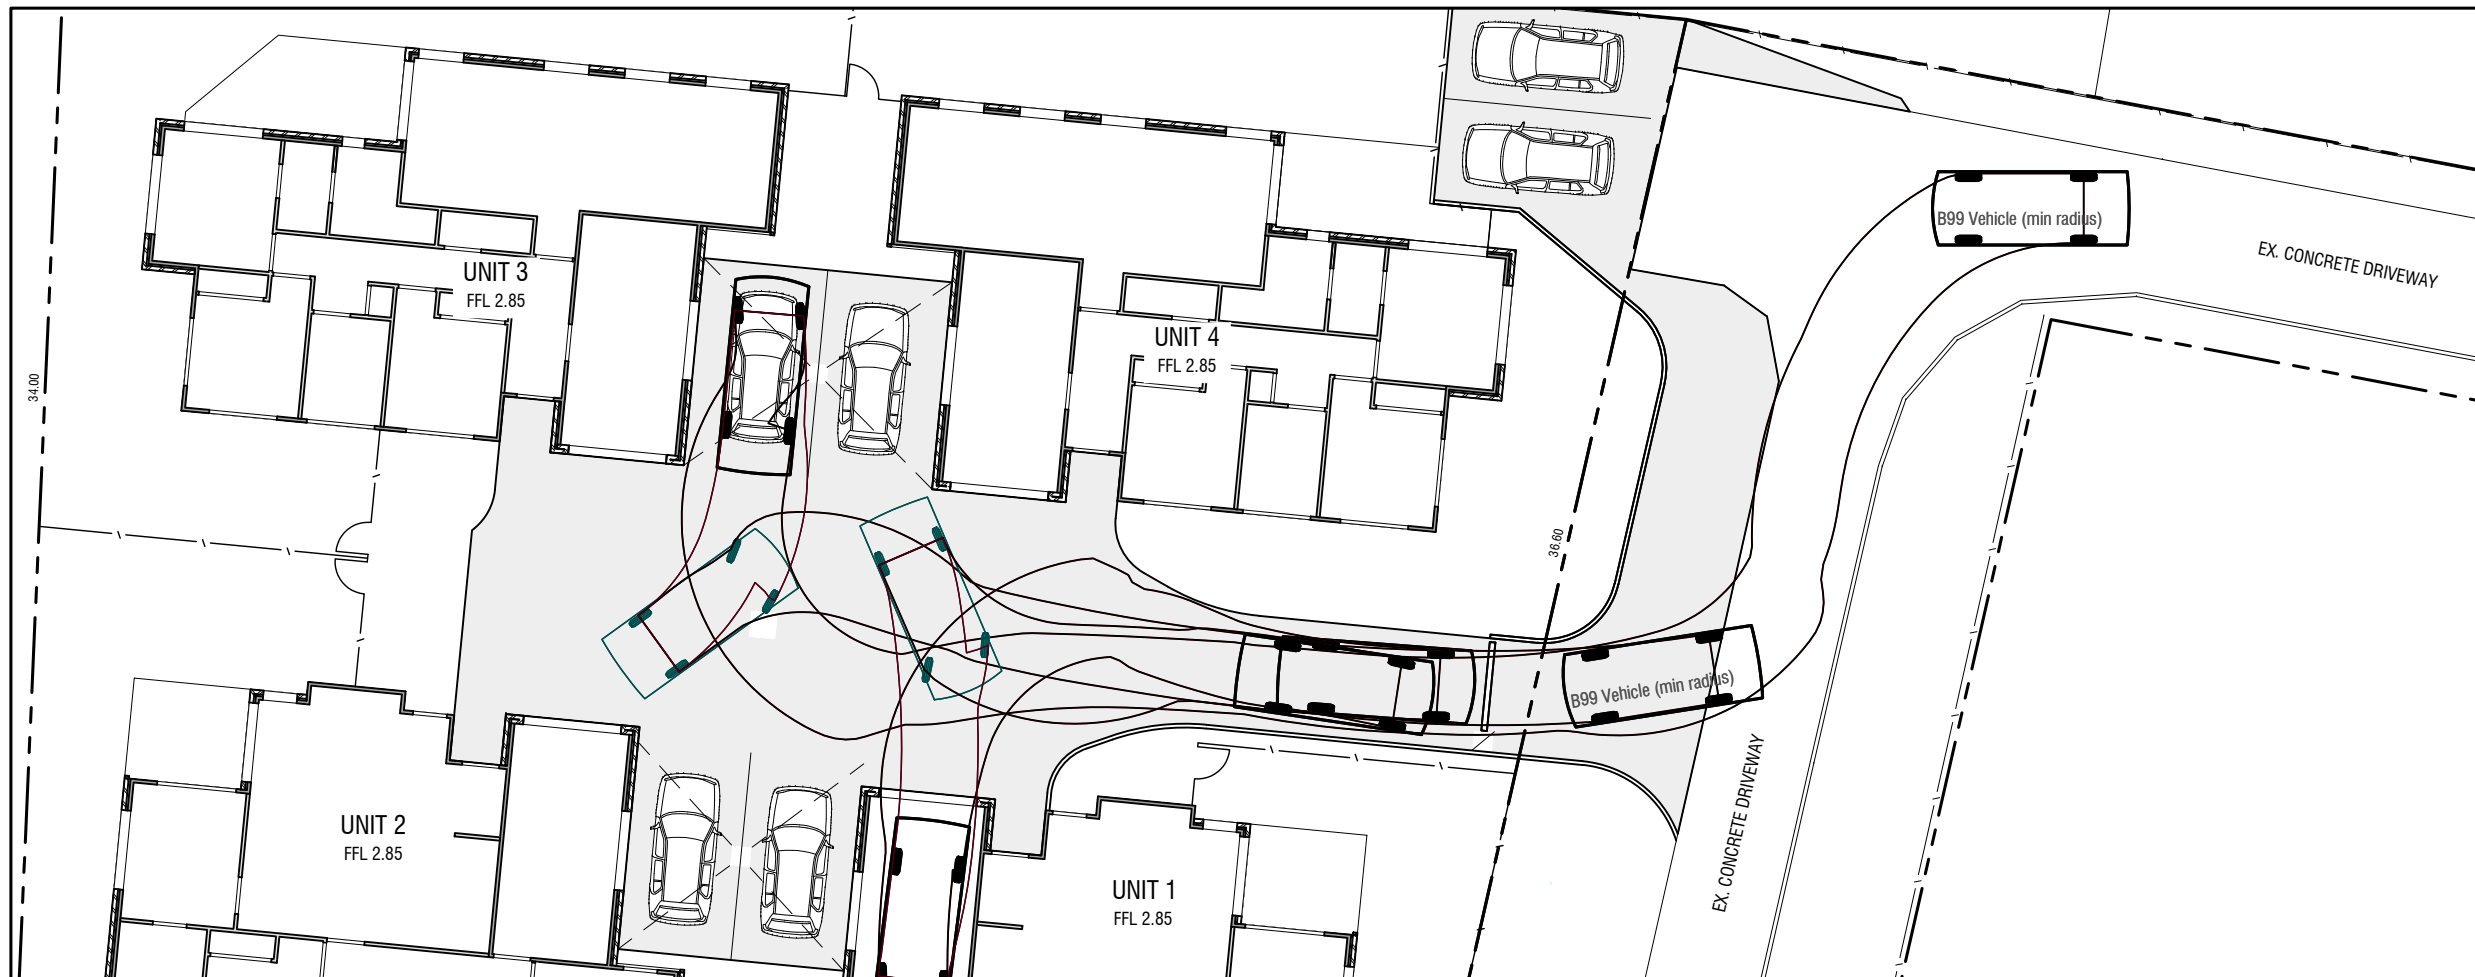

**DESIGN VEHICLE**  
B99 VEHICLE (TO AS2890.1)

OVERALL LENGTH	5.20m
OVERALL WIDTH	1.94m
TRACK WIDTH	1.84m
LOCK TO LOCK TIME	4.00sec
KERB TO KERB TURNING RADIUS	6.25m

No.	Revision	Date	<b>COPYRIGHT:</b> *This document is and shall remain the property of Henry Design & Consulting. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission. Unauthorised use of this document is prohibited.*	 ABN 91115 998 724 ACN 115 998 724 4 Fairisle Terrace Howrah 7018 TAS E: phenny@netspace.net.au M: 0400 196 061	DESIGNED PAH	DRAWN PAH	CLIENT LYDEN DEVELOPMENTS	DRAWING TITLE CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT 77 FOCHE AVENUE, OLD BEACH	DRG NO.	REV
	A	ISSUED FOR BUILDING APPROVAL			JAN 2026	CHECKED	APPROVED		PROJECT 77 FOCHE AVENUE, OLD BEACH	H25038-C05
B	AMENDED AS PER STORMWATER REPORT RECOMMENDATIONS	MAR 2026			SCALE: 1:100 (A1), 1:200 (A3)	DATE: JAN 2026	CAD FILE No: 77 FOCHE AVE 03	VEHICLE TURNING PATHS - SHEET 1 OF 2	SHEET OF	A1
C	AMENDED TO BMC REQUIREMENTS	APR 2026								

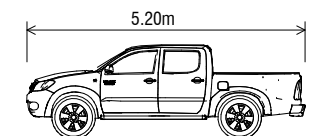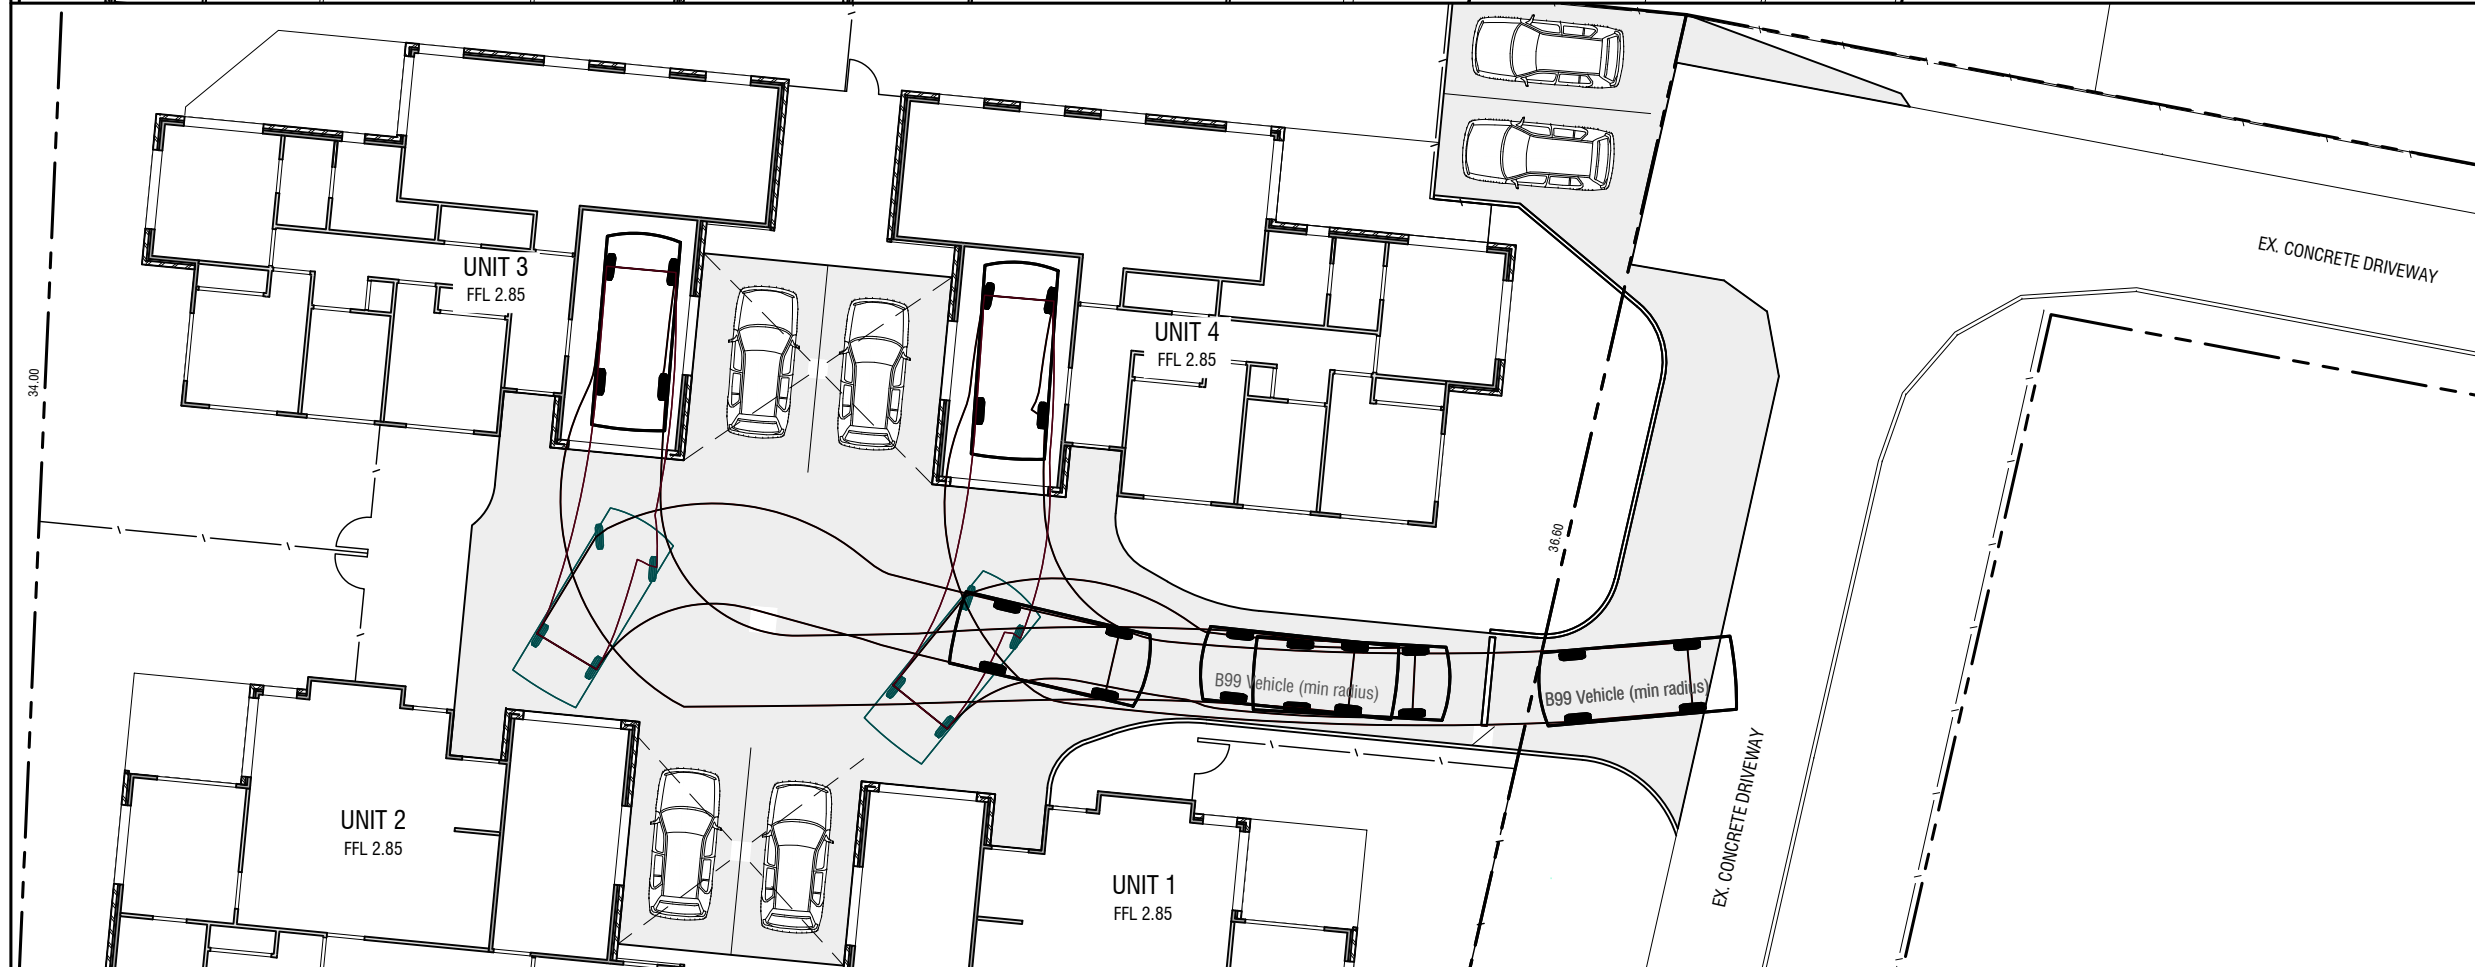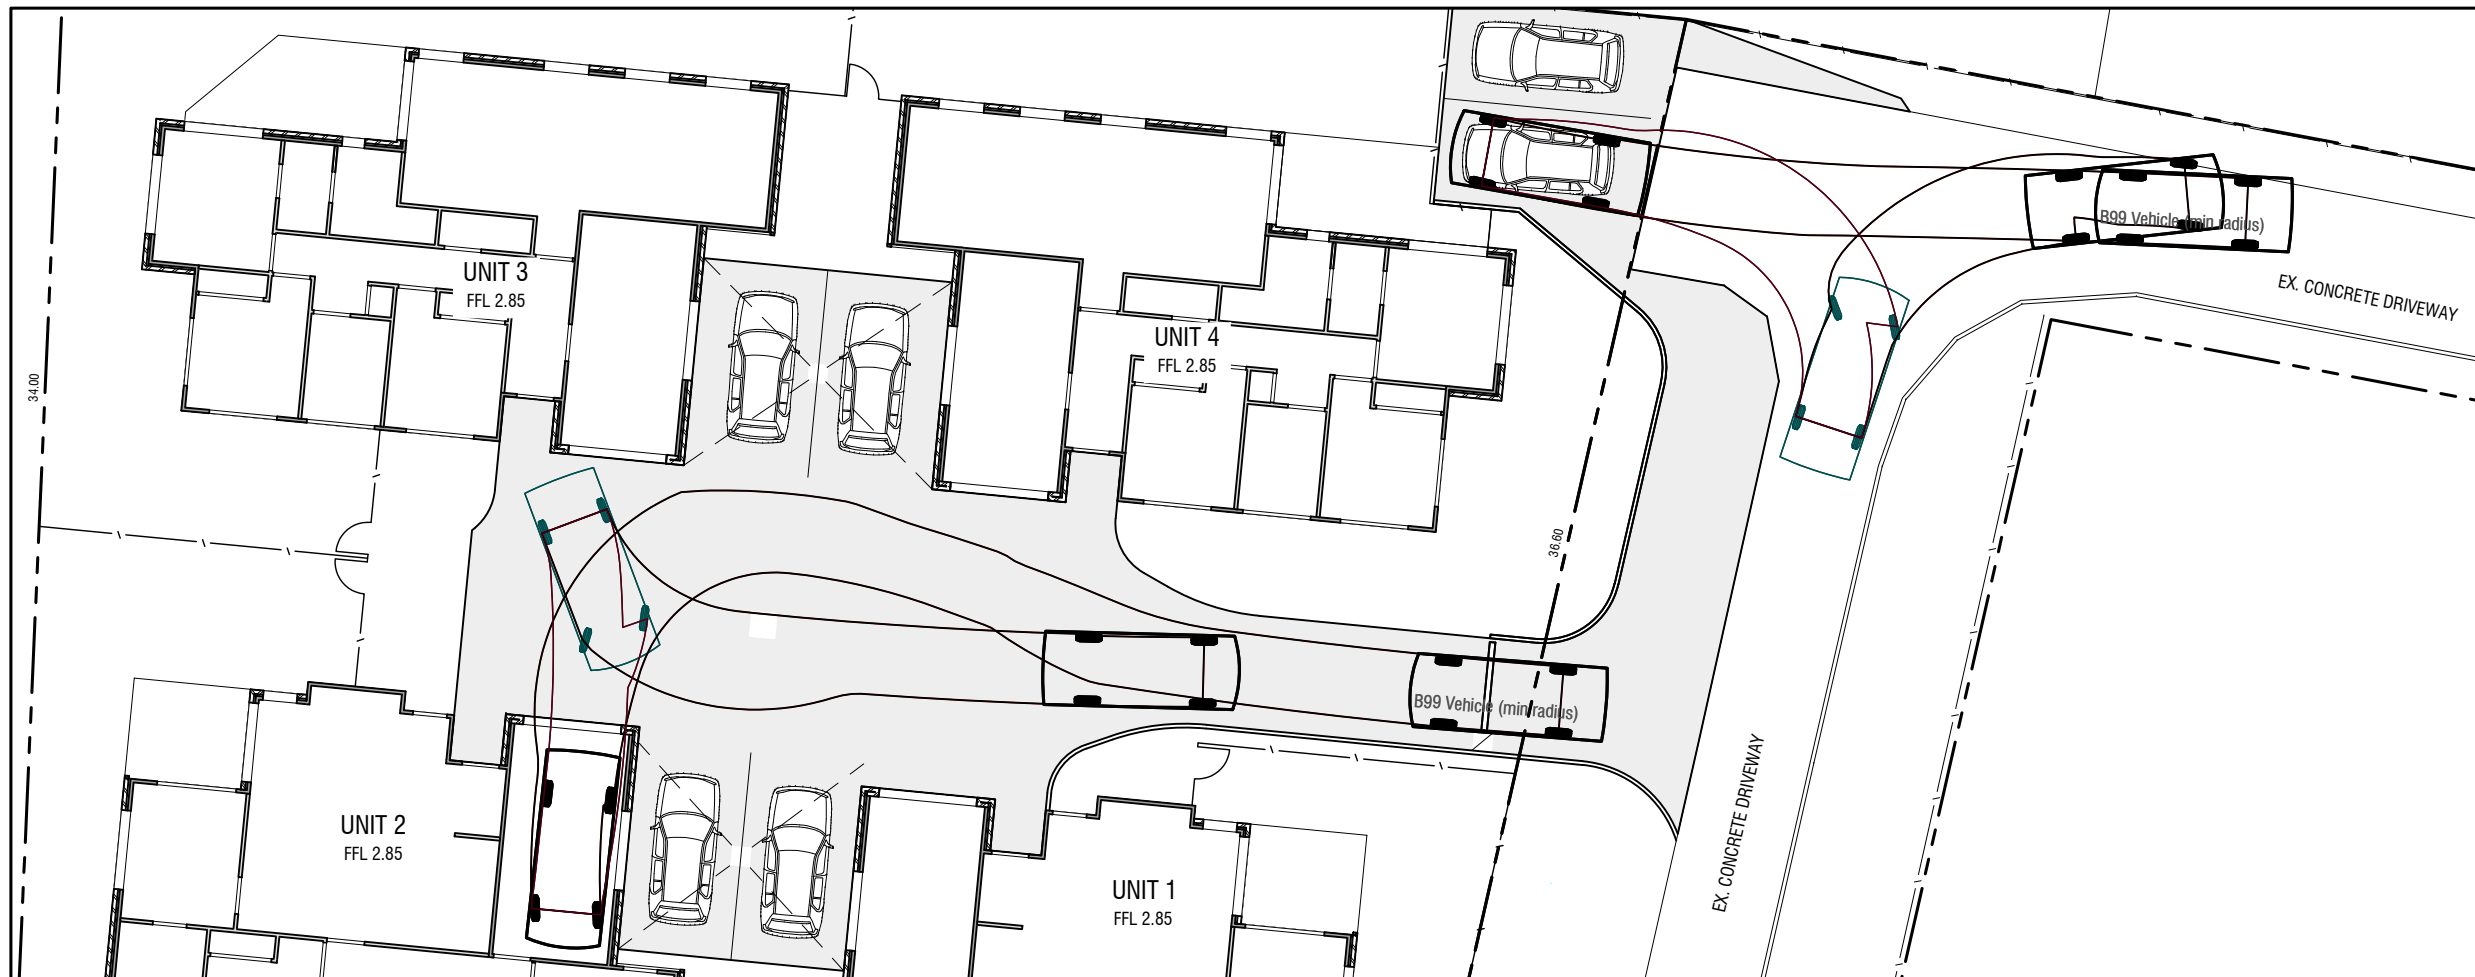

**DESIGN VEHICLE**  
B99 VEHICLE (TO AS2890.1)

OVERALL LENGTH	5.20m
OVERALL WIDTH	1.94m
TRACK WIDTH	1.84m
LOCK TO LOCK TIME	4.00sec
KERB TO KERB TURNING RADIUS	6.25m

No.	Revision	Date	<b>COPYRIGHT:</b> *This document is and shall remain the property of Henry Design & Consulting. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission. Unauthorised use of this document is prohibited.*	 ABN 91115 998 724 ACN 115 998 724 4 Fairisle Terrace Howrah 7018 TAS E: phenny@netspace.net.au M: 0400 196 061	DESIGNED PAH	DRAWN PAH	CLIENT LYDEN DEVELOPMENTS	DRAWING TITLE CIVILWORKS FOR PROPOSED UNIT DEVELOPMENT 77 FOUCHE AVENUE, OLD BEACH	DRG NO.	REV	
	A	ISSUED FOR BUILDING APPROVAL			JAN 2026	CHECKED	APPROVED		PROJECT 77 FOUCHE AVENUE, OLD BEACH	H25038-C05	C
	B	AMENDED AS PER STORMWATER REPORT RECOMMENDATIONS			MAR 2026	SCALE: 1:100 (A1), 1:200 (A3)	DATE: JAN 2026		CAD FILE No: 77 FOUCHE AVE 03	VEHICLE TURNING PATHS - SHEET 2 OF 2	SHEET OF
C	AMENDED TO BMC REQUIREMENTS	APR 2026									

# STORMWATER MANAGEMENT REPORT

77A Fouche Avenue, Old Beach

Prepared on behalf of Pinnacle Drafting

April 2026



ABN 87 648 234 975

1300 746 466  
hello@Pinionadvisory.com  
Pinionadvisory.com

#### Office locations

##### SA

Adelaide  
Clare  
Freeling  
Naracoorte

##### TAS

Devonport  
Hobart  
Launceston

##### VIC

Bright  
Mildura

##### QLD

Beenleigh  
Wondai

##### NSW

Dubbo  
Sydney

#### Author

Thomas Males  
Engineer

#### Project team

Water

#### Document status

Rev B

Date	Revision	Reason for revision	Reviewed by	Authorised by
10 April 2026	B	For Approval	R. Hunt	B. Nadler
26 February 2026	A	For Approval	R. Hunt	B. Nadler

#### DISCLAIMER

This report has been prepared in accordance with the scope of services described in the contract or agreement between Pinion Advisory and the Client. Any findings, conclusions or recommendations only apply to the aforementioned circumstances, and no greater reliance should be assumed or drawn by the Client. Furthermore, the report has been prepared solely for use by the Client and Pinion Advisory accepts no responsibility for its use by other parties.

# Contents

1	Introduction	4
2	Design Standards	4
3	Stormwater Quantity Design	5
3.1	Predevelopment Site	5
3.2	Post Development Site	6
3.3	flow and osd Calculations	7
3.3.1	Modelling and Inputs	7
3.3.2	On-site Detention	7
4	OSD Installation Requirements	8
5	OSD Maintenance Requirements	8
6	Stormwater Quality Design	9
7	Overland Flows	9
8	Conclusions and Recommendations	10

## TABLES INDEX

Table 1:	Predevelopment surface parameters	7
Table 2:	Post development surface parameters	7
Table 3:	Flow rate summary	7
Table 4:	OSD Maintenance Requirements	8

## FIGURES INDEX

Figure 1:	Locality and site plan.	4
Figure 2:	Surface Characteristics (NearMap, Dec 2024)	5
Figure 3:	Post Development Site Surface Properties (Red = Roof, Green = Hardstand, Blue = Landscaping)	6
Figure 4:	Flood Hazard Vulnerability Curves	10

## APPENDICES

Appendix 1	Pinion Advisory Design Drawing	11
Appendix 2	Pinion Advisory Stormwater Calculations	12
Appendix 3	Overland Flow Analysis	13

# 1 Introduction

Pinnacle Drafting and Design have engaged Pinion Advisory to provide a stormwater management report to address condition 5 of a Request for Information (RFI) from the Brighton Council (BC) in relation to a four-unit development at 77A Fouche Avenue, Old Beach (DA 2025/024).



**Figure 1: Locality and site plan.**

# 2 Design Standards

The design report is primarily guided by the following documents:

- DEP and LGAT Tasmanian stormwater policy guidance and standards for development V1 [2021]
- Australian Rainfall & Runoff 2016, Book 9: Runoff in Urban Areas<sup>1</sup>

<sup>1</sup> Ball J, Babister M, Nathan R, Weeks W, Weinmann E, Retallick M, Testoni I, (Editors), *Australian Rainfall and Runoff: A Guide to Flood Estimation*, Commonwealth of Australia (Geoscience Australia), 2019.

- AS/NZS 3500.3 – Plumbing and drainage Part 3: Stormwater drainage
- Brighton Council Policy 6.1 – Stormwater Quality Control Contributions

The following assumptions and formulae are utilised:

- Stormwater infrastructure and detention systems in residential areas are required to control the 5% AEP flows. All subsequent calculations are based on 5% AEP rainfall events.
- Rainfall data was obtained from the Bureau of Meteorology (BOM). Specifically, the Design Data Rainfall System (2016).
- Flow rates were calculated using the Rational Method.
- Boyd’s Formula was used to determine required storage volumes.
- The ‘orifice equation’ was used to size outlet orifice sizes.

## 3 Stormwater Quantity Design

### 3.1 PREDEVELOPMENT SITE

The predevelopment site consists of a 1440m<sup>2</sup> lot previously subdivided from 77 Fouche Avenue.



Figure 2: Surface Characteristics (NearMap, Dec 2024)


At the time of subdivision, the lot was provided with a DN150 stormwater property connection to the existing council stormwater main located to the east of the site within 77 Fouche Avenue. An existing grated pit in the southern eastern corner of the property acts as the property's stormwater connection point.

The existing site is predominantly grassed with an area of gravel along the northern boundary – for the purposes of stormwater calculations this was still considered to have a runoff coefficient equivalent to grassland.

The predevelopment time of concentration was assumed to be 5 minutes based on a maximum flow path length of 50m and an elevation drop of 0.35m.

**3.2 POST DEVELOPMENT SITE**

The proposed development includes the construction of four units and associated driveway and carparking areas, and includes an 50m<sup>2</sup> passing bay adjacent, but outside, the eastern boundary. This will result in the construction of 963m<sup>2</sup> of new impervious area.

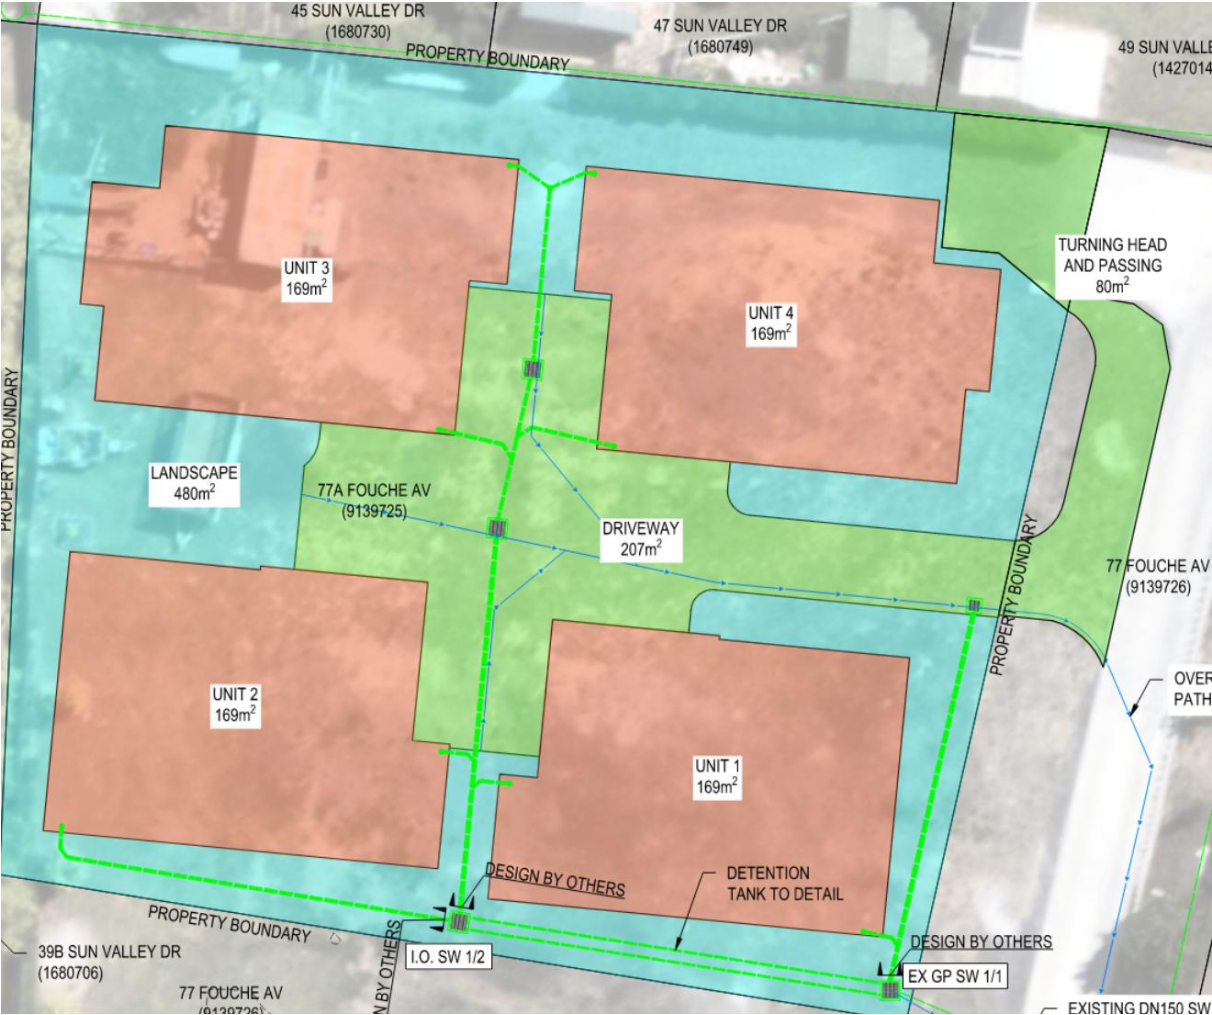

**Figure 3: Post Development Site Surface Properties (Red = Roof, Green = Hardstand, Blue = Landscaping)**

The internal stormwater network has been detailed by the building designer. It is possible to utilise the existing stormwater connection and maintain a single point of discharge to the public stormwater network.

The post development time of concentration was assumed to be 5-minutes, which is standard practice for small, fast response, urban catchments such as this.

### 3.3 FLOW AND OSD CALCULATIONS

#### 3.3.1 Modelling and Inputs

**Table 1: Predevelopment surface parameters**

Surface	Runoff Coefficient	Area
Concrete driveway	0.90	0 m <sup>2</sup>
Roof	0.90	0 m <sup>2</sup>
Gravel	0.74	0 m <sup>2</sup>
Landscaping/open space	0.42	1440m <sup>2</sup>
<i>Total</i>	<i>0.42</i>	<i>1440m<sup>2</sup></i>

**Table 2: Post development surface parameters**

Surface	Runoff Coefficient	Area
Concrete driveway	0.90	287m <sup>2</sup>
Roof	0.90	676m <sup>2</sup>
Gravel	0.74	0m <sup>2</sup>
Landscaping/open space	0.42	477m <sup>2</sup>
<i>Total</i>	<i>0.74</i>	<i>1440m<sup>2</sup></i>

**Table 3: Flow rate summary**

Development Condition	Storm Event	Flow Rate
Predevelopment, TOC	5% AEP, 5-min duration	15L/s*
Post Development, critical storm (as per detention calculations)	5% AEP, 5-min duration	26L/s

\*The 5% AEP, 5-minute duration predevelopment flow rate of 15L/s defines the permissible site discharge (PSD).

#### 3.3.2 On-site Detention

To restrict the post development flow across all storm durations to the PSD, a detention volume of 3.3m<sup>3</sup> is required. It is proposed that an oversized stormwater pipe is installed in the corner of the site between EX GP SW1/1 and I.O. SW1/2. Oversizing this 17.3m long run to DN450 provides 2.75m<sup>3</sup> total capacity. The pits on each end of the tank will contribute 0.2m<sup>3</sup> each. Providing a combined 3.15m<sup>3</sup>. The remaining 0.15m<sup>3</sup> will be provided by the internal stormwater network. Approximately 10m of DN150 pipe will produce a volume of 0.15m<sup>3</sup>. As such the system has the capacity to detain 3.3m<sup>3</sup> of water without surcharging.

The detention outflow will be controlled with an 700mm tall orifice plate installed over the outlet of EX GP SW1/1. A 93mm square orifice was found to restrict the outflow from the site to the permissible site discharge of 15L/s. A square orifice is preferred to a round

orifice as they offer better blockage resistance particularly under low flow conditions due to the greater bottom width.

A detailed design drawing is provided in Appendix 1 – Pinion Design Drawing. Refer Appendix 2 – Pinion Stormwater Calculations for detailed calculations.

## 4 OSD Installation Requirements

- Outlet orifice must be sized according to Section 3.3.2. The orifice is to be constructed in accordance with Section 7.10 of AS/NZS 3500.3:2021.
- The orifice is to be protected from blockage and debris build up by installing a “trash grate”.
- Access to the “trash grate”/orifice to allow cleaning/removal is accommodated via EX GP SW1/1.
- The detention system must allow for high flow bypass via overtopping of the orifice plate in order to take the downstream DN150 property connection to capacity prior to surcharge from EX GP SW1/1 during a storm event with an AEP below 5%.
- The detention system must be installed in such a way that the tank will fill to overflow level without any upstream openings surcharging. The principal civil designer is responsible for ensuring compliant design.
- Additional runoff from offsite or from non-storm sources are not routed into the OSD.
- Pinion Advisory have provided a tank design that is hydraulically effective based on the depth of stormwater connection provided by the client. The building designer is required to ensure the remainder of the internal stormwater network achieves compliant grades and covers, whilst still connecting into the proposed stormwater detention tank.

## 5 OSD Maintenance Requirements

The maintenance requirements for the detention system are shown in Table 4.

**Table 4: OSD Maintenance Requirements**

Task	Description	Frequency
<b>General cleaning and inspection</b>	General inspection and cleaning of tank and orifice. <ul style="list-style-type: none"> <li>- Visual inspection of detention system and “trash grate”/orifice condition.</li> <li>- Any build-up of silt/debris to be removed.</li> <li>- Any blockage of “trash grate”/orifice to be removed.</li> </ul>	Once every 4 months, or after a significant storm event.  Performed in conjunction of cleaning of other drainage infrastructure such as gutters and drains.

## 6 Stormwater Quality Design

Due to the flat surface grades of the site with minimum driveway levels of approximately 2.45m and an existing property stormwater connection invert level of 1.44m, limited hydraulic head is available to facilitate stormwater treatment via either proprietary products or custom systems.

Under Brighton Council "Policy 6.1 - Stormwater Quality Control Contributions" a developer may request to provide a contribution to council in lieu of installing a stormwater treatment system on site. For multi-dwelling developments, a contribution of \$2,000 is imposed for each additional dwelling, with the first dwelling on a property with an existing stormwater connection exempt under Policy 6.1. A total developer contribution of \$6,000 is therefore proposed.

## 7 Overland Flows

During a major rainfall event, the flows from the development must be conveyed within the major drainage system without impacts to people or downstream properties and infrastructure. The major drainage system consists of both the piped (minor) drainage system and formalised overland flow paths such as gutters and open drains. Overland flows leave the site via the proposed driveway or surcharge from the existing grated stormwater pit in the southeastern corner of the site. The property fence must be located uphill/upstream of stormwater pit EX GP SW1/1 to ensure the fence does not intersect the flow path. Both overland flow discharge points flow onto the existing 77 Fouche Avenue driveway, before eventually reaching the foreshore of the River Derwent.

Since the development is located at the bottom of the catchment, only 80m from the discharge point of the council stormwater network, only one property, 77 Fouche Avenue, is impacted by the overland flow route from the site. 77 Fouche Avenue already has an established overland flow path along the eastern boundary consisting of a kerb on the existing concrete driveway followed by grassed front yard with a 10m clearance between the existing house and fence.

AutoCAD's "Hydraflow Express" tool was used to analyse the flow in this existing kerb and channel using a 1% AEP + 18% CC site outflow of 46.3L/s, driveway crossfall of 3% and 1.5% longitudinal grade. This analysis found a maximum channel depth of 53mm and a velocity of 1.0m/s. This depth and velocity is generally considered safe for people, vehicles and property as seen in Figure 4.

The constriction next to the 77A house was also analysed using a flat, grassed channel width of 4.0m (constriction at gate) and a longitudinal grade of 1%. This produced a maximum flow depth of 37mm and a velocity of 0.31m/s. This depth and velocity is also generally considered safe for people, vehicles and property as seen in Figure 4.

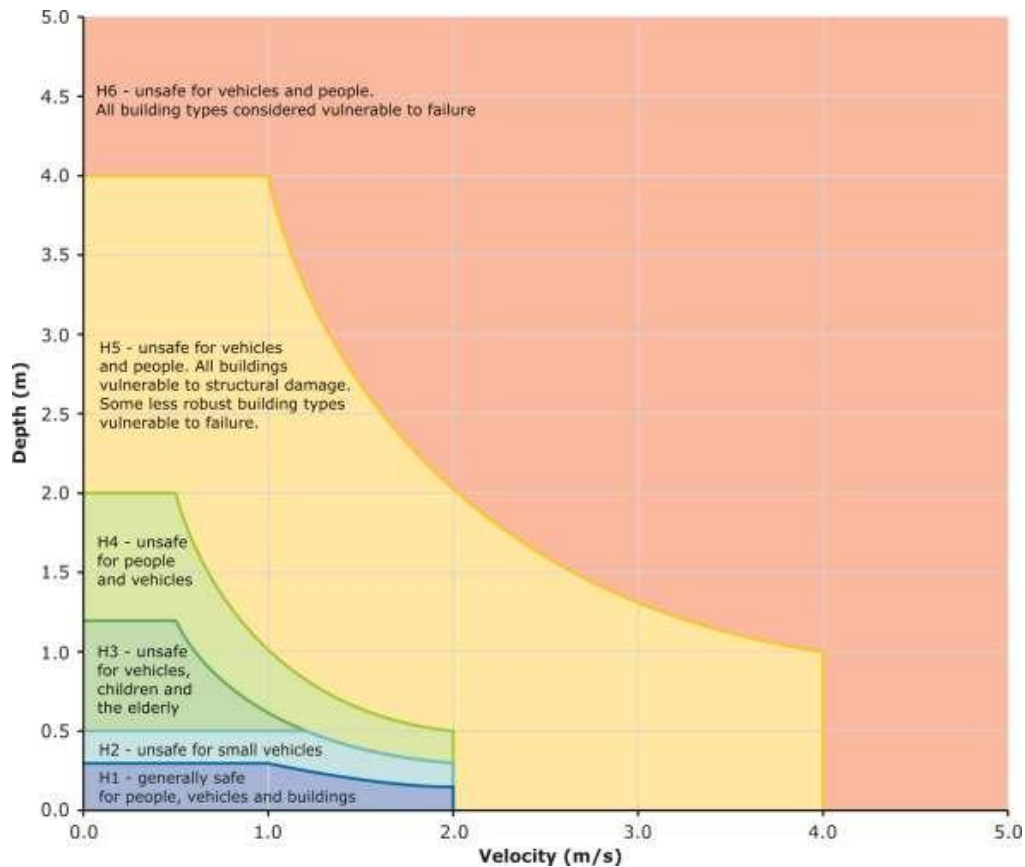


Figure 4: Flood Hazard Vulnerability Curves<sup>2</sup>

## 8 Conclusions and Recommendations


The proposed minor stormwater system complies with best practices and Brighton Council requirements in all aspects. The proposed stormwater detention system and outlet orifice ensures adequate flow restriction and storage volume to ensure the post development runoff will be restricted to the permissible site discharge for all 5% AEP storm durations.

The proposed developer contribution of \$6,000 in lieu of stormwater treatment complies with Brighton Council Policy 6.1 and their rates and charges as of the time of writing.


The proposed major stormwater system complies with best practices and Brighton Council requirements in all aspects. Overland flow path routes downstream of the site were demonstrated to convey the major site flows for a 1% AEP event with additional 18% loading for climate change without undue hazard to people, vehicles or property. The fence along the eastern property boundary is required to be installed uphill/upstream of the existing stormwater pit – EX GP SW1/1.

<sup>2</sup> Ball J, Babister M, Nathan R, Weeks W, Weinmann E, Retallick M, Testoni I, (Editors), *Australian Rainfall and Runoff: A Guide to Flood Estimation*, Commonwealth of Australia (Geoscience Australia), 2019.


## Appendix 1 Pinion Advisory Design Drawing

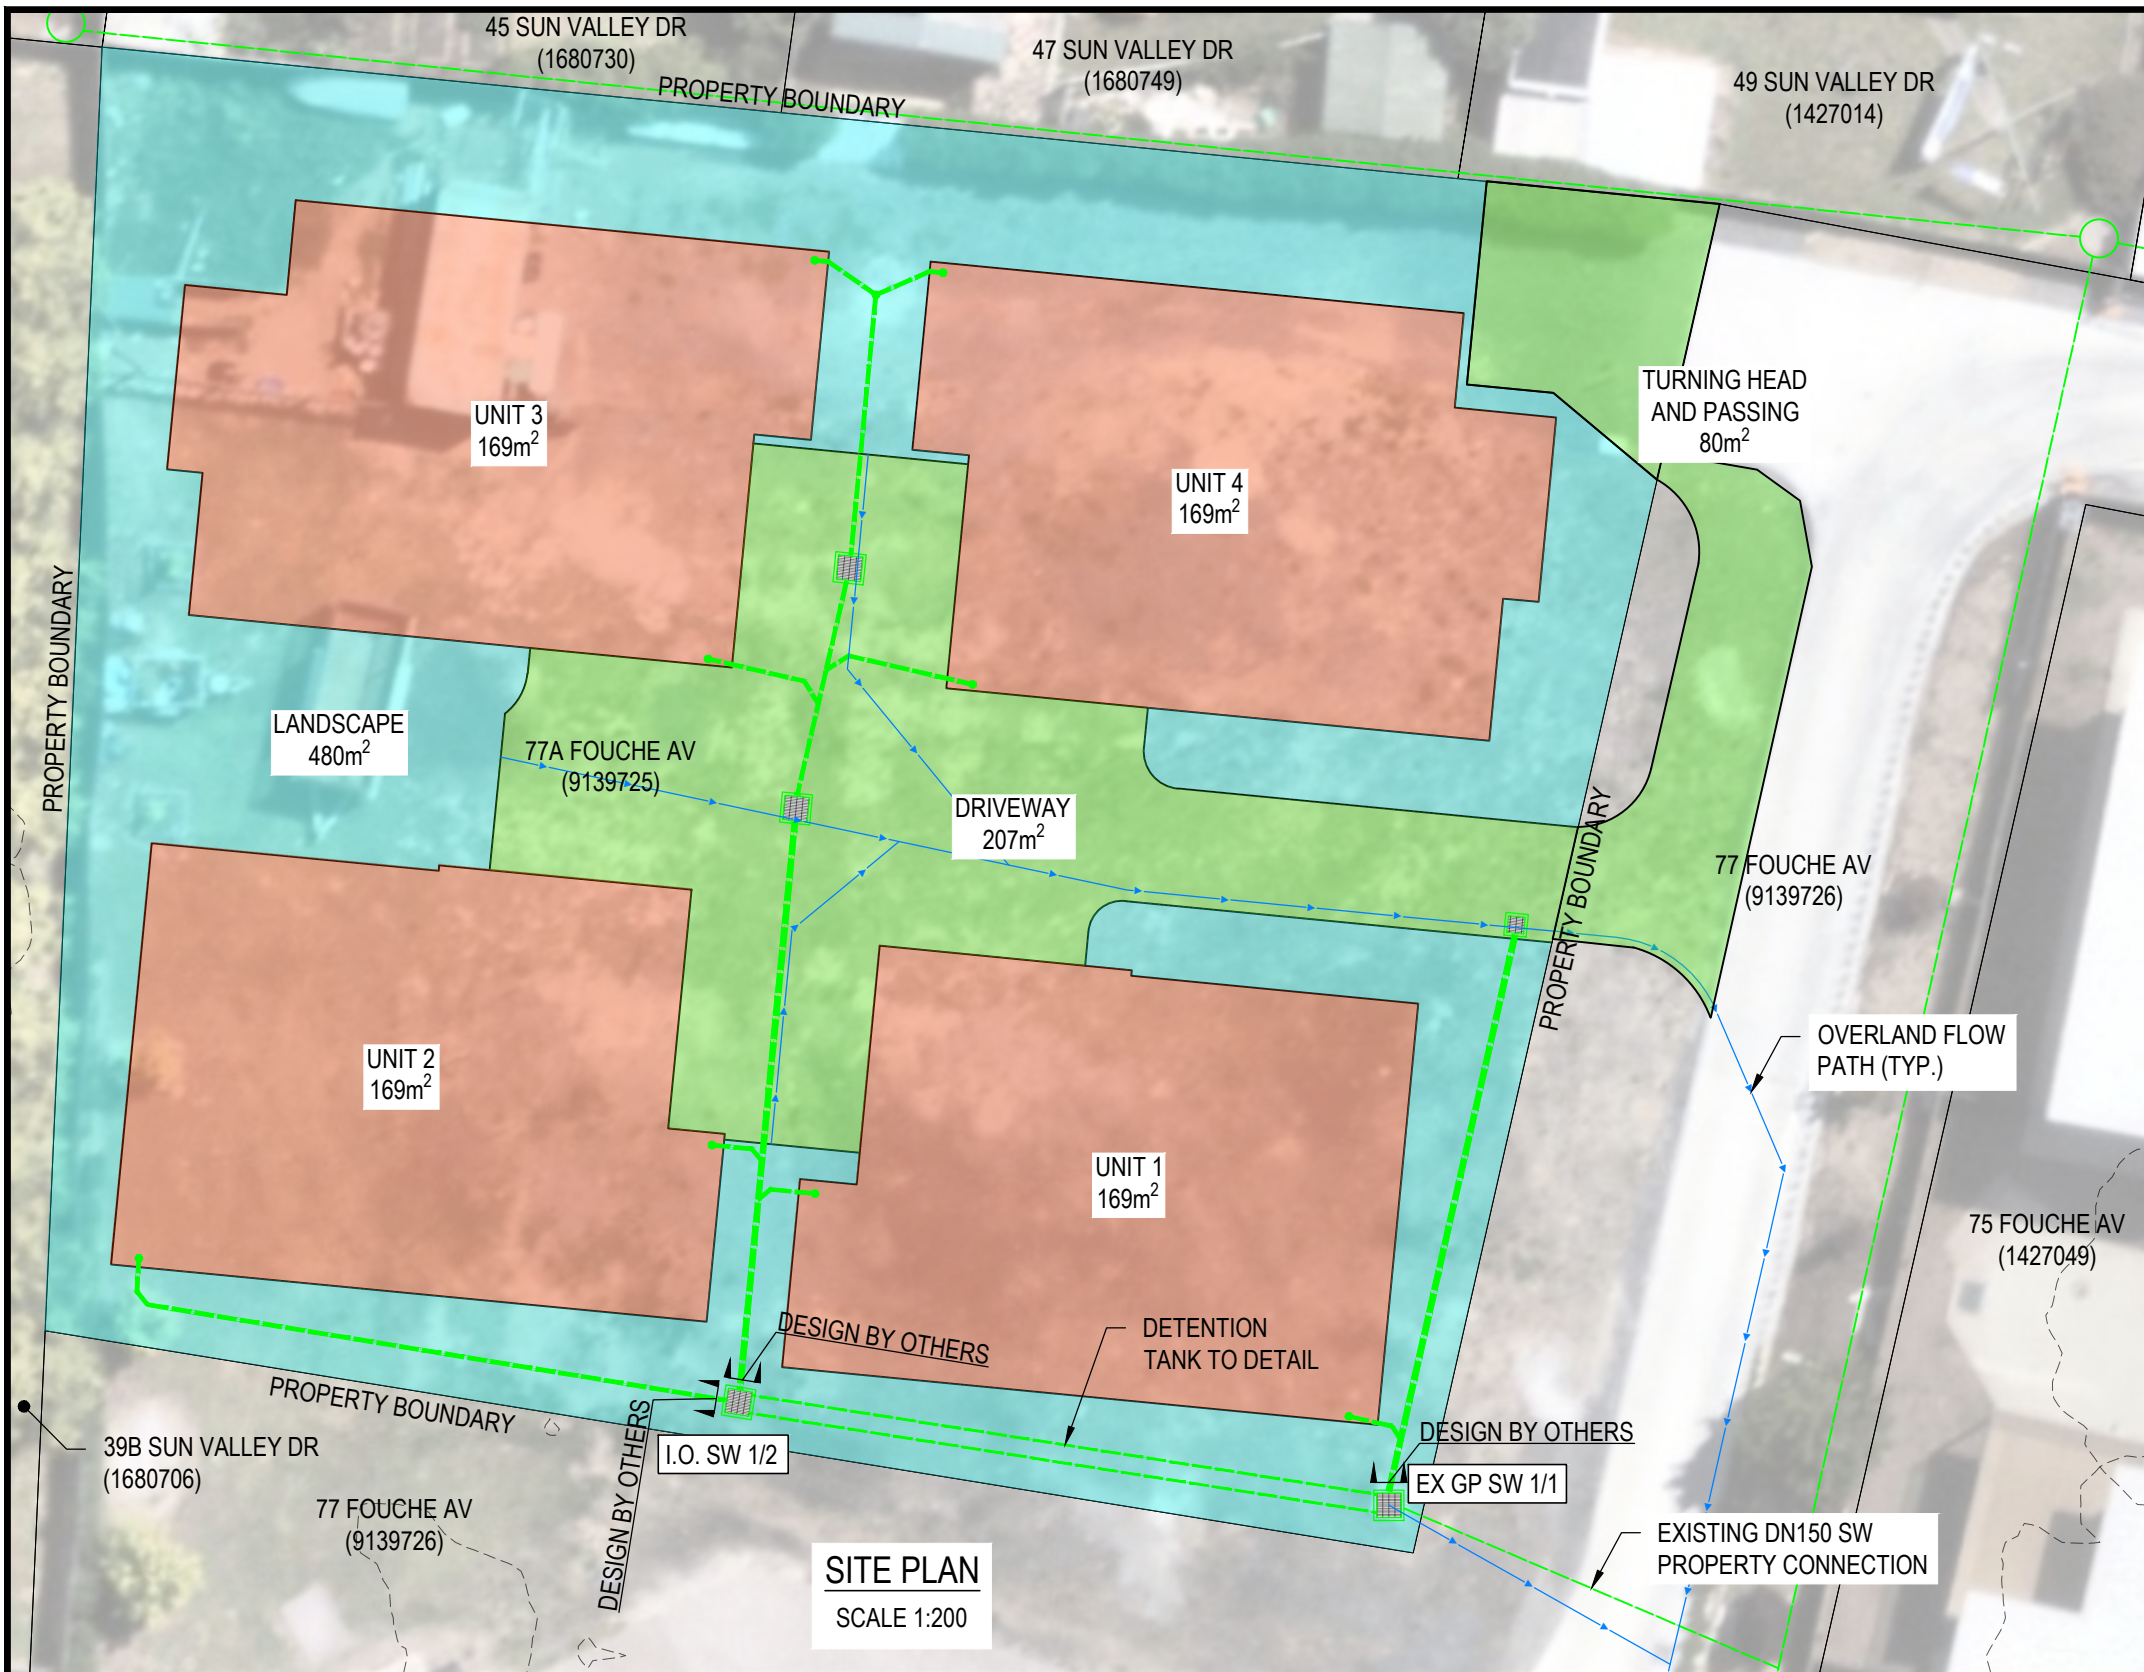

**SITE PLAN**  
SCALE 1:200

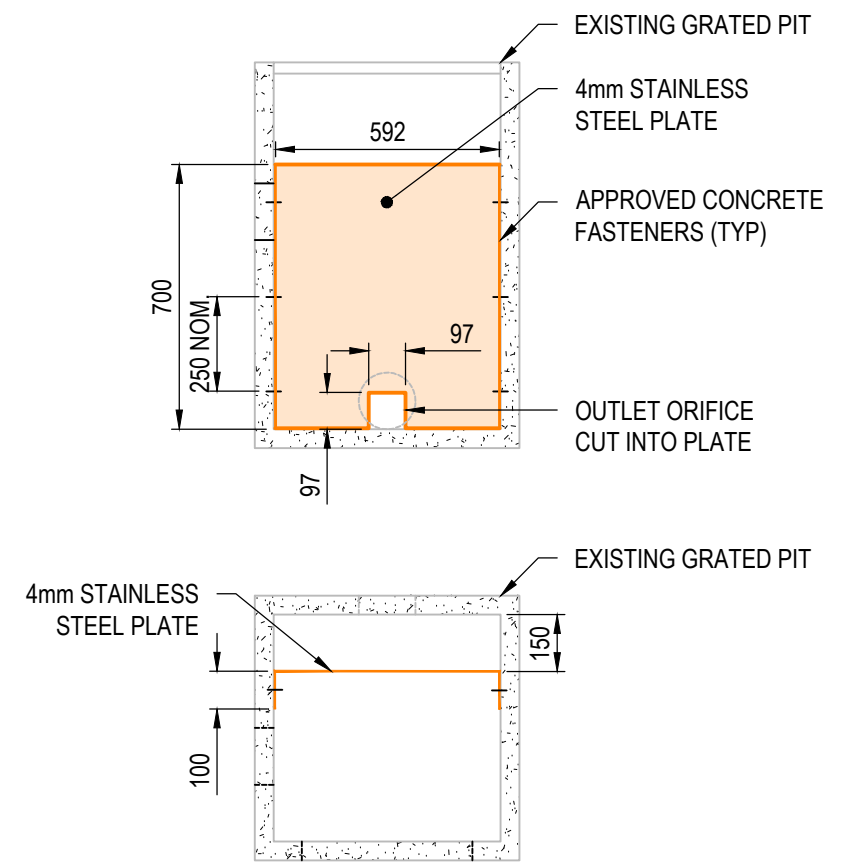

**STAINLESS STEEL BAFFLE DETAILS**  
SCALE 1:20

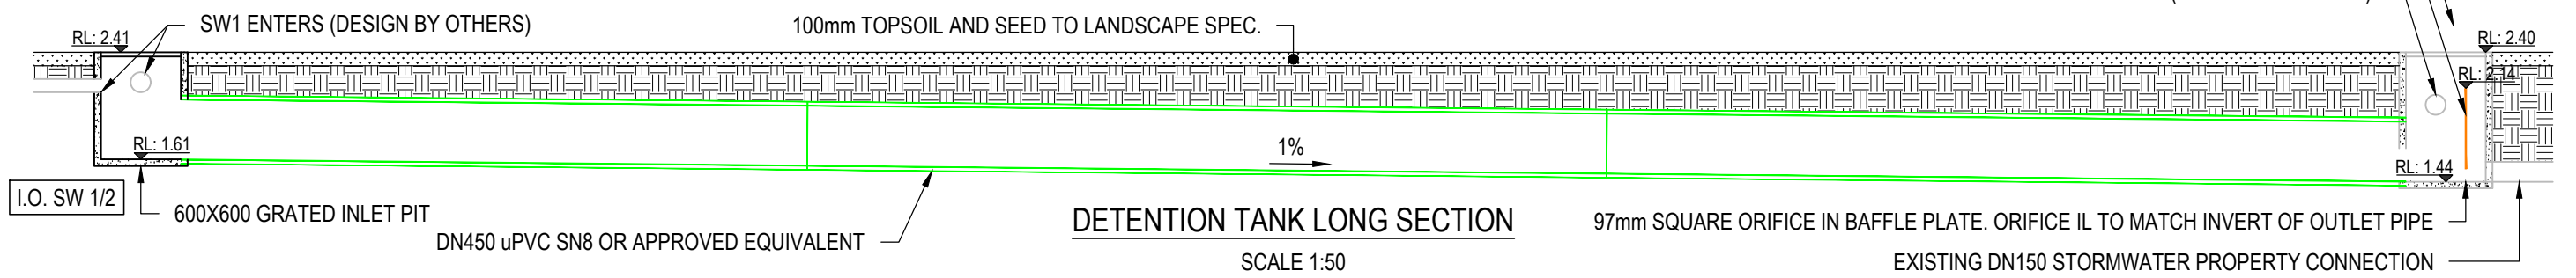

**DETENTION TANK LONG SECTION**  
SCALE 1:50

REV	ISSUED	DSGN	APPRVD	REVISION DESCRIPTION	REV	ISSUED	D.DWN	APPRVD	REVISION DESCRIPTION
A	25/02/26	TM	BN	FOR BUILDING APPROVAL					

admin@pinionadvisory.com 1300 746 466 pinionadvisory.com			SURVEY INFORMATION: GDA94 MGA-55 AHD83	REFERENCED PLANS: -	DES/DRAWN: T. MALES CHECKED: R. HUNT APPROVED: B. NADLER DATE: 25.02.2026	CLIENT: PINNACLE DRAFTING	DRAWING TITLE: 77A FOUCHE AVENUE, OLD BEACH STORMWATER DETENTION DESIGN
This document is and shall remain the property of PINION ADVISORY PTY. LTD. The document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for the commission.			COPYRIGHT The arrangement and general details as shown on this drawing are essentially diagrammatic and must be applied to the circumstances as found on site.		PROJECT REF: 160LYDED-CONS	DRAWING No: 001	REVISION A

## Appendix 2 Pinion Advisory Stormwater Calculations

# STORMWATER CALCULATIONS



<b>PROJECT</b>	ON-SITE DETENTION, UNIT DEVELOPMENT
<b>PROJECT ADDRESS</b>	77A Fouche Avenue, Old Beach
<b>PROJECT NUMBER</b>	160LYDED-CONS
<b>REVISION</b>	B

<b>DATE:</b>	10.04.2026
<b>DESIGNED:</b>	T. MALES
<b>REVIEWED:</b>	R. HUNT

## SITE PARAMETERS

	Pre Development		Post Development	
<b>Site Area</b>	1440	m <sup>2</sup>	1440	m <sup>2</sup>
<b>Effective Impervious Area</b>	576	m <sup>2</sup>	1153.8	m <sup>2</sup>
<b>Percentage Impervious</b>	40	%	80	%
<b>Runoff Coefficient</b>	0.42	(-)	0.74	(-)
<b>Time of Concentration</b>	5	mins	5	mins

## PEAK CATCHMENT FLOWS FOR GIVEN AEP AT T.O.C.

AEP	I <sub>tc,y</sub> (mm/h)	Pre Development		Post Development	
		Flow (L/s)	Flow + 18% CC (L/s)	Flow (L/s)	Flow + 18% CC (L/s)
10%	71.1	12	14	21	25
5%	83.5	15	17	26	31
2%	101.0	20	23	34	41
1%	115.0	23	27	41	48

<b>Permissible Site Discharge (PSD)</b>	15	L/s
---	----	-----

## DETENTION VOLUME AND ORIFICE SIZING

Storm Duration (min)	Tank Inflow (L/s)	Detention	
		Tank Outflow (L/s)	Storage (m <sup>3</sup> )
5	26.0	15.0	3.30

Orifice		
<b>Head (Above Orifice)</b>	0.7	m
<b>No. of Orifice</b>	1	(-)
<b>Max. Orifice Flow</b>	14.6	L/s
<b>Orifice Diameter</b>	93	mm

## Appendix 3 Overland Flow Analysis

# Channel Report

## Existing 77 Fouche Avenue Driveway

### Gutter


Cross Sl, Sx (m/m)	= 0.030
Cross Sl, Sw (m/m)	= 0.030
Gutter Width (m)	= 0.4500
Invert Elev (m)	= 1.0000
Slope (%)	= 1.5000
N-Value	= 0.013

### Highlighted

Depth (m)	= 0.0530
Q (cms)	= 0.046
Area (sqm)	= 0.0469
Velocity (m/s)	= 0.9876
Wetted Perim (m)	= 1.8217
Crit Depth, Yc (m)	= 0.0701
Spread Width (m)	= 1.7678
EGL (m)	= 0.1028

### Calculations

Compute by:	Known Q
Known Q (cms)	= 0.0463

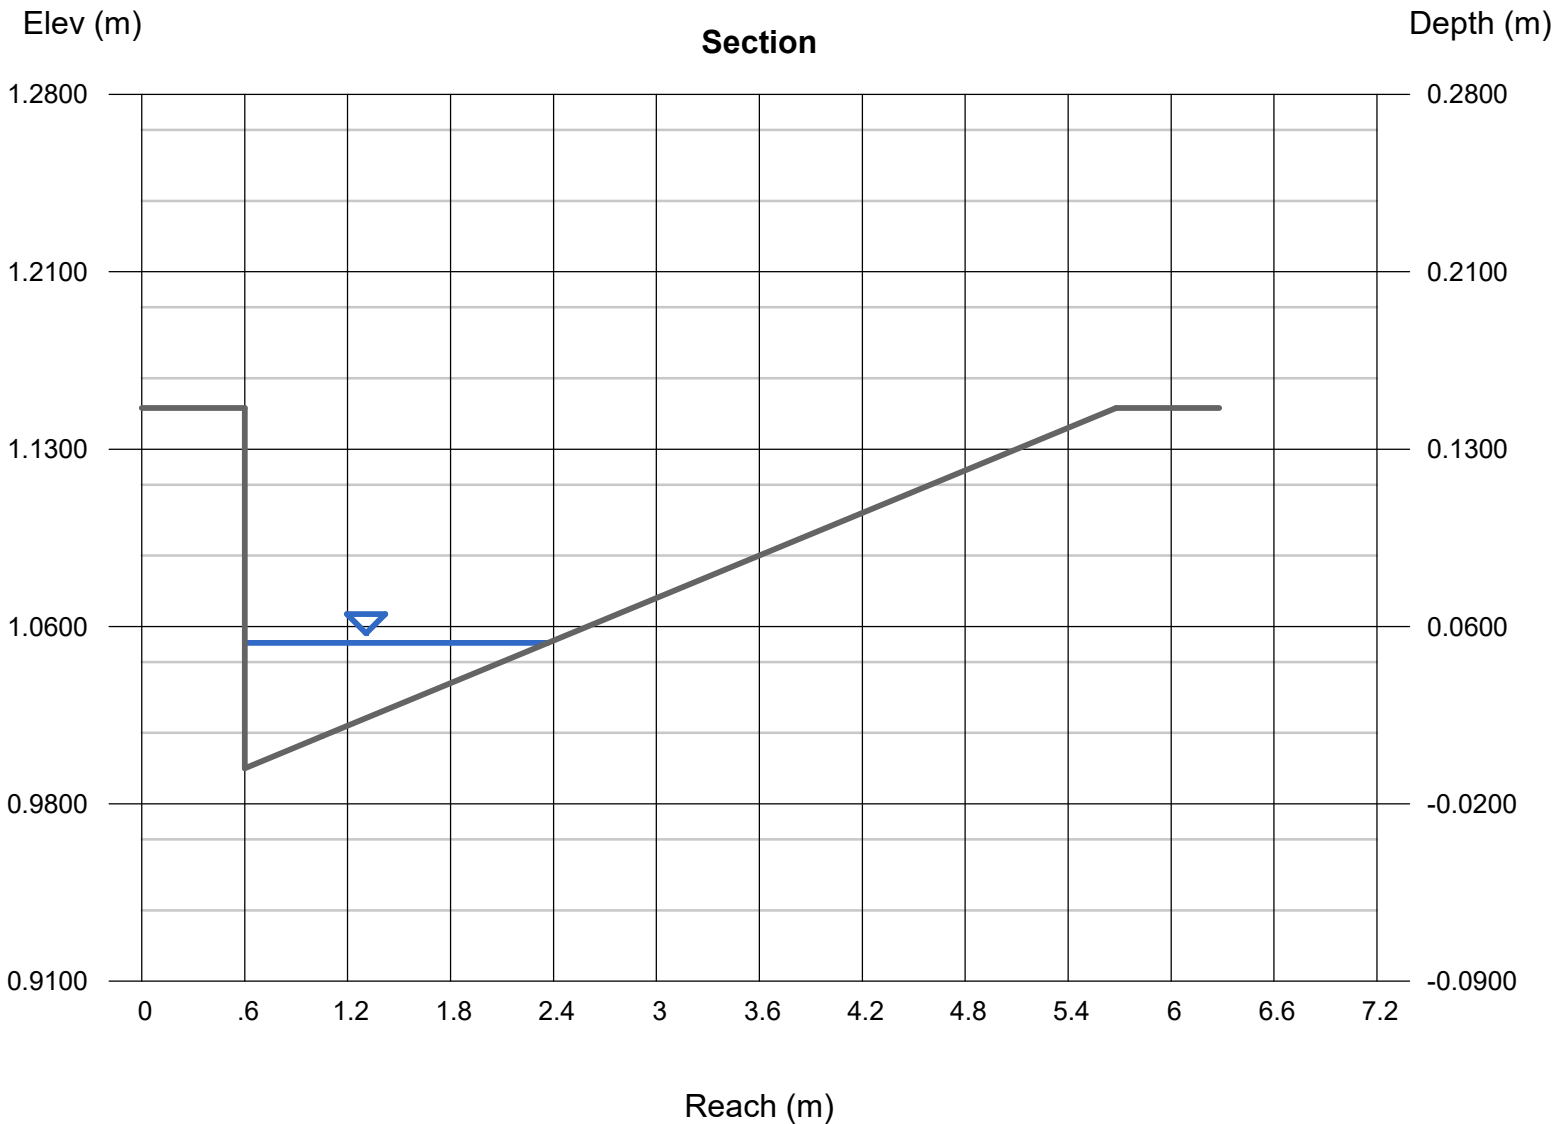

# Channel Report

## Existing 77 Fouche Avenue Driveway Gate

### Rectangular

Bottom Width (m) = 4.0000  
Total Depth (m) = 0.5000


Invert Elev (m) = 1.0000  
Slope (%) = 1.0000  
N-Value = 0.030

### Calculations

Compute by: Known Q  
Known Q (cms) = 0.0460

### Highlighted

Depth (m) = 0.0366  
Q (cms) = 0.046  
Area (sqm) = 0.1463  
Velocity (m/s) = 0.3144  
Wetted Perim (m) = 4.0732  
Crit Depth, Yc (m) = 0.0244  
Top Width (m) = 4.0000  
EGL (m) = 0.0416

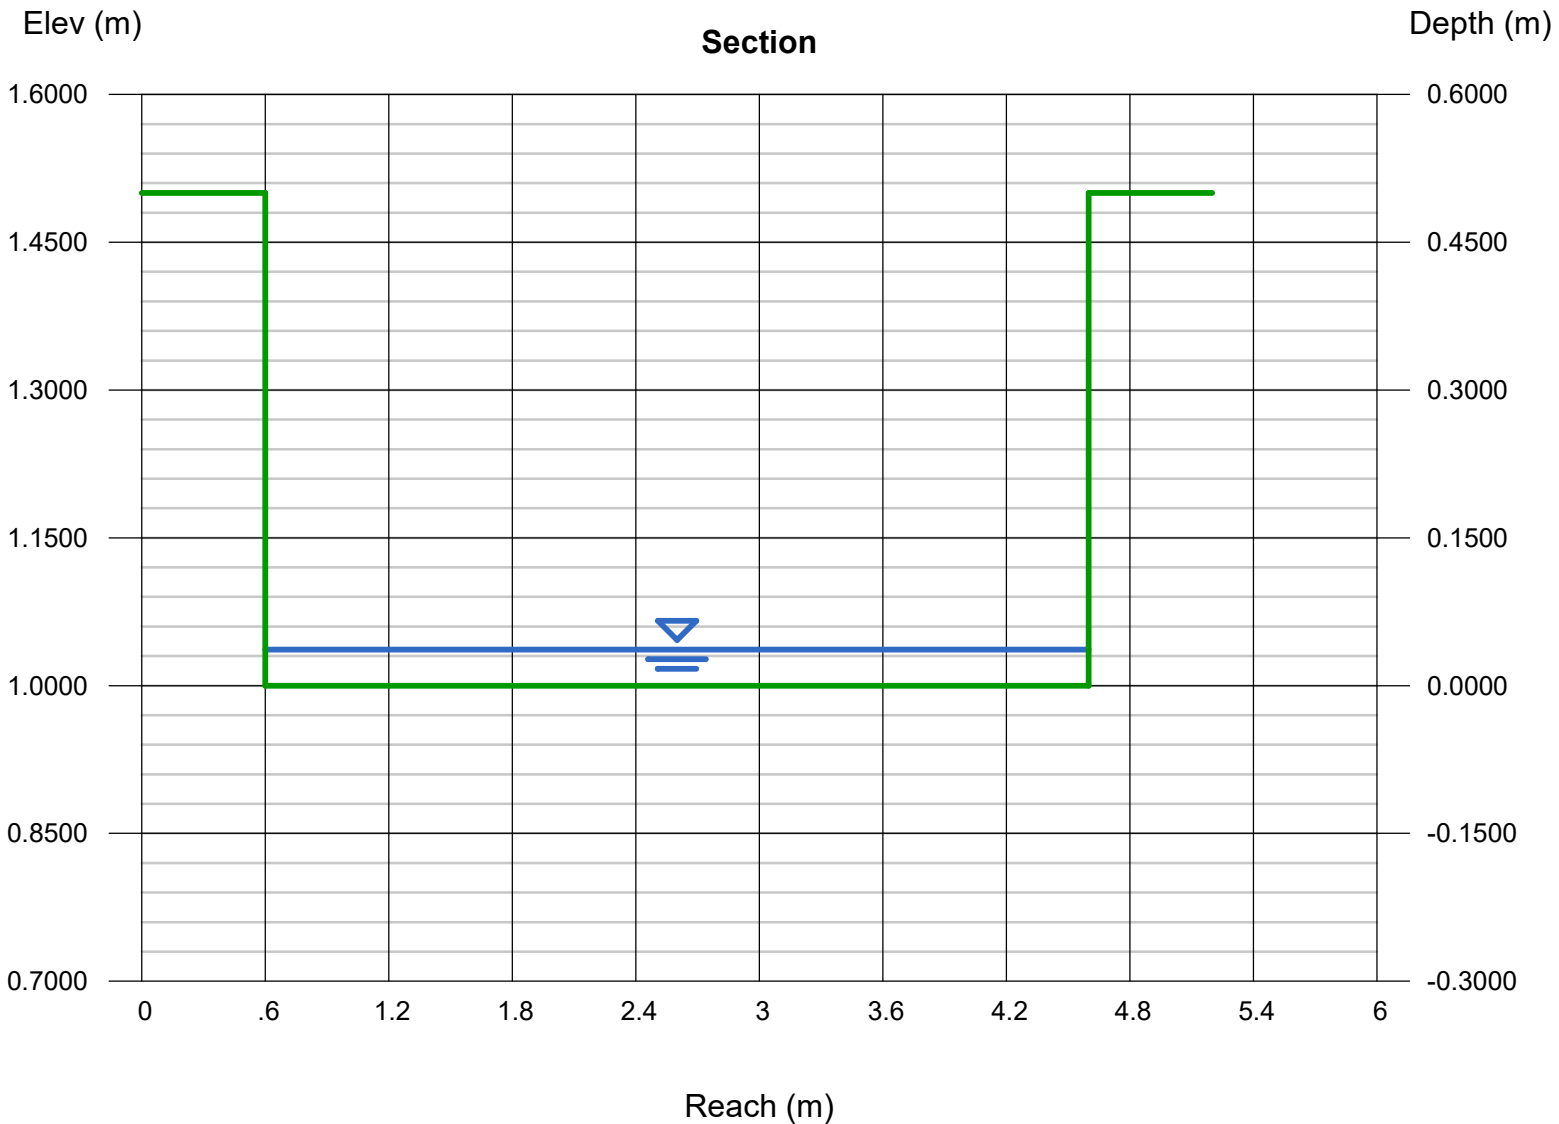





GEO-ENVIRONMENTAL  
SOLUTIONS

# COASTAL VULNERABILITY ASSESSMENT

*77 Fouche Avenue, Old Beach TAS 7017*

CLIENT: Lyden Builders

January 2023

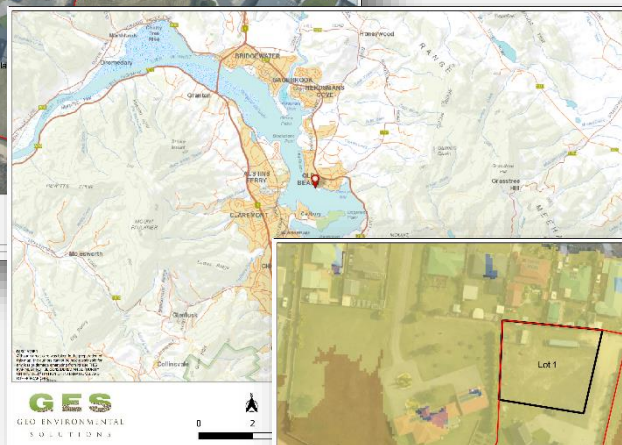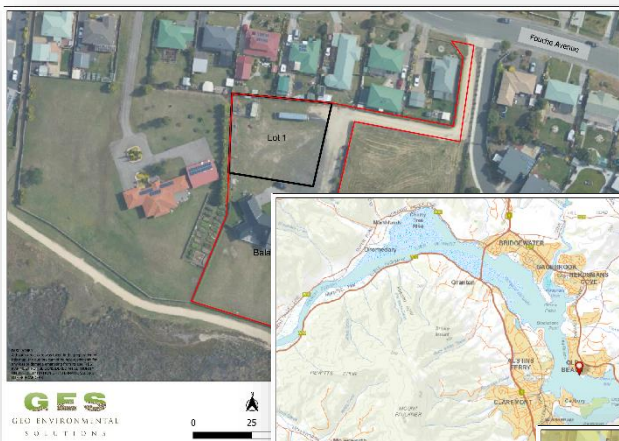

# DOCUMENT CONTROL RECORD

---

Document Prepared By:



Geo-Environmental Solutions Pty Ltd

ABN 24 115 004 834

29 Kirksway Place

Battery Point

TAS, 7004

P: +61 3 6223 1839

E: [office@geosolutions.net.au](mailto:office@geosolutions.net.au)

W: [geosolutions.net.au](http://geosolutions.net.au)

DOCUMENT CONTROL			
Report Title:	GES – 77 Fouche Avenue, Old Beach TAS 7017		
Project Type:	Coastal Vulnerability Assessment		
Client:	Lyden Builders		
Project Job Number:	J8254		
Revision Version:	V01		
Date:	31/01/2023		
Prepared By:	Vaida Seikyte	Reviewed By:	JP Cumming

APPROVED BY		
Name	Signature:	Date
JP Cumming		31/01/2023

This document is only to be used by the commissioning client and for the purposes of which this document was prepared. No responsibility is accepted for use of any part of this report in any other context or for any other purpose by a third party.

DOCUMENT CONTROL RECORD.....	2
Executive Summary .....	4
1 Introduction .....	5
2 Scope of Work .....	5
3 Site Details.....	6
3.1 Project Area Land Title .....	6
3.2 Project Area Regional Setting .....	6
3.3 Australian Building Code Board.....	7
3.4 Building Regulations 2016.....	8
3.4.1 Coastal inundation hazard areas .....	8
3.4.2 Works in coastal inundation hazard areas .....	8
3.5 Habitable Room Finished Floor Levels .....	9
3.6 Tasmanian Planning Scheme Overlay .....	9
3.6.1 Coastal Inundation Hazard Code (CIHC) Areas .....	9
3.7 Proposed Development.....	10
3.8 Acceptable Solutions .....	11
3.8.1 Coastal Inundation Hazard Code (C11.1) .....	11
3.9 Performance Criteria.....	11
4 Coastal Inundation Assessment.....	12
4.1 Coastal Inundation Levels.....	12
4.1.1 Storm Tide .....	12
4.1.2 Sea Level Rise .....	12
5 Risk Assessment .....	13
6 Conclusions and Recommendations .....	13
Appendix 1 Acceptable Solutions.....	14
Appendix 2 Works in a Coastal Inundation Hazard Area .....	15
Appendix 3 Directors Determination & Building Regulations 2016 - Coastal Inundation Hazard Reporting.....	16
Appendix 4 Quantitative Risk Assessment Tables .....	19
Appendix 5 Quantitative Risk Assessment .....	20

#### **Figures**

Figure 1 Location of Project Area (Source: The LIST).....	6
Figure 2 CIHC Overlay near the site (Source: The List).....	10
Figure 3 Proposed subdivision development plan .....	11

#### **Tables**

Table 1 Summary of Site Areas Falling Within Potential Coastal Vulnerability Zones.....	10
Table 2 Brighton Council Sea Level Rise Planning Allowance – derived from RCP 8.5.....	12

## Executive Summary

Geo-Environmental Solutions Pty Ltd (GES) were contracted by Lyden Builders to prepare a coastal inundation hazard assessment for a proposed subdivision at Old Beach. The project area consists of a single cadastral title (C.T. 110178/26) located at Lot 77 Fouche Avenue, Old Beach, TAS 7017 (The Site).

An application to conduct construction works has triggered the assessment in accordance with the Tasmania Planning Scheme (TPS) – Brighton and following of the Director's Determination for Coastal Inundation Hazard areas which provides building requirements for building and demolition work in coastal inundation hazard.

GES have undertaken this assessment using available scientific literature and datasets. Estimations are determined by approximation with appropriate regional information applied where appropriate to site specific information.

The following is concluded from the inundation hazard assessment:

- The project area has an elevation from ~2.0 m AHD on the south portion of the site to increasing to 3m AHD on the northeast boundary.
- The combined inundation levels for the site has been estimated at 1.94 m AHD for 2073 and 2.27 m AHD for 2100.
- Any proposed habitable developments should have a finished floor level which complies with the Tasmanian Building Act which stipulates that the finished floor level of a development should be 0.3 above the site inundation level; All habitable buildings should comply with performance criteria C11.7.1 P1 and must be elevated at or above 2.6 m AHD;
- The site is not predicted to be subject to coastal erosion over the life of the buildings and no specific protection measures for erosion are required;
- Given that water movement is expected to be minimal during possible future flooding, there is no requirement for specific flood or flow mitigation measures.

GES has established from the risk assessment that the level of risk is acceptable within the lifetime of the proposed development works. There are no medium or high-risk aspects to the proposed development.

# 1 Introduction

Geo-Environmental Solutions Pty Ltd (GES) were contracted by Lyden Builders to prepare a coastal inundation hazard assessment for a proposed subdivision at Old Beach. The project area consists of a single cadastral title (C.T.) located at Lot 77 Fouche Avenue, Old Beach, TAS 7017 (The Site).

An application to conduct construction works has triggered the assessment in accordance with the Tasmania Planning Scheme (TPS) – Brighton and following of the Director’s Determination for Coastal Inundation Hazard areas which provides building requirements for building and demolition work in coastal inundation hazard.

GES have undertaken this assessment using available scientific literature and datasets. Estimations are determined by approximation with appropriate regional information applied where appropriate to site specific information. Data collection and site-specific modelling was undertaken in assessment of the site.

## 2 Scope of Work

The objective of the site investigation is to:

- Identify which codes need to be addressed in terms of coastal inundation hazard code and identify the performance criteria relevant to the project which need addressing
- Conduct a detailed inundation hazard assessment
- Conduct a site risk assessment for the proposed subdivision ensuring relevant performance criteria are addressed; and
- Where applicable, provide recommendations on methods and design approach to reduce inundation impact.

## 3 Site Details

### 3.1 Project Area Land Title

The land studied in this report is defined by the following title reference:

- C.T. 110178/26

This parcel of land is referred to as the 'Site' and/or the 'Project Area' in this report.

### 3.2 Project Area Regional Setting

The Project Area is located between Ferry Point and Brock Point (Figure 1). The site is subject to the following hydraulic influences:

- Wind fetch across the River Derwent from the west, southwest and the south and the following:
  - Wave setup; and
  - Wave run-up.
- Sea level rise; and
- Tides and associated water currents.

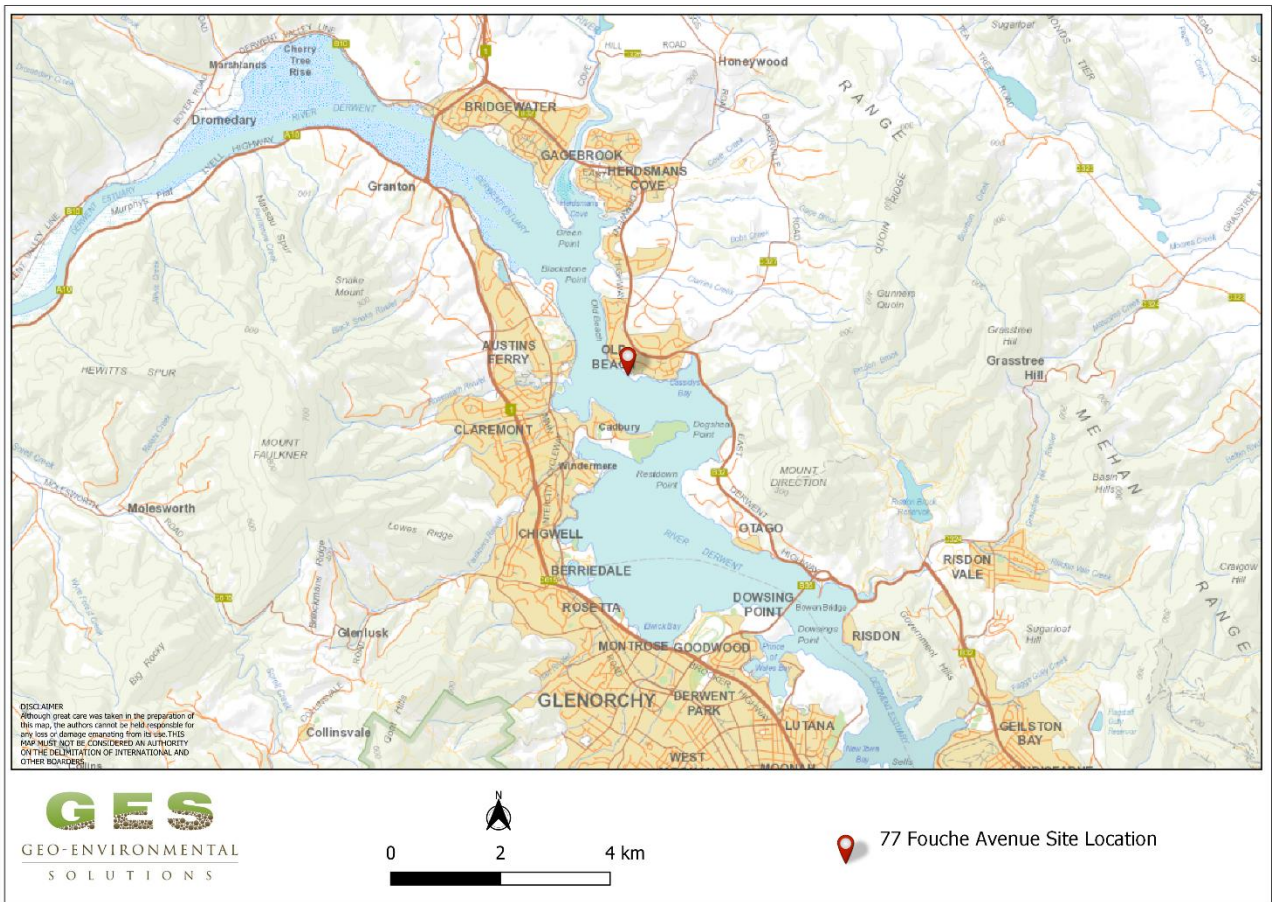


Figure 1 Location of Project Area (Source: The LIST)

The site has an area of approximately 5203 m<sup>2</sup> and appears to have its coastal boundary at the edge of the Derwent River (Figure 2). The elevation of the site ranges from 2.0 to 3.0 m AHD. The edge of the riverbank is lined with reeds, with a small area exposing underlying cobbles which lines the edge of the shoreline, providing some shoreline armouring.



Figure 2 Site Local Setting (Source: The List)

### 3.3 Australian Building Code Board

This report presents a summary of the overall building construction risk to coastal inundation hazard. This assessment has been conducted a 'normal' building design life category based on a 2022 baseline (ABCB 2015).

*'The design life of buildings should be taken as 'Normal' for all building importance categories unless otherwise stated.'*

As per Table 3-1, the following sub systems are identified for the proposed development:

- Building foundations subsystems are considered not accessible or economical to repair and therefore are to be designed with a 50-year life till 2073; and
- Wastewater subsystems are considered to have moderate ease of access but difficult or costly to replace or repair and are therefore to be designed with a 15-year life till 2034.

Table 3-1 Design life of building and plumbing installations and their components

<b>Building Design Life Category</b>	<b>Building Design Life (years)</b>	<b>Design life for components or sub systems readily accessible and economical to replace or repair (years)</b>	<b>Design life for components or sub systems with moderate ease of access but difficult or costly to replace or repair (years)</b>	<b>Design life for components or sub systems not accessible or not economical to replace or repair (years)</b>
Short	1 < dl < 15	5 or dl (if dl<5)	dl	dl
Normal	50	5	15	50
Long	100 or more	10	25	100

Note: Design Life (dl) in years

### 3.4 Building Regulations 2016

#### 3.4.1 Coastal inundation hazard areas

- (1) For the purposes of the Act, land is a coastal inundation hazard area if –
- (a) the land is shown on a planning scheme overlay map as being land that is within a coastal inundation hazard area; and
  - (b) the land –
    - (i) is classified as land within a hazard band of a coastal inundation hazard area; or
    - (ii) is shown on a planning scheme overlay map as being land in an investigation area for a coastal inundation hazard area and the land has not been subsequently classified as being an acceptable risk.
- (2) For the purposes of the definition of hazardous area in section 4(1) of the Act –
- (a) classification under a coastal inundation determination as being land that is within a hazard band of a coastal inundation hazard area is a prescribed attribute; and
  - (b) a coastal inundation hazard area is a hazardous area.

#### 3.4.2 Works in coastal inundation hazard areas

- (1) A person must not perform work in a coastal inundation hazard area unless he or she is authorised to do so under the Act.
- (2) If a person intends to perform work in an investigation area of a coastal inundation hazard area, the person must, before performing the work, ensure the land is classified, in accordance with the coastal inundation determination –
- (a) as being an acceptable risk; or
  - (b) into a hazard band for the coastal inundation hazard area.
- (3) A person must not perform work on a building on land in a coastal inundation hazard area unless the floor level of each habitable room of the building, being erected, re-erected or added as part of the work, is at least 300 millimetres above the defined flood level for the land.
- (4) A responsible person for work being performed in a coastal inundation hazard area must ensure that the work is being performed in accordance with the Act and the coastal inundation determination.

(5) A person performing work in a coastal inundation hazard area must ensure that the work complies with the Act and the coastal inundation determination.

### ***3.5 Habitable Room Finished Floor Levels***

According to the Building Code of Australia, habitable rooms are defined as:

“a room used for normal domestic activities and:

- Includes a bedroom, living room, lounge room, music room, television room, kitchen, dining room, sewing room, study, playroom, family room, home theatre, and sunroom; but,
- Excludes a bathroom, laundry, water closet, pantry, walk-in wardrobe, corridor, hallway, lobby, photographic darkroom, clothes drying room, and other spaces of a specialised nature occupied neither frequently nor for extended periods." Non enclosed areas (such as a deck) are not defined as habitable.

### ***3.6 Tasmanian Planning Scheme Overlay***

The director’s determination reporting checklist for site hazards is presented in *Appendix 3*.

As identified in the directors Determination and regulation 56(3) of the Building Regulations 2016, the defined flood level is the level above the 0 metre Australian Height Datum with a one percent probability of being exceeded in a storm surge flooding event in the year 2100, as specified in the Coastal Inundation Hazard Band Levels List for the relevant locality in the relevant Local Provisions Schedule of the Tasmanian Planning Scheme.

#### **3.6.1 Coastal Inundation Hazard Code (CIHC) Areas**

The site is within low and medium coastal inundation hazard overlay. (Figure 3).



Figure 3 CIHC Overlay near the site (Source: The List)

### 3.7 Proposed Development

The proposed works are to subdivide the site into two lots: Lot 1 and Balance Lot (Figure 3). The balance lot has an existing residential dwelling and there are no proposed further works on the site. The lot 1 is located on the north portion of the site. There are two no habitable storage buildings on the site at the moment. The proposed future works for the Lot 1 is to build a residential dwelling located in the middle of the lot. Both sites will have individual access via Fouché Avenue through the existing driveway.

The proposed lots size:

**Lot 1** – 1400 m<sup>2</sup>

**Balance** – 3752 m<sup>2</sup>

Codes relevant to the site and site plans are presented in Table 1. Climate Futures LiDAR 2008 elevations used in this assessment are considered suitable for the investigation purposes.

Table 1 Summary of Site Areas Falling Within Potential Coastal Vulnerability Zones

Site Location	Earth Elevation Range (m AHD)	TPS (C11.7.1) Overlay Low Risk	TPS (C11.7.1) Overlay Medium Risk	TPS (C11.7.1) Overlay High Risk
Site	~2 - 3	~60%	~40%	-

- Outside of Overlay

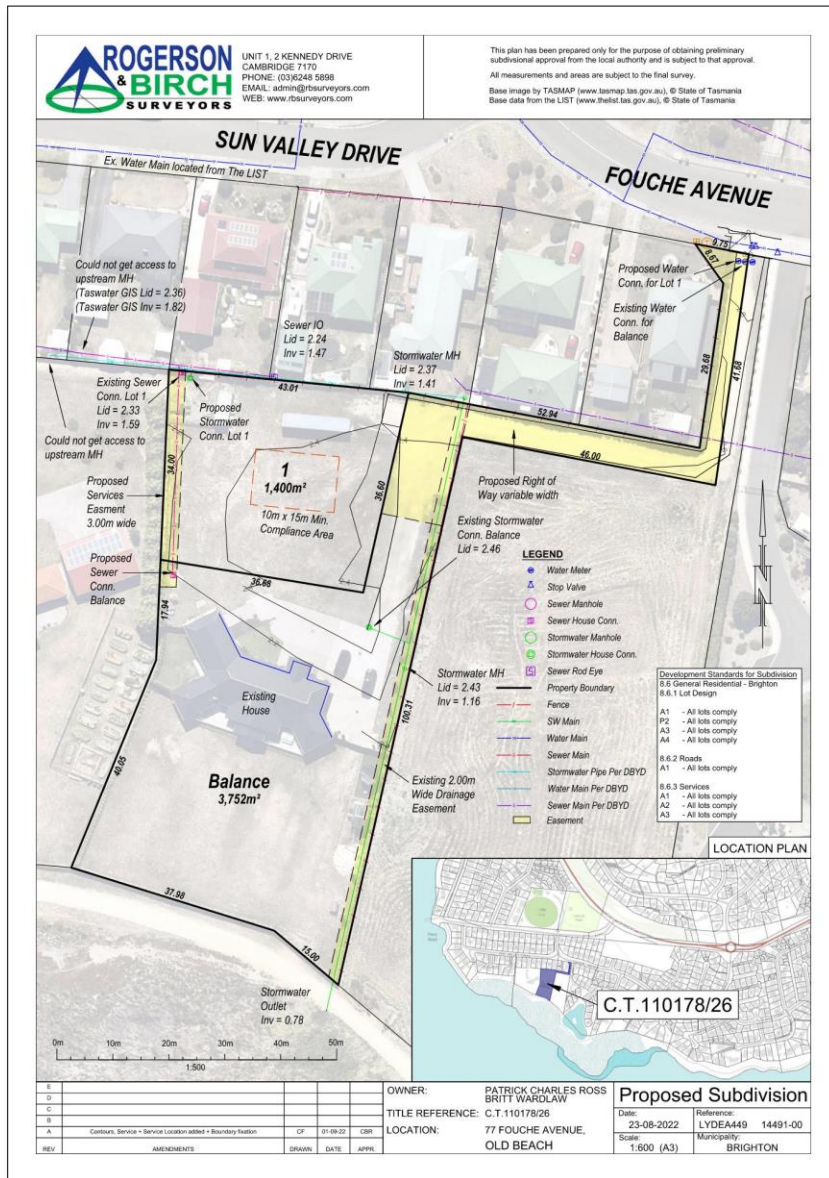


Figure 4 Proposed subdivision development plan

### 3.8 Acceptable Solutions

Where applicable, the need for further performance criteria compliance is outlined in Appendix 1.

#### 3.8.1 Coastal Inundation Hazard Code (C11)

As the proposed development resides in a Low Coastal Inundation Hazard Code Overlay and no acceptable solutions can be met for subdivision in CIHC Area, the C11.7.1 performance criteria will need to be addressed.

### 3.9 Performance Criteria

The following performance criteria are to be addressed:

- C11.7.1 P1

Each lot, or a lot proposed in a plan of subdivision within a coastal inundation hazard area must not create an opportunity for use or development that cannot achieve and maintain a tolerable risk from coastal inundation, having regard to:

- (a) any increase in risk from coastal inundation for adjacent land;
- (b) the level of risk to use or development arising from an increased reliance on public infrastructure;
- (c) the need to minimise future remediation works;
- (d) any loss or substantial compromise, by coastal inundation, of access to the lot on or off site;
- (e) the need to locate building areas outside the coastal inundation hazard area;
- (f) any advice from a State authority, regulated entity or a council; and
- (g) the advice contained in a coastal inundation hazard report.

## 4 Coastal Inundation Assessment

### 4.1 Coastal Inundation Levels

#### 4.1.1 Storm Tide

Storm tide events may be defined in terms of the culmination of astronomical tide and storm surge events. Maximum storm tide inundation levels have been adopted for the site based on a 1% AEP that an inundation event will occur (Source: Canute 3.0).

*The storm tide level adopted for the site is 1.24m.*

#### 4.1.2 Sea Level Rise

The sea level rise projections are based on the IPCC AR5's high emissions, 'business-as-usual' scenario, known as Representative Concentration Pathway 8.5, or RCP 8.5.

The following sea level rise planning allowances for Brighton Council:

- 0.29 m rise by 2050; and
- 0.85 m rise by 2100

It should be noted that sea level is expected to continue to rise beyond 2100. However, the Tasmanian sea level rise planning allowances are provided up until 2100 to align with projections provided by the IPCC.

Based on these figures, sea level elevations presented in Table 2 are applied to the site. The 2073 design life of the building is included in the assessment. These refined estimates for sea level rise are based upon the IPCC RCP8.5 climate scenario.

**Table 2 Brighton Council Sea Level Rise Planning Allowance – derived from RCP 8.5**

Sea Levels Allowance (Brighton Council)	DPAC RCP 8.5 2050	DPAC RCP 8.5 2073	DPAC RCP 8.5 2100
Sea Levels (m AHD)	0.29	0.51	0.85

The site inundation levels are defined by:

- Sea level rise of 0.29m AHD by 2050, 0.51 m AHD by 2073 and 0.85 m AHD by 2100
- Storm tide levels of 1.24 m
- Wind setup of 0.06 m
- Wave setup of 0.13 m

The combined inundation levels for the site are therefore at 1.94 m AHD for 2073 and 2.27 m AHD for 2100.

Any future residential construction on proposed Lot 1 in the subdivision must have a finished floor level at least 2.6 m AHD, so it is above current predictions for the Low Coastal Inundation Hazard Band 1% annual exceedance probability for 2100.

The development therefore will have an acceptable risk above the modelled 2100 coastal inundation level and there is a low risk to the building and future occupants.

## 5 Risk Assessment

The qualitative risk assessment criteria have been developed to identify key risks that may arise from building works in areas that are vulnerable to inundation hazards. The risk assessment is based on 2073 projected life of the building scenario.

The criteria are based on a risk assessment matrix consistent with Australian Standard AS4360 on Risk Management (AS4360). The qualitative assessment of risk severity and likelihood (Appendix 5) were used to help provide a qualitative risk assessment based upon the coastal vulnerability assessment completed for the site.

GES has established from the risk assessment that the level of risk is acceptable within the lifetime of the proposed subdivision. There are no medium or high-risk aspects to the proposed developments.

## 6 Conclusions and Recommendations

After the inundation assessment has been conducted for the subdivision located in a Low Inundation Hazard Area as defined under the Tasmania Planning Scheme- Brighton identifies that:

- The project area has an elevation from ~2.0 m AHD on the south portion of the site to increasing to 3m AHD on the northeast boundary.
- The combined inundation levels for the site has been estimated at 1.94 m AHD for 2073 and 2.27 m AHD for 2100.
- Any proposed habitable developments should have a finished floor level which complies with the Tasmanian Building Act which stipulates that the finished floor level of a development should be 0.3 above the site inundation level; All habitable buildings should comply with performance criteria C11.7.1 P1 and must be elevated at or above 2.6 m AHD;
- The site is not predicted to be subject to coastal erosion over the life of the buildings and no specific protection measures for erosion are required;
- Given that water movement is expected to be minimal during flooding, there is no requirement for specific flood or flow mitigation measures.

## Appendix 1 Acceptable Solutions

Standard	Code	Acceptable Solution		Performance Criteria
Use	C11.5.1 Change of Use	A1	No Acceptable solution	P1
Development	C11.6.1 Buildings and works, excluding coastal protection works, within a coastal inundation hazard area	A1	No Acceptable solution	P1.1 & P1.2
	C11.6.2 Coastal protection works within a coastal inundation hazard area	A1	No Acceptable solution	P1
Subdivision	C11.7.1 Subdivision within a coastal inundation hazard area	A1	<p>A1 Each lot, or a lot proposed in a plan of subdivision, within a coastal inundation hazard area, must:</p> <ul style="list-style-type: none"> <li>(a) be able to contain a building area, vehicle access, and services, that are wholly located outside a coastal inundation hazard area;</li> <li>(b) be for the creation of separate lots for existing buildings;</li> <li>(c) be required for public use by the Crown, a council or a State authority; or</li> <li>(d) be required for the provision of Utilities.</li> </ul>	P1

## *Appendix 2 Works in a Coastal Inundation Hazard Area*

According to this director's determination, the following regulations are applicable for the works in a coastal inundation hazard area:

- (1) For the purposes of this Determination and regulation 56(3) of the Building Regulations 2016, the defined flood level is the level above the 0 metre Australian Height Datum with a one percent probability of being exceeded in a storm surge flooding event in the year 2100, as specified in the Coastal Inundation Hazard Band Levels List for the relevant locality in the relevant Local Provisions Schedule of the Tasmanian Planning Scheme.
- (2) Where land is not located in a specified locality, the defined flood level for the relevant municipal area average applies.
- (3) A coastal inundation hazard report must be prepared.
- (4) The design of the building footing system must be prepared by an engineer-civil.
- (5) The building design (including the footing system) must take into account the coastal inundation hazard report.
- (6) In determining an application for a Certificate of Likely Compliance, the building surveyor must:
  - (a) take into account the coastal inundation hazard report and any relevant coastal inundation management plan; and
  - (b) be satisfied that the proposed work will not cause or contribute to coastal inundation on the site, on adjacent land or of public infrastructure; and
  - (c) be satisfied that the proposed work can achieve and maintain a tolerable risk for the intended life of the building without requiring any specific coastal inundation protection measures.
- (7) In determining an application for a permit, the permit authority must take into account the coastal inundation hazard report and any relevant coastal inundation management plan

## Appendix 3 Directors Determination & Building Regulations 2016 - Coastal Inundation Hazard Reporting

This coastal inundation hazard report has been prepared in accordance with methodology specified in the Directors Determination – Coastal Inundation Hazard Areas pursuant to section 20(1)(c) of the Building Act 2016 and regulation 51 of the Building Regulations 2016 (Document Version 1.2 Dated 27<sup>th</sup> September 2021).

This report has been prepared by John Paul Cumming who has over 15 years' experience in the preparation and supervision of over 300 coastal inundation hazard assessment reports for residential and commercial developments for both the private and public sector.

Practices used in this assessment are developed from recent literature, including regional public domain remote sensing, wave, sea level, and storm tide modelling data obtained through various government agencies. This data is refined to a local (site scale) using detailed bathymetry models and methods within the coastal engineering manual (CEM) as well as equations obtained from recent publications to determine wind setup, wave setup, and wave runup which is specific to the coastal setting.

Specific determinations regarding coastal hazard reporting as presented in the Director's Determination - Coastal Inundation Hazard Areas, Division 2, Section 4 'Coastal Inundation Hazard Reporting' are presented in the Table below.

Signature

A handwritten signature in blue ink, consisting of a series of loops and a long horizontal stroke extending to the right.

Dr John Paul Cumming B.Agr.Sc (hons) PhD CPSS GAICD

Report Determination Criteria	Coastal Inundation Hazard Report Compliance Checklist	Compliance	Specific Comments
4. (1)	Report is prepared by a specified practitioner being a practitioner with relevant qualifications, experience and competence in the preparation of coastal inundation hazard reports	Yes	Up to date models, literature and methods are used in this assessment, which draw on regional and site-specific information to determine present day and forward projected site hazards.
4. (1) (a)	Signed Declaration	Yes	
4. (1) (b)	Conclusions based on consideration of the proposed work as to:		
4. (1) (b) (i)	whether the work is likely to cause or contribute to coastal inundation on the land or on adjacent land or of public infrastructure;	Yes	Buildings development will not impose any additional risks
4. (1) (b) (iii)	whether the work can achieve and maintain a tolerable risk for the intended life of the building having regard to:	Yes	<p>Modelling has been conducted with measures put in place to ensure that by the end of the building's lifetime, the risks are tolerable in line with the sites typical residential use and typical intensity of this use. This assessment is based on the intended use as outlined in the development application. All potential and site-specific inundation factors are considered to assess tolerable risks which include:</p> <ul style="list-style-type: none"> <li>• Government sea level projections which are calibrated to the Local Government Authority area and scaled to the building design life (DPAC 2016),</li> <li>• Storm tide projections (combined 1% AEP storm surge and tides) which are calculated on a local scale (0.5 km accuracy)</li> <li>• Wind setup conditions specific to the site which are calculated from all wind fetch directions</li> <li>• Wave setup and wave runup based on detailed wave modelling which has been conducted, specific to the site: <ul style="list-style-type: none"> <li>○ Localised wind generated waves based on dominant wind fetch incidents and calculated based on 1% AEP wind velocity and durations. Nearshore wave parameters determined based on sea level compensated water depths (to building design life) and bathymetry attenuation.</li> </ul> </li> </ul>
	<ul style="list-style-type: none"> <li>• the nature, intensity and duration of the use;</li> </ul>	Yes	The risk assessment herein is based on the highest intensity of use which is residential use. Full occupancy duration is considered over the lifetime of the development. The full inundation extent is based on a 1% AEP event occurring at the end of the buildings design life.
	<ul style="list-style-type: none"> <li>• the type, form and duration of an development;</li> </ul>	Yes	This assessment is based on the specific plans as outlined in the development application, with the duration based on the building design life as defined herein. Particularly where wave runup is concerned, consideration is given to the

			presence of solid walls on ground versus buildings elevated above ground on piers, with both scenarios affecting the wave runup height against the building. Where necessary, consideration may need to be given to reinforcing the structure against the wave force load which is to be calculated.
	<ul style="list-style-type: none"> <li>the likely change in the risk across the intended life of the building;</li> </ul>	Yes	As indicated in 4. (1) (b) (iii), consideration is given to risk in the most adverse of modelled consecutive 1% AEP storm conditions for the projected end life of the building. Where deemed necessary, a 0.3 m freeboard 'buffer' is to be applied to design 1% AEP stillwater level for the building end of life.
	<ul style="list-style-type: none"> <li>the ability to adapt to a change in the risk;</li> </ul>	Yes	Engineering solutions may be applied if it is so desired to reduce the risk through hazard reduction. Increased risk may occur as a result of increased user vulnerability beyond what is modelled as a tolerable risk in this assessment. E.g. Changed site layout meaning reduced access during a floodwater event. Hazard reduction may include onsite wave attenuation structures such as wave breaker walls and/or revetments.
	<ul style="list-style-type: none"> <li>the ability to maintain access to utilities and services;</li> </ul>	Yes	
	<ul style="list-style-type: none"> <li>the need for specific coastal inundation hazard reduction or protection measures on the site;</li> </ul>	Yes	Coastal inundation hazard reduction or protection measures are not recommended on the site based on the projected lifetime of the proposed development.
	<ul style="list-style-type: none"> <li>the need for coastal inundation hazard reduction or protection measures beyond the boundary of the site;</li> </ul>	NA	Coastal inundation hazard reduction or protection measures are not recommended beyond the boundary of the site based on the projected lifetime of the proposed development.
	<ul style="list-style-type: none"> <li>any coastal inundation management plan in place for the site and/or adjacent land.</li> </ul>	NA	Where necessary, a coastal inundation management plan may be developed where mitigation is deemed to be effective against adverse erosion conditions.
4. (2)	protection measures for any hazardous chemical used, handled, generated or stored on the site, taking into consideration the potential risks of the hazardous chemical to human health and safety as a consequence of coastal erosion on the site or adjacent land.	Yes	GES are not aware of any proposal for hazardous chemicals to be used, handled, generated or stored on the site. It is recommended that if such chemicals are to be stored within the proposed extension, they are elevated above the designated inundation level.
4. (3)	The declaration format for a coastal inundation hazard report must contain:	Yes	
4. (3) (a)	details of, and be signed by, the person who prepared or verified the report;	Yes	
4. (3) (b)	confirmation they have the appropriate qualifications, expertise and level of current indemnity insurance;	Yes	
4. (3) (c)	confirmation that the report has been prepared in accordance with the specified methodology.	Yes	

# Appendix 4 Quantitative Risk Assessment Tables

## Consequence Index

Consequence	Details - Storm Erosion and Inundation	Details – Waterways and Coastal Protection
Catastrophic	Loss of life, loss of significant environmental values due to a pollution event where there is not likely to be recovery in the foreseeable future.	Very serious environmental effects with impairment of ecosystem function. Long term, widespread effects on significant environment (eg. RAMSAR Wetland)
Major	Extensive injuries. Complete structural failure of development, destruction of significant property and infrastructure, significant environmental damage requiring remediation with a long-term recovery time.	Serious environmental impact effects with some impairment of ecosystem function. Relatively widespread medium-long term impacts.
Moderate	Treatment required, significant building or infrastructure damage i.e. loss of minor outbuildings such as car ports, garages and the like. Replacement of significant property components. linings, hard paved surfaces, cladding, flooring. Moderate environmental damage with a short-term natural or remedial recovery time.	Moderate effects on biological or physical environment (air, water) but not affecting ecosystem function. Moderate short term widespread impacts (e.g. significant spills)
Minor	Medium loss – repair of outbuildings and repair and minor replacement of building components of buildings. Replacement of floor/window coverings, some furniture through seepage (where applicable). Minor environmental damage easily remediated.	Minor effects on biological or physical environment. Minor short-term damage to small area of limited significance.
Insignificant	No injury, low loss – no replacement of habitable building components, some remediation of garden beds, gravel driveways etc. Environment can naturally withstand and recover without remediation. Inundation of the site, but ground based access is still readily available and habitable buildings are not inundated, including incorporated garages.	Limited damage to minimal area of low significance.

## Likelihood Index

Level	Descriptor	Description	Guideline
A	Almost Certain	Consequence is expected to occur in most circumstances.	Occurs more than once per month.
B	Likely	Consequence will probably occur in most circumstances.	Occurs once every 1 month – 1 year.
C	Occasionally	Consequence should occur at some time.	Occurs once every 1 year - 10 years.
D	Unlikely	Consequence could occur at some time.	Occurs once every 10 years – 100 years.
E	Rare	Consequence may only occur in exceptional circumstances.	Occurs less than once every 100 years.

Source: AS/NZS 4360:2004 Risk Management

## Qualitative Risk Matrix

Likelihood of the Consequence	Maximum Reasonable Consequence				
	(1) Insignificant	(2) Minor	(3) Moderate	(4) Major	(5) Catastrophic
(A) Almost certain	11 High	16 High	20 Extreme	23 Extreme	25 Extreme
(B) Likely	7 Moderate	12 High	17 High	21 Extreme	24 Extreme
(C) Occasionally	4 Low	8 Moderate	13 High	18 Extreme	22 Extreme
(D) Unlikely	2 Low	5 Low	9 Moderate	14 High	19 Extreme
(E) Rare	1 Low	3 Low	6 Moderate	10 High	15 High

Source: AS/NZS 4360:2004 Risk Management

## Appendix 5 Quantitative Risk Assessment

### SUBDIVISION WITHIN A COASTAL INUNDATION HAZARD AREA

Performance Criteria C11.7.1 P1  Each lot, or a lot proposed in a plan of subdivision within a coastal inundation hazard area must not create an opportunity for use or development that cannot achieve and maintain a tolerable risk from coastal inundation, having regard to:	Relevance	Management Options	Preliminary Risk Assessment (where relevant)			Further Assessment Required
			Consequence	Likelihood	Risk	
a) any increase in risk from coastal inundation for adjacent land;	The proposed subdivision development will not increase risk for adjacent land. Given the very low wave run up levels, there is a low risk that the proposed development will present a risk to users of the site, adjoining or nearby land.	All habitable areas must be sited at or above 2.6 m AHD	Minor (2)	Unlikely (D)	Low (1)	No
b) the level of risk to use or development arising from an increased reliance on public infrastructure;	The proposed sites will have connection to public infrastructure, and will have minor impact upon catchment flows, no significant increase in risk.	Not required	Minor (2)	Unlikely (D)	Low (1)	No
c) the need to minimise future remediation works;	Based on the modelling completed, there is not projected to be need for future remediation works	Not required	Insignificant (1)	Rare (E)	Low (1)	No
d) any loss or substantial compromise, by coastal inundation, of access to the lot on or off site;	Based on the modelling completed access will not be compromised by estimated coastal inundation level for building life	Not required	Insignificant (1)	Rare (E)	Low (1)	No
e) the need to locate building areas outside the coastal inundation hazard area;	Based on the modelling completed future buildings will be above the estimated coastal inundation level for building life	FFL must be at or above 2.6m AHD as per TPS - Brighton requirements	Minor (2)	Unlikely (D)	Low (1)	No
f) any advice from a State authority, regulated entity or a council; and	Reference to planning scheme requirements or state policy	FFL must be at or above 2.6m AHD as per TPS - Brighton requirements				No
g) the advice contained in a coastal inundation hazard report.		Refer to recommendations	Minor (2)	Unlikely (D)	Low (1)	No

# Amended Submission to Planning Authority Notice

## Application details

Council Planning Permit No.	DA 2025/24
Council notice date	5/03/2025
TasWater Reference No.	TWDA 2025/00210-BTN
Date of response	<b>22/04/2026 Amendment</b> 21/03/2025
TasWater Contact	Timothy Carr
Phone No.	0419 306 130

## Response issued to

Council name	BRIGHTON COUNCIL
Contact details	development@brighton.tas.gov.au

## Development details

Address	77A FOUCHE AV, OLD BEACH
Property ID (PID)	9139725
Description of development	Multiple Dwellings x 4

## Schedule of drawings/documents

Prepared by	Drawing/document No.	Revision No.	Issue date
Pinnacle Drafting & Design	<b>Site Plan – A0.02 &amp; A0.03</b>	<b>DA-06</b>	<b>07/04/2026</b>
	<del>Site Plan – A0.03</del>	<del>DA-03</del>	<del>14/03/2025</del>
Pinnacle Drafting & Design	U1-U4 Floor Plan – A1.01, A2.01, A3.01 & A4.01	<b>DA-06</b>	<b>07/04/2026</b>
		<del>DA-03</del>	<del>14/03/2025</del>

## Conditions

Pursuant to the *Water and Sewerage Industry Act 2008 (TAS)* Section 56P(1) TasWater imposes the following conditions on the permit for this application:

### CONNECTIONS, METERING & BACKFLOW

1. A suitably sized water supply with metered connections and sewerage system and connections to the development must be designed and constructed to TasWater's satisfaction and be in accordance with any other conditions in this permit.
2. Any removal/supply and installation of water meters and/or the removal of redundant and/or installation of new and modified property service connections must be carried out by TasWater at the developer's cost.
3. Prior to commencing construction of the development, any water connection utilised for construction must have a backflow prevention device and water meter installed, to the satisfaction of TasWater.

#### **DEVELOPER CHARGES**

4. Prior to TasWater issuing a Certificate(s) for Certifiable Work (Building) and/or (Plumbing), the applicant or landowner as the case may be, must pay a developer charge totalling \$3,865.40 to TasWater for water infrastructure for 2.20 additional Equivalent Tenements, indexed by the Consumer Price Index All groups (Hobart) from the date of this Submission to Planning Authority Notice until the date it is paid to TasWater.
5. Prior to TasWater issuing a Certificate(s) for Certifiable Work (Building) and/or (Plumbing), the applicant or landowner as the case may be, must pay a developer charge totalling \$5,271.00 to TasWater for sewerage infrastructure for 3.00 additional Equivalent Tenements, indexed by the Consumer Price Index All groups (Hobart) from the date of this Submission to Planning Authority Notice until the date it is paid to TasWater.

#### **DEVELOPMENT ASSESSMENT FEES**

6. The applicant or landowner as the case may be, must pay a development assessment fee of \$403.51 to TasWater, as approved by the Economic Regulator and the fee will be indexed, until the date paid to TasWater.

**The payment is required within 30 days of the issue of an invoice by TasWater.**

### **Advice**

#### **General**

For information on TasWater development standards, please visit

<https://www.taswater.com.au/building-and-development/technical-standards>

For application forms please visit

<https://www.taswater.com.au/building-and-development/development-application-form>

#### **Important Notice Regarding Plumbing Plans and Associated Costs**

The SPAN includes references to documents submitted as part of the application. These plans are acceptable for planning purposes only and are subject to further detailed assessment and review during the next stage of the development proposal.

TasWater's assessment staff will ensure that the design contains sufficient detail to assess compliance with relevant codes and regulations. Additionally, the plans must be clear enough for a TasWater contractor to carry out any water or sewerage-related work.

Depending on the nature of the project, your application may require Building and/or Plumbing permits or could be exempt from these requirements. Regardless, TasWater's assessment process and associated time are recoverable through an assessment fee.

Please be aware that your consultant may need to make revisions to their documentation to ensure the details are fit for construction. Any costs associated with updating these plans should be discussed directly with your consultant.

### **Developer Charges**

For information on Developer Charges please visit the following webpage - <https://www.taswater.com.au/building-and-development/developer-charges>

### **Water Submetering**

As of July 1 2022, TasWater's Sub-Metering Policy no longer permits TasWater sub-meters to be installed for new developments. Please ensure plans submitted with the application for Certificate(s) for Certifiable Work (Building and/or Plumbing) reflect this. For clarity, TasWater does not object to private sub-metering arrangements. Further information is available on our website ([www.taswater.com.au](http://www.taswater.com.au)) within our Sub-Metering Policy and Water Metering Guidelines.

### **Declaration**

The drawings/documents and conditions stated above constitute TasWater's Submission to Planning Authority Notice.